



Technical Standards and Safety Authority
 345 Carlingview Drive
 Toronto, Ontario M9W 6N9
 Fax: 416.231.4078
 Customer Service: 1.877.682.8772
 www.tssa.org

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
 Propane Storage and Handling Regulation

This Level 1 RSMP applies to:

- a facility with a total propane storage capacity of 5,000 USWG or less, or
- a facility with a fixed propane storage capacity of exactly 5,000 USWG and no more than 500 USWG of portable propane storage capacity.


Failure to fully complete this form may result in rejection.
 Making a false statement may result in a fine or prosecution
 under the *Technical Standards and Safety Act*

Licence Number: 000272169

Check applicable type of propane operations:

Cylinder Motor Fill Filling Plant Card/Keylock

Submit along with this completed application a Facility Site Plan and a Map of the Surrounding Area.



SECTION A: GENERAL INFORMATION

The Undersigned applies to TSSA for a review for an RSMP under Ontario's *Technical Standards and Safety Act*, Propane Storage and Handling Regulation.

A Company Name: 2523298 Ontario Corporation Corporation No.: 002523298

Operator Name (if different from above): Ousmane Taranaguada

Telephone No.: 705-821-3700 Fax No.: E-mail: otarana@yahoo.ca

B Street No.: 127 Street Name / 911 Number / Address, if applicable: Nappadale St

Town / City or Township / County: Woodville Province: Ontario Postal Code: K0M 2T0

C Mailing address if different from above.

Street No.: 127 Street Name / 911 Number / Address, if applicable: Nappadale St

Town / City or Township / County: Woodville Province: Ontario Postal Code: K0M 2T0

D Information on Container Refill Centre or Filling Plant

Location of facility:

Street No.: 127 Street Name / 911 Number / Address, if applicable: Nappadale St Nearest Major Intersection: King St and Nappadale St

Town / City or Township / County: Woodville Province: Ontario Postal Code: K0M 2T0

Name of Licence Holder: 2523298 Ontario Corporation

Name of a Senior Management person as defined in the regulation holding the Record of Training (ROT): Ousmane Taranaguada ROT type: RSMP Level 1

Municipality (or municipalities if the facility or its hazard distance touches multiple borders): Kawartha Lakes

Hours of operation:

This document is valid until the next licence renewal date. You are required by law to notify TSSA of any change of information.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Print name	Signature	Date (dd-mmm-yyyy)
Name of Licence Holder: 2523298 Ontario Corporation		Jan 3 / 17
Name of Senior Management person as defined in the Regulation holding the Record of Training: Ousmane Taranaguada		



Technical Standards and Safety Authority
 345 Carlingview Drive
 Toronto, Ontario M9W 6N9
 Fax: 416.231.4078
 Customer Service: 1.877.682.8772
 www.tssa.org

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
 Propane Storage and Handling Regulation

SECTION A: GENERAL INFORMATION (cont'd)


Indicate the year the facility was established. 2007 Indicate the year of any significant modifications, as defined in s.1, O.Reg 211/01, since establishment.

Identify the psig rating and serial number for each fixed propane storage tank on site.


	PSIG	Serial Number
Tank 1	<u>250</u>	<u>204-91</u>
Tank 2	_____	_____
Tank 3	_____	_____

Enter capacity of propane in USWG, fixed, portable, and mobile, and provide detailed inventory that includes the number of tank/vessel for each type (fixed, portable, and mobile) and the capacity of each tank/vessel, on a separate document.

Fixed: 1,000 Portable: 116 Mobile: 0



Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Ousmane Taranagueda	Official Title Director
Signature 	Telephone No. 416-712-1250
	Date (dd-mmm-yyyy) <u>Jan 3/17</u>



Technical Standards and Safety Authority
 345 Carlingview Drive
 Toronto, Ontario M9W 6N9
 Fax: 416.231.4078
 Customer Service: 1.877.682.8772
 www.tssa.org

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
 Propane Storage and Handling Regulation

SECTION A: GENERAL INFORMATION (cont'd)
 Activity Information

Name of Propane Supplier(s)			For Office Use - Party No.		
Budget Propane Corporation					
Street No.	Street Name / 911 Number / Address, if applicable				
1011	Beiers Rd				
Town / City or Township / Country			Province	Postal Code	
Gravenhurst			Ontario	P1P 1R1	
Telephone No.	Fax No.	Contact Name			
705-687-5608	705-687-1305	Jacco Bos / James Callow			
E-mail					
jacco@budgetpropane.net / james@budgetpropane.net					

Name of Propane Transporter. If same as above, please check box. <input checked="" type="checkbox"/>			For Office Use - Party No.		
Street No.	Street Name / 911 Number / Address, if applicable				
Town / City or Township / Country			Province	Postal Code	
Telephone No.	Fax No.	Contact Name			
E-mail					

Off-site Cylinder and/or Mobile Storage		Capacity stored off-site, in USWG	For Office Use - Party No.
Street No.	Street Name / 911 Number / Address, if applicable		
Town / City or Township / Country		Province	Postal Code
Telephone No.	Fax No.	Contact Name	

Note: Customer storage is not considered off-site storage.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print)		Official Title	
Ousmane Taranagueta		Director	
Signature		Telephone No.	Date (dd-mmm-yyyy)
		416-712-1250	Jan 3/17



Technical Standards and Safety Authority
 345 Carlingview Drive
 Toronto, Ontario M9W 6N9
 Fax: 416.231.4078
 Customer Service: 1.877.682.8772
 www.tssa.org

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
 Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN

The licence holder will complete Section B in consultation with the local Fire Services.

Description of the maximum volume, types and storage location of other hazardous materials on site, if any.

Gasoline - 45,000 L Regular & 45,000 L Premium fuel in underground tanks - Location at front of property where vent pipes are located

Diesel - 15,000 L underground tank - Location at front of property where vent pipe is located

Store contains retail containers of fuel conditioners, antifreeze, power steering fluid etc. typical of a gas station variety store

Description of fire and emergency equipment indicated on facility site map.

1 x Fire extinguisher located inside the store

1 x Fire extinguisher located at propane pumping station inside the weighing scale cabinet

List of fire protection controls (e.g., fire detection systems, fire notification systems, alarm systems, automatic shut off devices, fusible links, etc.) and describe their function, use and operation.

The gas station store is equipped with smoke detectors to alert staff


Manual Emergency Stop on back of variety store

Maintenance and testing schedule for fire protection controls and devices.

Smoke detectors will be tested and batteries replaced every 6 months

The E stop will be tested annually

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Ousmane Taranaguada	Official Title Director
Signature 	Telephone No. 416-712-1250
	Date (dd-mmm-yyyy) Jan 3/17



Technical Standards and Safety Authority
 345 Carlingview Drive
 Toronto, Ontario M9W 6N9
 Fax: 416.231.4078
 Customer Service: 1.877.682.8772
 www.tssa.org

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
 Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

1. Contacts for Emergency Response

1. Facility Contact Personnel - Key Contact

Name	Ousmane Taranaguada	For Office Use - Party No.	
Official Title	Director		
Telephone No.	416-712-12580	Fax No.	
E-mail	otarana@yahoo.ca		
Role and responsibilities in emergency	Management and coordination of Emergency Services and evacuation as required		

5. Facility 24-Hour Contact Person

Name	Ousmane Taranaguada	For Office Use - Party No.	
Official Title	Director		
Cell No.	416-712-12580	Fax No.	
E-mail	otarana@yahoo.ca		
Role and responsibilities in emergency	Management and coordination of emergency services and evacuation as required		

2. Facility Contact Personnel - Alternate Contact

Name	Ibrahim Taranaguada	For Office Use - Party No.	
Official Title	Manager / Attendant		
Telephone No.	705-821-3700	Fax No.	
E-mail			
Role and responsibilities in emergency	Shut Down all fuel transfer systems including propane system. Notify key contacts and emergency services		

6. Name of Facility Manager

Name	Ibrahim Taranaguada	For Office Use - Party No.	
Official Title	Manager / Attendant		
Telephone No.		Fax No.	
E-mail			
Role and responsibilities in emergency			

3. Local Fire Services - Key Contact

Name	Jason Teel	For Office Use - Party No.	
Official Title	Fire Hall Coordinator	E-mail	
Telephone No.	705-439-2734	Fax No.	
Role and responsibilities in emergency	Coordination of Woodville Fire Department		
Fire Services Address	114 Argyle St. Woodville Ontario,		

7. Propane Supplier Key Contact Person

Name	Budget Propane - Jacco Bos / James Callow	For Office Use - Party No.	
Official Title	Engineer / President	E-mail	jacco or james@budgetpropane.net
Telephone No.	705-687-5608	Fax No.	705-687-1305
Role and responsibilities in emergency	Provide support to emergency services as required. Contact ERAC through CPA if required		
Propane Supplier Address	1011 Beiers Rd. Gravenhurst, Ontario Canada P1P 1R1		

4. Local Fire Services - Alternate Contact

Name		For Office Use - Party No.	
Official Title		E-mail	
Telephone No.		Fax No.	
Role and responsibilities in emergency			
Fire Services Address	114 Argyle St. Woodville Ontario		

8. Municipal Contact

Name	Andrew Veale	For Office Use - Party No.	
Official Title	Councillor Ward 4		
Telephone No.	705-439-2434	Fax No.	
E-mail	aveale@city.kawarthalakes.on.ca		
Municipality Name and Address	Kawartha Lakes		

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print)	Ousmane Taranaguada	Official Title	Director
Signature		Telephone No.	416-712-1250
		Date (dd-mmm-yyyy)	Jan 3 / 17



Technical Standards and Safety Authority
 345 Carlingview Drive
 Toronto, Ontario M9W 6N9
 Fax: 416.231.4078
 Customer Service: 1.877.682.8772
 www.tssa.org

Level 1 Risk and Safety Management Plan (RSMP)

Technical Standards and Safety Act
 Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

3. Record of Emergency Training Provided - For most recent 12-month period.

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Training Date (dd-mmm-yyyy) <u>2016-08-23</u>	Print Name of Training Provider: <u>FUELS Learning Centre</u>
	Print Name of Instructor: <u>DONALD SAARI</u>
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Training on the facility's Emergency Management Procedures provided to staff.

Training Date (dd-mmm-yyyy) <u>016 2016 -08-23</u>	Print Name of Training Provider: <u>Fuels Learning Centre</u>
	Print Name of Instructor: <u>Donald Saari</u>
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

On-site specific training provided to certificate holders / persons with Records of Training.

Training Date (dd-mmm-yyyy) <u>2016-08-23</u>	Print Name of Training Provider: <u>Fuels Learning Centre</u>
	Print Name of Instructor: <u>Donald Saari</u>
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Ousmane Taranagueda	Official Title Director
Signature 	Telephone No. 416-712-1250
	Date (dd-mmm-yyyy) <u>Jan 3/17</u>



Technical Standards and Safety Authority
 345 Carlingview Drive
 Toronto, Ontario M9W 6N9
 Fax: 416.231.4078
 Customer Service: 1.877.682.8772
 www.tssa.org

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
 Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

4. Emergency Training Plan for Coming Year

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Target Date (dd-mmm-yyyy) <i>2017-08-01</i>	Print Name of Training Provider: <i>Ousmane Taranagneda</i>
	Print Name of Instructor: <i>Ousmane Taranagneda</i>
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:


Training on the facility's Emergency Management Procedures provided to staff.

Target Date (dd-mmm-yyyy) <i>2017-08-01</i>	Print Name of Training Provider: <i>Ousmane Taranagneda</i>
	Print Name of Instructor: <i>Ousmane Taranagneda</i>
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

On-site specific training provided to certificate holders / persons with Records of Training.

Target Date (dd-mmm-yyyy) <i>2017-08-01</i>	Print Name of Training Provider: <i>Ousmane Taranagneda</i>
	Print Name of Instructor: <i>Ousmane Taranagneda</i>
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Ousmane Taranagneda	Official Title Director
Signature 	Telephone No. 416-712-1250
	Date (dd-mmm-yyyy) <i>Jan 31/17</i>



Technical Standards and Safety Authority
 345 Carlingview Drive
 Toronto, Ontario M9W 6N9
 Fax: 416.231.4078
 Customer Service: 1.877.682.8772
 www.tssa.org

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
 Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

5. Emergency Response Communications Plan

Warnings and Actions

Describe who gives warnings to whom, and how and when the warning will be given (including public notification as appropriate).
 In the event of a release of fuel into the environment that represents a safety risk, a leak that can't be controlled or sealed or any indication of a fire hazard:
 the attendant on site, Ousmane or Ibrahim, will issue a warning and notify emergency services and all personnel and members of the public in the immediate vicinity including Di Bello Towing, gas station and house of the emergency situation and instruct them to evacuate the area to a distance of at least 200 m from the gas station. Emergency Services will notify neighbors within the 1 psi over pressure radius as required based on the hazard.

Describe what action is to be taken and by whom when a warning is issued (including details of a meeting place in a safe identified area and activating the evacuation plan, if necessary).
 Following emergency alert, Ousmane or Ibrahim will shut off the electric power to fuel transfer equipment by disconnecting the main breaker inside the store. All personnel are to leave the vicinity and congregate at the church parking lot 250 m south of the gas station across from the elementary school. Attendance will be taken by Ibrahim to account for all personnel

Communication with Emergency Response Authorities


Describe when and how the licence holder will give early warning to emergency response authorities (including a process to ensure that a call is placed to 911).
 Upon identification of a fire related hazard (example, an uncontrolled propane leak or indication of fire) Ibrahim, Ousmane or the attendant on shift will call 911 with their cell phone while notifying other staff & customers of the emergency.
 Ousmane and Ibrahim will remain on the phone with 911 dispatch to follow instructions while evacuating the area.

Describe provisions for fire department entry when there are no operations or staffing at the propane site.
 The site is accessible at all times. The propane tank is located behind the gas station store. Vehicle access is possible 24/7

Describe how the licence holder will ensure continual flow of updated information to authorities.
 All changes to the RSMP will be forwarded to the key contact list above.

How long will it take the facility liaison person to respond to the site.
 As Ibrahim and Ousmane are both management and operator of the gas bar it is expected that they will be on site during business hours. After hours a maximum 1 hour response time will be typical depending on circumstances.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Ousmane Taranaguada		Official Title Director	
Signature 		Telephone No. 416-712-1250	Date (dd-mmm-yyyy) Jan 31/17



Technical Standards and Safety Authority
 345 Carlingview Drive
 Toronto, Ontario M9W 6N9
 Fax: 416.231.4078
 Customer Service: 1.877.682.8772
 www.tssa.org

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
 Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

6. Building and Site Security and Procedures

- | | Yes | No |
|---|-------------------------------------|--------------------------|
| 1. Does the propane location have controlled access to limit unnecessary risk and entry (lock out procedures)? | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 2. Is there adequate night lighting at the site? | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 3. Are procedures in place that ensure access routes, aisles, storage area, filling areas and the grounds are kept clear from unwanted materials? | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 4. Are there procedures that capture and record the daily inspection of hoses and inspection requirements for filling systems and mechanical devices used in the transfer of propane? | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 5. Does the facility have procedures that include a process to isolate and purge any overfilled propane cylinders? | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 6. Are weighing systems validated for accuracy? | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 7. Are storage areas clearly marked with the vessels' capacity status (i.e., filled, empty, purged and other hazardous materials)? | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 8. Are quality assurance procedures in place to ensure that all valves are closed after the propane cylinders are filled?(e.g., QCC valves) | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 9. Is the schedule of maintenance and testing activities retained on site? | <input checked="" type="checkbox"/> | <input type="checkbox"/> |

7. Water Supply

The propane licence holder should work with the local fire department to determine water supply capabilities that are available based on the propane facility's location.

- | | Yes | No |
|---|-------------------------------------|--------------------------|
| 1. Is a pressurized water system available at the propane facility site? | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 2. Can the municipal fire department pump 375 GPM (1420 LPM) of water at this location? | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 3. What is the unobstructed distance to the closest water supply that could be used for firefighting activities? (distance in metres only) | | 150 m |
| 4. What is the unobstructed distance to the closest approved water supply with year round access if there are no hydrants? (distance in metres only) | | _____ |

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Ousmane Taranagueda	Official Title Director
Signature 	Telephone No. 416-712-1250
	Date (dd-mmm-yyyy) Jan 3/17

Victoria Scarsella

From: Ousmane T <otarana@yahoo.ca>
Sent: Thursday, January 26, 2017 12:23 PM
To: Propane Licensing
Cc: Ousmane Taranagueda
Subject: woodville gas station...fire dept communication
Attachments: Fire Services to sign sign page 11.doc

attention: victotia scarsella

Fire Services to sign sign page 11 (7)

Ousmane T <otarana@yahoo.ca> Hello, It was nice talking to you today. Here is the RSMP attached, page 11 to be signed. TSSA does not require a letter. Thanks Ousmane 4167121250

To

fmattern@city.kawarthalakes.on.ca

CC

otarana@yahoo.ca

Jan 23 at 1:53 PM

Hello,

It was nice talking to you today. Here is the RSMP attached, page 11 to be signed. TSSA does not require a letter.

Thanks
Ousmane
4167121250

-
-
- 2 Attachments
- [View all](#)
- [Download all](#)

- No
Preview

[Download](#)

tssa-page7-8 .pdf

- No
Preview

[Download](#)

woodville-gas-station-rsmp



Technical Standards and Safety Authority
 345 Carlingview Drive
 Toronto, Ontario M9W 6N9
 Fax: 416.231.4078
 Customer Service: 1.877.682.8772
 www.tssa.org

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
 Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)
 The licence holder will complete Section B in consultation with the local Fire Services.
 8. Licence holder and local Fire Services Review

To be completed by the Local Fire Services

Has the local fire service had an opportunity to review the Emergency Response and Preparedness Plan? Yes No

If not, please explain (e.g., no fire services).

Fire services comments, if any:

To be completed by the Licence Holder

In response to the above comments, the following action(s) is required:

The licence holder will respond to the Local Fire Services comments by: _____ (dd-mmm-yyyy)

LOCAL FIRE SERVICES

The undersigned has reviewed Section B of the Risk and Safety Management Plan Fire Services.

Print name	Signature	Date (dd-mmm-yyyy)
Local Fire Services Name		

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Ousmane Taranagueda	Official Title Director	
Signature 	Telephone No. 416-712-1250	Date (dd-mmm-yyyy) Jan 3/17



Technical Standards and Safety Authority
 345 Carlingview Drive
 Toronto, Ontario M9W 6N9
 Fax: 416.231.4078
 Customer Service: 1.877.682.8772
 www.tssa.org

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
 Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS
 Applicant must include a Facility Site Plan and Map of Surrounding Area

Facility Site Plan.

The licence holder will submit a copy of the original facility site plan updated with the following information:

1. The storage location of fixed, portable, and mobile vessels.
2. The maximum volume, types and storage location of hazardous materials.
3. Location of permanent structures on site.
4. Access and egress points and location of barriers.
5. Location of fire and emergency equipment (e.g., sprinkler systems, extinguishers, suppression systems) on site and location of fire hydrant or water supply where available.
6. Location of emergency shut off/shut down switches/valves.

Map of Surrounding Area.

The licence holder will submit a scaled aerial map of the surrounding area showing the following information:

7. The capacity and placement of the single largest propane storage vessel, including its setback from the front, rear and side property lines.
8. GPS co-ordinates of the single largest vessel.
9. Visual indication of the single largest fixed vessel and a circle made using the distance in Table 1 as the radius from the single largest fixed vessel.
10. Clear indication of the municipality or municipalities present within the circle.
11. Visual indication of property line information.
12. The location and name of roads within or abutting the site.
13. Key note to the drawing indicating the facility's municipal address, municipal lot number(s) and concession lines as applicable, and the date the map was prepared.
14. Address and contact information for each municipality (municipal clerk or secretary-treasurers of planning board). (Refer to page 5.)
15. Complete "Required Mapping Information from Updated Site Plan" in table below.

Required Mapping Information from Updated Site Plan

Date map prepared (dd-mmm-yyyy) December 28 2016	Capacity of single largest propane storage vessel (USWG) 1000 uswg
Tank setback coordinates. Indicate placement on the map.	
Front: 40 m _____	Right side property line: 34 m _____
Rear: 46 m _____	Left side property line: 20 m _____
GPS coordinates of single largest vessel: 44°24'05.45"N - 78 59'38.89"W _____	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Ousmane Taranagueda	Official Title Director
Signature 	Telephone No. 416-712-1250
	Date (dd-mmm-yyyy)



Technical Standards and Safety Authority
 345 Carlingview Drive
 Toronto, Ontario M9W 6N9
 Fax: 416.231.4078
 Customer Service: 1.877.682.8772
 www.tssa.org

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
 Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)
 Applicant must include a Facility Site Plan and Map of Surrounding Area


Table 1: Distance Table

Water Capacity (litres)	Nominal Water Capacity (USWG)	Distance to 1 psi overpressure (m)
1,890	500	155
3,780	1,000	195
4,920	1,300	213
6,620	1,750	235
7,130	1,885	241
7,560	2,000	246
18,900	5,000	333

Formula: $D = 16.94 \times (1.524 \times C)^{1/3}$
 D = Distance to overpressure of 1 psi (meters)
 C = Tank Total Capacity in USWG

Parameters: Density of Propane is 0.5033 kg per litre @ 15 C
 Assume all vessels are 80% full
 1 gallon [US, liquid] = 0.003785411784 cubic meter
 1 cubic metre = 264.17 USWG

Hazard Distance Chart (EPA-TNT model)

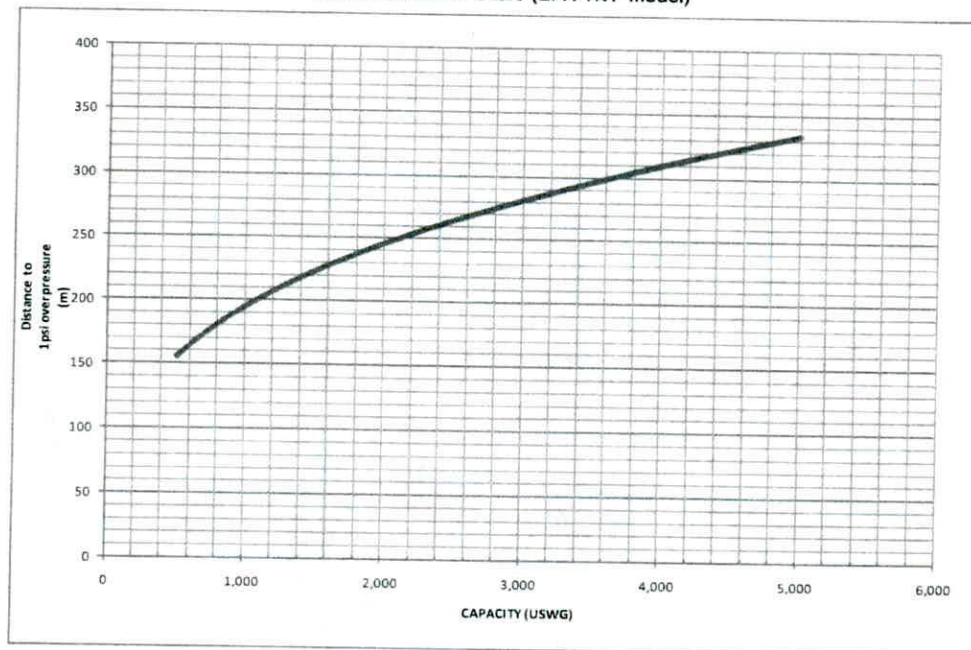



Technical Standards and Safety Authority
 345 Carlingview Drive
 Toronto, Ontario M9W 6N9
 Fax: 416.231.4078
 Customer Service: 1.877.682.8772
 www.tssa.org

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
 Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)
 Applicant must include a Facility Site Plan and Map of Surrounding Area

As an accompaniment to the Map of Surrounding Area, provide the following information about buildings and features present within the circle in Table 2.

Table 2: Buildings and Features

Buildings and Features Present within the Circle on the Map of the Surrounding Area AND Name and Address of Closest Building or Feature	* Number of Buildings and Features (mark with an "X")				Distance from Tank to Closest Building or Feature
	0	1	2-10	11+	
Industrial buildings or parks or golf courses Name: <u>Woodville Medical Centre</u> Address: <u>115 Nappadale St</u> City: <u>Woodville</u> Province <u>Ontario</u> Postal Code <u>K0M 2T0</u>		1			<u>155</u> m
Residential building units specifically permanent single family dwellings [Redacted]			7		<u>20</u> m
Commercial building units specifically retail, restaurants, entertainment, theatres, and sporting complexes. Name: <u>Gas Station Store 127 Nappadale St</u> Address: _____ City: <u>Woodville</u> Province <u>Ontario</u> Postal Code <u>K0M 2T0</u>		1			<u>10</u> m
Commercial building units – continuous occupancy specifically hotels, campgrounds, and resorts. Name: _____ Address: _____ City: <u>Woodville</u> Province <u>Ontario</u> Postal Code _____	0				_____ m
Sensitive institutions specifically hospitals, schools and day cares, nursing and retirement homes, mental health institutions, and prisons. Name: <u>Woodville Elementary School: Technically outside 195m radius but a consideration for 1st responders</u> Address: <u>109 Nappadale St</u> Tel: <u>705-439-2427</u> Principal <u>Dawn Sudsbury</u> City: <u>Woodville</u> Province <u>Ontario</u> Postal Code <u>K0M 2T0</u>		1			<u>230</u> m
Emergency responders specifically fire stations, ambulance stations, and police stations Name: _____ Address: _____ City: <u>Woodville</u> Province <u>Ontario</u> Postal Code _____	0				_____ m

* For multi-unit buildings, count each unit as "1".

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Ousmane Taranagueda	Official Title Director
Signature 	Telephone No. 416-712-1250
	Date (dd-mmm-yyyy) <u>Jan 31/17</u>



Technical Standards and Safety Authority
 345 Carlingview Drive
 Toronto, Ontario M9W 6N9
 Fax: 416.231.4078
 Customer Service: 1.877.682.8772
 www.tssa.org

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
 Propane Storage and Handling Regulation

WORKSHEET


Portable Storage Additional Information Worksheet

Cylinder Size	Capacity in USWG	Quantity	Total Volume in USWG
# 420	123.9	1	123.9 (Empty - Display only)
# 100	29.5		
# 40	11.75		
# 33.3	9.62		
# 30	8.8		
# 20	5.8		
# 10	2.9		
# 5	1.5		
Total Cylinder Capacity			123.9

Tanks Stored On-site Not Connected for Use

Tank Size In USWG	Quantity	Total Volume in USWG
1000	1	1000
Total Tank Capacity		1000

Total Cylinder Capacity	123.9
Total Tank Capacity	1000
Total Portable Capacity (Total Cylinder Capacity + Total Tank Capacity)	1123.9

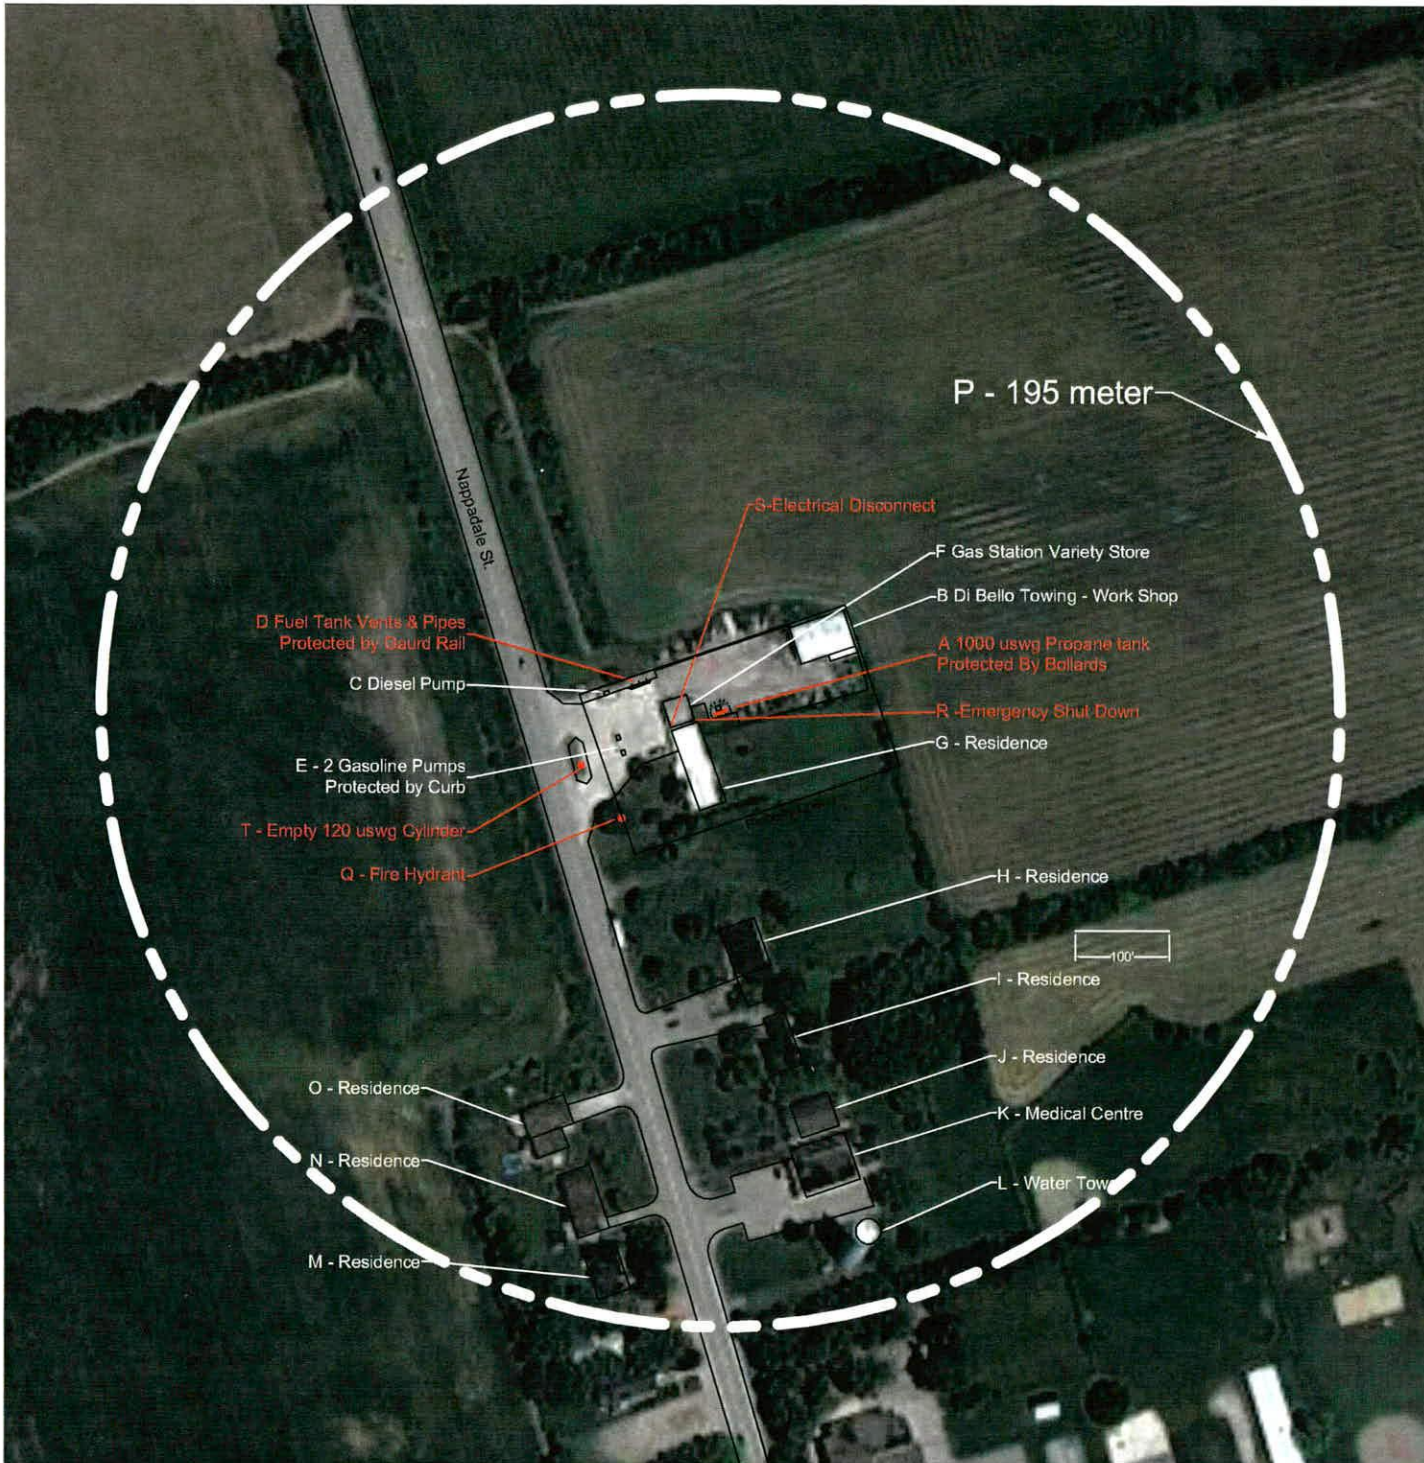

Legend - Features

A	1000 uswg Propane Tank
B	Work Shop 30 m Away
C	Diesel Pump 20 M Away
D	Underground Tank Vents and Pipes
E	2 Gasoline Pumps 20 m Away
F	127 Nappadale St - Gas Station Variety Store
G	127 Nappadale St - Residence at Gas Station
H	121 Nappadale St-.Residence 66 m away
I	119 Nappadale St - Residence 97 m away
J	117 Nappadale - Residence 127 m away
K	115 NappadaleSt-Medical Centre140 m away
L	Water Tower
M	128 Nappadale St - Residence 175 m away
N	130 Nappadale - Residence 155 m away
O	132 Nappadale St - Residence 135 m away
P	195 m -1 psi over pressure radius
Q	Fire Hydrant
R	Emergency Shutoff
S	Electrical Disconnect
T	Empty 120 Gallon Cylinder

Notes:

- D - List of underground fuel tanks and volumes
 - Regular Gasoline - 45,000 L
 - Premium Gasoline 45,000L
 - Diesel - 15,000 L

GPS Coordinates of 1000 uswg Vessel:

44°24'05.45" N
78°59'38.89" W

Tank Setback

From Front: 40 m
From Right: 34 m
From Back: 46 m
From Left: 20 m

2523298 ONTARIO CORP

127 Nappadale St, Woodville, Ont.

Kawartha Lakes Municipality

Capacity of Largest Vessel: 1000 uswg

RSMP LEVEL 1 - 1 PSI Over Pressure Radius

REV: 001

DATE: DEC 29 2016

DRAFTED BY: J.BOS



2523298 ONTARIO CORP

127 Nappadale St, Woodville, Ont.

RSMP LEVEL 1 SITE DRAWING

REV: 001

DATE: DEC 29 2016

DRAFTED BY: J.BOS

Vessel GPS Coordinates 44°24'05.45" N 78°59'38.89" W

Tank Setback: From Front: 40 m
From Back: 46 m

From Right: 34 m
From Left: 20 m

Legend - Features - Notes

A	1000 uswg Propane Tank	N	Residence 155 m away
B	Di Bello Towing 30 m Away	O	Residence 135 m away
C	Diesel Pump 20 M Away	P	195 m -1 psi over pressure radius
D	Underground Tank, Vents and Pipes	Q	Fire Hydrant
E	2 Gasoline Pumps 20 m Away	R	Emergency Shutoff
F	Gas Station Variety Store	S	Electrical Disconnect
G	Residence at Gas Station	T	Empty 120 Gallon Cylinder
H	Residence 66 m away	U	Fire Extinguishers @ Tank & Inside Store
I	Residence 97 m away	D	List of underground fuel tanks and volumes
J	Residence 127 m away		Regular Gasoline - 45,000 L
K	Medical Centre 140 m away		Premium Gasoline 45,000L
L	Water Tower		Diesel - 15,000 L
M	Residence 175 m away		