



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

This Level 1 RSMP applies to: . a facility with a total propane storage capacity of 5,000 USWG or less; or
a facility with a fixed propane storage capacity of 5,000 USWG or less; or
USWG of portable propane storage capacity of 5,000 USWG or less.

Failure to fully complete this form may result in rejection.
Making a false statement may result in a fine or prosecution
under the *Technical Standards and Safety Act*

Licence Number 000260916

Check applicable type of propane operations.

Cylinder Motor Fill Filling Plant Card Keylock

Submit along with this completed application a Facility Site Plan and a Map of the Surrounding Area.

SECTION A: GENERAL INFORMATION

The Undersigned applies to TSSA for a review for an RSMP under Ontario's *Technical Standards and Safety Act*, Propane Storage and Handling Regulation.

A Company Name Kevin Shay Sales Limited Corporation No. 817658

Operator Name (if different from above) _____

Telephone No. 905-884-1196 Fax No. 905-731-3102 E-mail kevinshay@ctretail.net

B Street No. 250 Street Name / 911 Number / Address, if applicable Silver Linden Dr

Town / City or Township / County Richmond Hill Province ON Postal Code L4B 4W7

C Mailing address if different from above.

Street No. _____ Street Name / 911 Number / Address, if applicable _____

Town / City or Township / County _____ Province _____ Postal Code _____

Information on Container Refill Centre or Filling Plant

D Location of facility.

Street No. 250 Street Name / 911 Number / Address, if applicable Silver Linden Drive Nearest Major Intersection Highway 7 and Bayview

Town / City or Township / County Richmond Hill Province ON Postal Code L4B 4W7

Name of Licence Holder Kevin Shay

Name of a Senior Management person as defined in the regulation holding the Record of Training (ROT). Kevin Shay ROT type PPO-3-C

Municipality (or municipalities if the facility or its hazard distance touches multiple borders) Richmond Hill

Hours of operation. _____

This document is valid until the next licence renewal date. You are required by law to notify TSSA of any change of information.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Print name Name of Licence Holder <u>Kevin Shay</u>	Signature 	Date (dd-mm-yyyy) <u>08-Aug-2016</u>
Name of Senior Management person as defined in the Regulation holding the Record of Training <u>Kevin Shay</u>		



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION A: GENERAL INFORMATION (cont'd)


Indicate the year the facility was established. 2010 Indicate the year of any significant modifications, as defined in s.1, O.Reg 211/01, since establishment.

Identify the psig rating and serial number for each fixed propane storage tank on site.

	PSIG	Serial Number
Tank 1:	<u>250</u>	<u>217908</u>
Tank 2:	_____	_____
Tank 3:	_____	_____

Enter capacity of propane in USWG, fixed, portable, and mobile, and provide detailed inventory that includes the number of tank/vessel for each type (fixed, portable, and mobile) and the capacity of each tank/vessel, on a separate document.

Fixed: 2000 Portable: 766 Mobile: 0



Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Brandon Lamoureux	Official Title General Manager	
Signature 	Telephone No. 905-884-1196	Date (dd-mmm-yyyy) 14-Jun-2016



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario MBX 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION A: GENERAL INFORMATION (cont'd)
Activity Information

Name of Propane Supplier(s) Superior Propane		For Office Use - Party No.	
Street No. 6750	Street Name / 911 Number / Address, if applicable Century Ave #400		
Town / City or Township / Country Mississauga		Province ON	Postal Code L5N 2V8
Telephone No. 613-391-9604	Fax No.	Contact Name Ken Gills, Safety and Technical Specialist, Ontario	
E-mail GillisK@SuperiorPropane.com			

Name of Propane Transporter. If same as above, please check box. <input checked="" type="checkbox"/>		For Office Use - Party No.	
Superior Propane			
Street No. 7022	Street Name / 911 Number / Address, if applicable Wellington Road 124S		
Town / City or Township / Country Guelph		Province Ontario	Postal Code N1H 6L3
Telephone No. 519-831-6564	Fax No.	Contact Name Chris Van Herksen	
E-mail vanherkc@superiorpropane.com			

Off-site Cylinder and/or Mobile Storage	Capacity stored off-site, in USWG	For Office Use - Party No.
Street No.	Street Name / 911 Number / Address, if applicable	
Town / City or Township / Country		Province
		Postal Code
Telephone No.	Fax No.	Contact Name

Note: Customer storage is not considered off-site storage.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Brandon Lamoureux	Official Title General Manager
Signature	Telephone No. 905-884-1196
	Date (dd-mmm-yyyy) 14-Jun-2016



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN

The licence holder will complete Section B in consultation with the local Fire Services.

Description of the maximum volume, types and storage location of other hazardous materials on site, if any.

4 x 1100 Litre oil tanks for service centre located at northwest corner of the service centre

oxygen and acetylene canisters for welding equipment in service centre

Oxygen canisters x 4 - Size - 125 CF (volume)

Acetylene canisters x 4 - Size - 200 CF (volume)

Description of fire and emergency equipment indicated on facility site map.

Fire hydrant on median west of filling station

Fire extinguisher inside propane filling station, service centre located 5' once you walk in man door on left wall, near main entrance vestibule

List of fire protection controls (e.g., fire detection systems, fire notification systems, alarm systems, automatic shut off devices, fusible links, etc.) and describe their function, use and operation.

Emergency stop button - this shuts down the pump and closes a solenoid valve upstream of hoses - Mounted on outer left side of weight station console

Fusible link on ISC valve - isolation valve between the tank and the downstream propane dispensing equipment - located in console to right of scale console

ISC valve interlock bar (interlocked with cabinet door) - ISC valve closes when door is closed - console to the right of weigh scale console

Auto Shut-off located in service department. Walk in man door to shop and located approx 5' from door on left side wall.

Maintenance and testing schedule for fire protection controls and devices.

Pumps, pump motor, ISC valves inspected and tested yearly

Storage tank relief valves - inspected to meet provincial regulations

fire extinguishers maintained by owner in accordance with Ontario fire regulations.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Brandon Lamoureux	Official Title General Manager
Signature 	Telephone No. 905-884-1196
	Date (dd-mmm-yyyy) 02-Aug-2016



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

1. Contacts for Emergency Response

1. Facility Contact Personnel - Key Contact		5. Facility 24-Hour Contact Person	
Name Armin Mosaffa	For Office Use - Party No.	Name Armin Mosaffa	For Office Use - Party No.
Official Title Service Manager		Official Title Service Manager	
Telephone No. 905-884-1196	Fax No. 905-731-3102	Cell No. 641-244-9390	Fax No. 905-731-3102
E-mail armin.mosaffa@yahoo.ca		E-mail armin.mosaffa@yahoo.ca	
Role and responsibilities in emergency Coordinate RSMP and ensure safety of all personnel. Coordinate site response		Role and responsibilities in emergency Coordinate RSMP and ensure safety of all personnel. Coordinate site response.	
2. Facility Contact Personnel - Alternate Contact		6. Name of Facility Manager	
Name Jason Donovan	For Office Use - Party No.	Name Kevin Shay	For Office Use - Party No.
Official Title General Manager		Official Title Dealer	
Telephone No. 416-722-4493	Fax No. 905-731-3202	Telephone No. 289-221-3433	Fax No. 905-731-3102
E-mail mohamednasr@ctretail.net		E-mail kevins Shay@ctretail.net	
Role and responsibilities in emergency Coordinate RSMP and site response if main contact is not available.		Role and responsibilities in emergency Owner of the store and third contact if first two are not available to coordinate site response and RSMP	
3. Local Fire Services - Key Contact		7. Propane Supplier Key Contact Person	
Name Randy Pyle	For Office Use - Party No.	Name Superior Propane Hotline	For Office Use - Party No.
Official Title Chief Fire Prevention Officer	E-mail randy.pyle@richmondhill.ca	Official Title	E-mail N/A
Telephone No. 905-780-2895	Fax No. 905-780-2939	Telephone No. 1-877-873-7467	Fax No. N/A
Role and responsibilities in emergency Fire Prevention		Role and responsibilities in emergency Identify and dispatch Superior Propane and or ERAP emergency response personnel as required	
Fire Services Address 1200 Elgin Mills Road East, Richmond Hill ON L4S 1M4		Propane Supplier Address 7022 Wellington Road 124S, Guelph ON N1H 6L3	
4. Local Fire Services - Alternate Contact		8. Municipal Contact	
Name Bryan Burbidge	For Office Use - Party No.	Name Karen Rae	For Office Use - Party No.
Official Title Deputy Chief	E-mail bryan.burbidge@richmondhill.ca	Official Title Zoning Examiner	
Telephone No. 905-780-2897	Fax No. 905-780-2895	Telephone No. 905-771-2436	Fax No. N/A
Role and responsibilities in emergency Fire prevention		E-mail N/A	
Fire Services Address 1200 Elgin Mills Road East, Richmond Hill, ON L4S 1M4		Municipality Name and Address Richmond Hill 225 East Beaver Creek Road L4B 3P4	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Brandon Lamoureux	Official Title General Manager
Signature 	Telephone No. 905-884-1196
	Date (dd-mmm-yyyy) 14-Jun-2016



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

2. Additional Safety Measures

Describe any other measures in place at the facility that exceed the minimum Code and Standards requirements.

Fire Hydrant located 24' west of filling station on the median near parking laneway

All managers on duty will be trained to execute the RSMP during all operating hours.

Emergency site shut off location is on the service centre located on left wall about 5' from man door entrance.

No mechanical repairs to any equipment or cars (including battery charging) shall take place within 20 ft of propane filling station

No Smoking signs have been posted around propane filling facility

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Brandon Lamoureux		Official Title General Manager
Signature 		Telephone No. 905-884-1196
		Date (dd-mmm-yyyy) 08-Aug-2016



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

3. Record of Emergency Training Provided - For most recent 12-month period.

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Training Date (dd-mmm-yyyy) 05-Aug-2016	Print Name of Training Provider: FSN provided material
	Print Name of Instructor: Brandon Lamoureux
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Training on the facility's Emergency Management Procedures provided to staff.

Training Date (dd-mmm-yyyy) 05-Aug-2016	Print Name of Training Provider: FSN provided material
	Print Name of Instructor: Brandon Lamoureux
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

On-site specific training provided to certificate holders / persons with Records of Training.

Training Date (dd-mmm-yyyy) 05-Aug-2016	Print Name of Training Provider: FSN provided material
	Print Name of Instructor: Brandon Lamoureux
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Brandon Lamoureux	Official Title General Manager
Signature 	Telephone No. 905-884-1196
	Date (dd-mmm-yyyy) 08 Aug 2016



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

4. Emergency Training Plan for Coming Year

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Target Date (dd-mmm-yyyy) 01-Jul-2017	Print Name of Training Provider: FSN to provide materials
	Print Name of Instructor: Jason Donovan
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Training on the facility's Emergency Management Procedures provided to staff.

Target Date (dd-mmm-yyyy) 01-Jul-2017	Print Name of Training Provider: FSN to provide materials
	Print Name of Instructor: Jason Donovan
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

On-site specific training provided to certificate holders / persons with Records of Training.

Target Date (dd-mmm-yyyy) 01-Jul-2017	Print Name of Training Provider: FSN to provide materials
	Print Name of Instructor: Jason Donovan
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Brandon Lamoureux	Official Title General Manager
Signature 	Telephone No. 905-884-1196
	Date (dd-mmm-yyyy) 08-Aug-2016



Technical
Standards and
Safety Authority
www.issa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

5. Emergency Response Communications Plan

Warnings and Actions

Describe who gives warnings to whom, and how and when the warning will be given (including public notification as appropriate).
The Manager on duty during operating hours will be the individual to communicate any emergency events to all personnel on the premises. The duty manager will use the PA system, 2-way radios and phone to communicate and direct warnings as well as notify all required emergency contacts. The manager on duty will call 911 or designate someone to call 911 immediately once an emergency event is determined.

Describe what action is to be taken and by whom when a warning is issued (including details of a meeting place in a safe identified area and activating the evacuation plan, if necessary).
The duty manager will be responsible for activating the evacuation plan and communicating where the meeting place will be (southwest of parking lot, along Silver Linden Dr). The duty manager will coordinate responsibilities to all store staff to ensure specific roles are given for a quick and timely evacuation.

Communication with Emergency Response Authorities

Describe when and how the licence holder will give early warning to emergency response authorities (including a process to ensure that a call is placed to 911).
The duty manager will be required to inform the license holder as well as all authorities or if unable to do so they will assign a store staff member to make all necessary phone calls. If the license holder is on site they will contact all required authorities immediately. Emergency contacts are posted in safety wall in lunch room as well as on propane fill station and in the Emergency Response Preparedness Plan. Daily checks will be done each morning and logs taken for any deficiencies found.

Describe provisions for fire department entry when there are no operations or staffing at the propane site.
The propane console has an emergency stop switch on outer left side of the console scale unit. The other safety valves are located in the console to the right of the scale console. There is a padlock on there that can be cut with bolt cutters. There is a fire hydrant roughly 9M to the west of the propane fill station that is accessible during non-operating hours. There is access to water from perimeter of the building on the right side (facing building) of the main EXIT doors. Key holders can be contacted in the key contact section of the RSMP. In open parking lot with 4 access points.

Describe how the licence holder will ensure continual flow of updated information to authorities.
They will be in constant contact with the duty manager executing the evacuation plan and if not on site they will keep contact and relay important information to the proper authorities as needed

How long will it take the facility liaison person to respond to the site.
The key 254 hour contact lives approximately 10 minutes away. Alternate contact and license holder contact live approx 25 minutes away to respond if these individuals are not on site

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Brandon Lamoureux	Official Title General Manager
Signature 	Telephone No. 905-884-1196
	Date (dd-mmm-yyyy) 08-Aug-2016



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

6. Building and Site Security and Procedures

	Yes	No
1. Does the propane location have controlled access to limit unnecessary risk and entry (lock out procedures)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
2. Is there adequate night lighting at the site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
3. Are procedures in place that ensure access routes, aisles, storage area, filling areas and the grounds are kept clear from unwanted materials?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
4. Are there procedures that capture and record the daily inspection of hoses and inspection requirements for filling systems and mechanical devices used in the transfer of propane?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
5. Does the facility have procedures that include a process to isolate and purge any overfilled propane cylinders?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
6. Are weighing systems validated for accuracy?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
7. Are storage areas clearly marked with the vessels' capacity status (i.e., filled, empty, purged and other hazardous materials)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
8. Are quality assurance procedures in place to ensure that all valves are closed after the propane cylinders are filled?(e.g., QCC valves)	<input checked="" type="checkbox"/>	<input type="checkbox"/>
9. Is the schedule of maintenance and testing activities retained on site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>

7. Water Supply

The propane licence holder should work with the local fire department to determine water supply capabilities that are available based on the propane facility's location.

	Yes	No
1. Is a pressurized water system available at the propane facility site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
2. Can the municipal fire department pump 375 GPM (1420 LPM) of water at this location?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
3. What is the unobstructed distance to the closest water supply that could be used for firefighting activities? (distance in metres only)		<u>Approx 9m</u>
4. What is the unobstructed distance to the closest approved water supply with year round access if there are no hydrants? (distance in metres only)		<u>Approx 11m</u>

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Brandon Lamoureux	Official Title General Manager
Signature 	Telephone No. 905-884-1196
	Date (dd-mmm-yyyy) 02-Aug-2016



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

8. Licence holder and local Fire Services Review

To be completed by the Local Fire Services

Has the local fire service had an opportunity to review the Emergency Response and Preparedness Plan?

Yes

No



If not, please explain (e.g., no fire services).

Fire services comments, if any:

All persons operating filling station shall have received training on use and emergency procedures in accordance with established industry requirements, this plan and fire safety plan.

To be completed by the Licence Holder

In response to the above comments, the following action(s) is required:

All staff operating fill station have been given training documentation.

The licence holder will respond to the Local Fire Services comments by:

12-Aug-2016
(dd-mmm-yyyy)

LOCAL FIRE SERVICES

The undersigned has reviewed Section B of the Risk and Safety Management Plan Fire Services.

Local Fire Services Name: **Tollio Tarquini**

Print name

Signature

Date (dd-mmm-yyyy)

Aug 8/16

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print)

Brandon Lamoureux

Official Title
General Manager

Signature

Telephone No.
905-884-1196

Date (dd-mmm-yyyy)
02-Aug-2016



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS

Applicant must include a Facility Site Plan and Map of Surrounding Area

Facility Site Plan.

The licence holder will submit a copy of the original facility site plan updated with the following information:

1. The storage location of fixed, portable, and mobile vessels.
2. The maximum volume, types and storage location of hazardous materials.
3. Location of permanent structures on site.
4. Access and egress points and location of barriers.
5. Location of fire and emergency equipment (e.g., sprinkler systems, extinguishers, suppression systems) on site and location of fire hydrant or water supply where available.
6. Location of emergency shut off/shut down switches/valves.

Map of Surrounding Area.

The licence holder will submit a scaled aerial map of the surrounding area showing the following information:

7. The capacity and placement of the single largest propane storage vessel, including its setback from the front, rear and side property lines.
8. GPS co-ordinates of the single largest vessel.
9. Visual indication of the single largest fixed vessel and a circle made using the distance in Table 1 as the radius from the single largest fixed vessel.
10. Clear indication of the municipality or municipalities present within the circle.
11. Visual indication of property line information.
12. The location and name of roads within or abutting the site.
13. Key note to the drawing indicating the facility's municipal address, municipal lot number(s) and concession lines as applicable, and the date the map was prepared.
14. Address and contact information for each municipality (municipal clerk or secretary-treasurers of planning board). (Refer to page 5.)
15. Complete "Required Mapping Information from Updated Site Plan" in table below .

Required Mapping Information from Updated Site Plan

Date map prepared (dd-mmm-yyyy) 02-Aug-2016	Capacity of single largest propane storage vessel (USWG) 2000
Tank setback coordinates. Indicate placement on the map.	
Front: 81 Metres	Right side property line: 132 Metres
Rear: 102 Metres	Left side property line: 33 Metres
GPS coordinates of single largest vessel: Long:-79.413407 Lat:43.842394	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Brandon Lamoureux	Official Title General Manager	
Signature 	Telephone No. 905-884-1196	Date (dd-mmm-yyyy) 02-Aug-2016



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)

Applicant must include a Facility Site Plan and Map of Surrounding Area


Table 1: Distance Table

Water Capacity (litres)	Nominal Water Capacity (USWG)	Distance to 1 psi overpressure (m)
1,890	500	155
3,780	1,000	195
4,920	1,300	213
6,620	1,750	235
7,130	1,885	241
7,560	2,000	246
18,900	5,000	333

Formula: $D = 16.94 \times (1.524 \times C)^{1/3}$
 D = Distance to overpressure of 1 psi (meters)
 C = Tank Total Capacity in USWG

Parameters: Density of Propane is 0.5033 kg per litre @ 15 C
 Assume all vessels are 80% full
 1 gallon [US, liquid] = 0.003785411784 cubic meter
 1 cubic metre = 264.17 USWG

Hazard Distance Chart (EPA-TNT model)

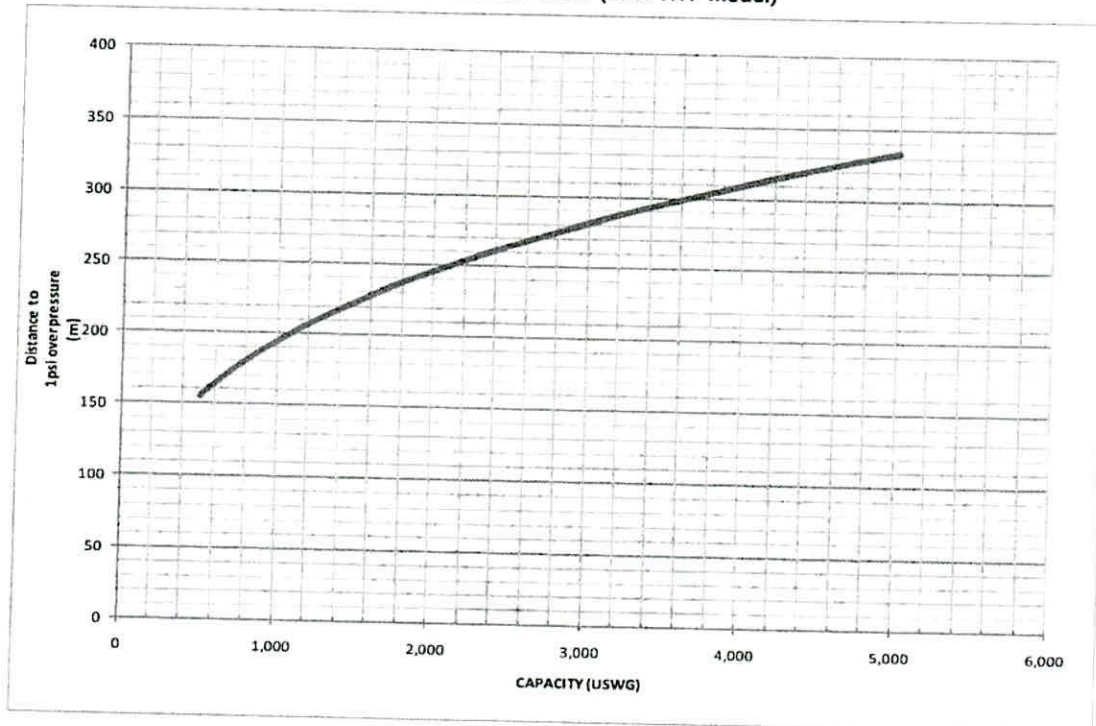



Technical Standards and Safety Authority
www.tssa.org


14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)
Applicant must include a Facility Site Plan and Map of Surrounding Area


As an accompaniment to the Map of Surrounding Area, provide the following information about buildings and features present within the circle in Table 2.

Table 2: Buildings and Features

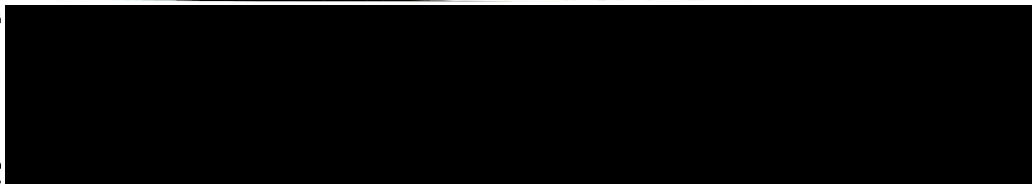Buildings and Features Present within the Circle on the Map of the Surrounding Area AND Name and Address of Closest Building or Feature	* Number of Buildings and Features (mark with an "X")				Distance from Tank to Closest Building or Feature
	0	1	2-10	11+	
Industrial buildings or parks or golf courses Name: N/A Address: _____ City: _____ Province _____ Postal Code _____					_____ m
			X		_____ m
Commercial building units specifically retail, restaurants, entertainment, theatres, and sporting complexes. Name: Toys R Us, Storage Solutions, Bombay, Loblaws, Walmart Address: 295 High Tech Road City: Richmond Hill Province ON Postal Code L4B 4R2			x		61-187 m
Commercial building units – continuous occupancy specifically hotels, campgrounds, and resorts. Name: N/A Address: _____ City: _____ Province _____ Postal Code _____					_____ m
Sensitive institutions specifically hospitals, schools and day cares, nursing and retirement homes, mental health institutions, and prisons. Name: N/A Address: _____ City: _____ Province _____ Postal Code _____					_____ m
Emergency responders specifically fire stations, ambulance stations, and police stations. Name: N/A Address: _____ City: _____ Province _____ Postal Code _____					_____ m

* For multi-unit buildings, count each unit as "1".

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Brandon Lamoureux	Official Title General Manager
Signature 	Telephone No. 905-884-1196
	Date (dd-mmm-yyyy) 02-Aug-2016



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

WORKSHEET

Portable Storage Additional Information Worksheet

Cylinder Size	Capacity in USWG	Quantity	Total Volume in USWG
# 420	123.9		
# 100	29.5		
# 40	11.75		
# 33.3	9.62		
# 30	8.8		
# 20	5.8		
# 10	2.9		
# 5	1.5		
Total Cylinder Capacity N/A			

Tanks Stored On-site Not Connected for Use

Tank Size In USWG	Quantity	Total Volume in USWG
Total Tank Capacity N/A		

Total Cylinder Capacity	
Total Tank Capacity	
Total Portable Capacity (Total Cylinder Capacity + Total Tank Capacity)	N/A

Canadian Tire - Floor Plan
Richmond Hill, Ont.




Emergency Exit

Fire Extinguishers

Pull Stations

Propane Emergency Shut off

4 x 1100 Litre O₂ tanks
↳ Oxygen canisters x4 125CF
↳ Acetylene x4 - 200CF

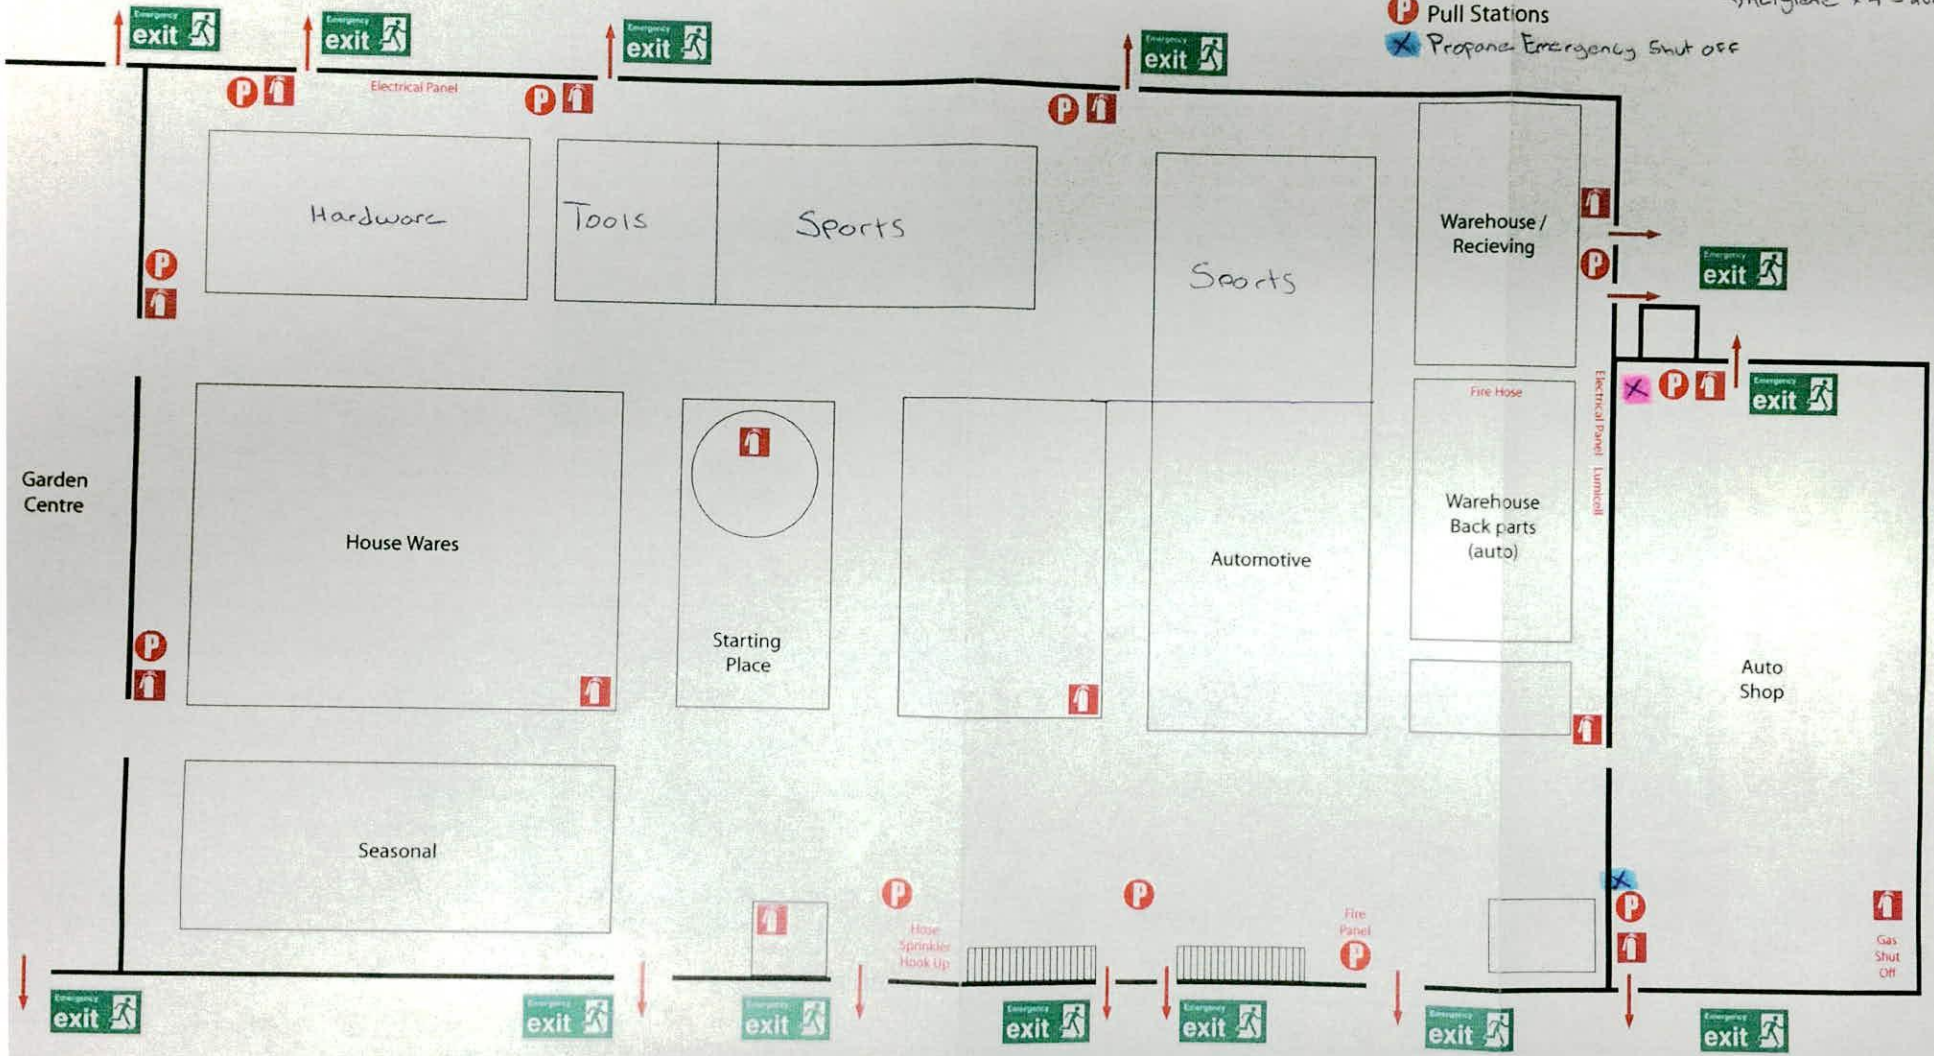

MAIN FLOOR PLAN

bing Maps

250 Silver Linden Dr, Richmond Hill, ON,
L4B

Municipality Contact:

Karen Rae - Zoning Examiner

905-771-2436


225 East Beaver Creek Rd.

Richmond Hill ON

L4B 3P4

Longitude: -79.413407

Latitude: 43.842394

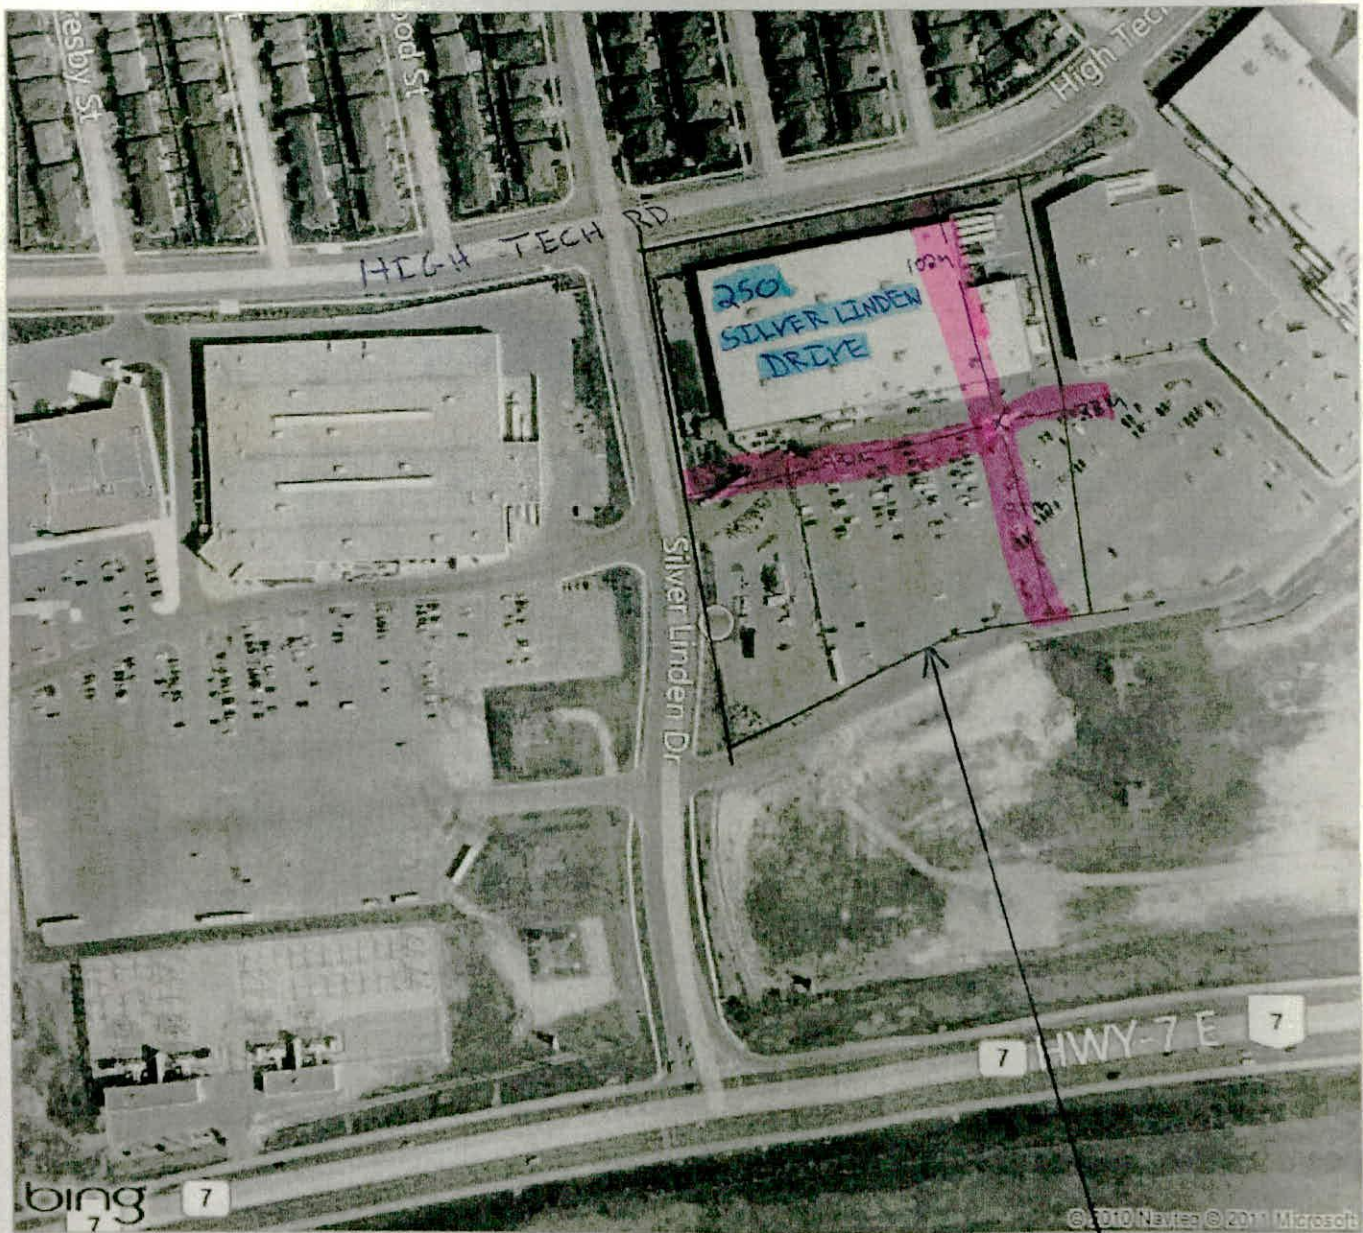

X = Propane Facility Distance From property line
North - 102M East - 33M
South - 81M West - 132M

Capacity of storage vessel - 2000 USWB