

Intake Group

OCT 09 2013

RECEIVED



Technical Standards and Safety Authority
www.tssa.org

14th Floor, Centre Tower
3300 Bloor Street West
Toronto, Ontario M6W 2M1
Fax: 416-231-4903
Customer Service: 1-877-682-0772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

This Level 1 RSMP applies to: - a facility with a total propane storage capacity of 5,000 USWG or more
- a facility with a fixed propane storage capacity of 1,000 USWG or more
- a facility with a fixed propane storage capacity of 1,000 USWG or more and a portable propane storage capacity of 5,000 USWG or more

Failure to fully complete this form may result in rejection.
Making a false statement may result in a fine or prosecution under the Technical Standards and Safety Act

License Number: 0076316772 000076649180

Check applicable type of propane operations:

Cylinder Motor Fill Filling Plant Card/Keylock

Submit along with this completed application a Facility Site Plan and a Map of the Surrounding Area.

SECTION A: GENERAL INFORMATION

The undersigned applies to TSSA for a review for an RSMP under Ontario's Technical Standards and Safety Act, Propane Storage and Handling Regulation.

A Company Name: TSC STORES LP Ontario Corporation No., if applicable

Operator Name (if different from above)

Telephone No.: 519-453-5270 Fax No.: 519-453-8068 E-mail: millon@tscstores.com (Ms. Heather Brooks, Store Manager)

B Street No.: 1250 Street Name/911 Number/Address, if applicable: OXFORD STREET EAST
Town/City or Township/County: LONDON Province: ONTARIO Postal Code: N5V 2Z8

Mailing address if different from above.

C Street No.: Street Name/911 Number/Address, if applicable:
Town/City or Township/County: Province: Postal Code:

Information on Container Refill Centre or Filling Plant.

D Location of facility:
Street No.: 28 Street Name/911 Number/Address, if applicable: BRONTE STREET NORTH Nearest Major Interchange: SW corner of Bronte St, N and Main St, W
Town/City or Township/County: MILTON Province: ONTARIO Postal Code: L9T 2N5

Name of License Holder

TSC STORES LP

Name of a Senior Management person as defined in the regulation holding the Record of Training (ROT):

MR. STACY MILLER, VP STORE OPERATIONS AND REAL ESTATE

ROT type

PPC-3

Municipality (or municipalities if the facility or its hazard distance touches multiple borders)

Town of Milton

Hours of operation:

This document is valid until the next license renewal date. You are required by law to notify TSSA of any change of information.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of License Holder: TSC STORES LP	Print Name	Signature	Date (dd-mm-yyyy): Oct. 01/2013
Name of Senior Management person as defined in the Regulation holding the Record of Training: STACY MILLER			



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION A: GENERAL INFORMATION (cont'd)

Indicate the year the facility was established.
N/A


Indicate the year of any significant modifications, as defined in s.1, O.Reg 211/01, since establishment.
N/A

Identify the psig rating and serial number for each fixed propane storage tank on site.

	PSIG	Serial Number
Tank1:	250	5557776
Tank2:		
Tank3:		

Enter capacity of propane in USWG, fixed, portable, and mobile, and provide detailed inventory that includes the number of tank/vessel for each type (fixed, portable, and mobile) and the capacity of each tank/vessel, on a separate document.

Fixed: 1,000 USWG Portable: 794 USWG Mobile: 0 USWG



Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print)	Official Title	
Signature <i>JUDY HE</i> <i>[Signature]</i>	Telephone No. 416-298-9563	Date (dd-mm-yyyy) 25-09-2013



Technical Standards and Safety Authority
www.issa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION A: GENERAL INFORMATION (cont'd)

Activity Information

Name of Propane Supplier(s) UPI Energy LP			
Street No. 105	Street Name / 911 Number / Address, if applicable Silvercreek Parkway North, Suite 200		
Town / City or Township / Country GUELPH		Province ONTARIO	Postal Code N1H 8M1
Telephone No. 519-821-2667	Fax No. 519-821-4919	Contact Name Dana Wells	
E-mail dwells@upi.on.ca			

Name of Propane Transporter. If same as above, please check box. <input type="checkbox"/>			
Primemax Energy Inc.			
Street No. 2558	Street Name / 911 Number / Address, if applicable Cedar Creek Road		
Town / City or Township / Country AYR		Province ONTARIO	Postal Code N0B 1E0
Telephone No. 519-740-8209	Fax No. 519-740-1015	Contact Name Anthony Hiebert	
E-mail ahiebert@primemaxenergy.com			

Off-site Cylinder and/or Mobile Storage N/A	Capacity stored off-site, in USWG	For Office Use - Party No.
Street No.	Street Name / 911 Number / Address, if applicable	
Town / City or Township / Country		Province
Telephone No.		Postal Code
Fax No.	Contact Name	

Note: Customer storage is not considered off-site storage.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) JUDY UE	Official Title	
Signature <i>Judy UE</i>	Telephone No. 416-298-9563	Date (dd-mm-yyyy) 25-09-2013



Technical Standards and Safety Authority
 www.tssa.org
 14th Floor - Centre Tower
 3300 Bloor Street West
 Toronto Ontario M8X2X4
 Fax: 416.231.4903
 Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
 Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN

The licence holder will complete Section B in consultation with the local Fire Services.

Description of the maximum volume, types and storage location of other hazardous materials on site, if any.

Kerosene packages - uncontrolled quantities, inside store - garden centre

Fertilizer packages - uncontrolled quantities, in storage barn

Description of fire and emergency equipment indicated on facility site map.

Fire extinguishers located on bollard and inside store.

Two (2) Emergency Stop buttons located at bollard around propane tank (1) and at store barn wall (1).

List of fire protection controls (e.g., fire detection systems, fire notification systems, alarm systems, automatic shut off devices, fusible links, etc.) and describe their function, use and operation.

A cabinet houses the cylinder fill equipment. The tank ISC valve is connected via a fusible link to a lever located next to the cabinet door. The lever must be in the vertical position, which closes the ISC valve, before the cabinet door fully closes. Thus, the ISC valve is always closed when the facility is closed and the cabinet closed and locked. The ISC valve will spring shut when the temperature-sensitive fusible link breaks.

The propane fill pump can be shut off by the 2 emergency stop buttons, as well as the local (at tank) & main power switch (in store).

Maintenance and testing schedule for fire protection controls and devices.

Annual checks are done by qualified technicians (third party) for the following: fire extinguishers, ISC valve, fusible link, emergency shut down switches.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print)	Official Title	
Signature	Telephone No.	Date (dd-mm-yyyy)
INDY LIE	416-298-9563	25-09-2013



Technical Standards and Safety Authority
www.tssa.org
14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

1. Contacts for Emergency Response

1. Facility Contact Personnel - Key Contact		5. Facility 24-Hour Contact Person	
Name Heather Brooks	For Office Use - Party No.	Name Dana Wells (UPI Energy LP)	For Office Use - Party No.
Official Title Manager		Official Title Manager, ERT, Compliance & Fleet Services	
Telephone No. (O) 905-878-2391	Fax No. 905-878-9784	Cell No. 519-240-8591	Fax No. 519-821-4919
E-mail milton@tscstores.com		E-mail dwells@upi.on.ca	
Role and responsibilities in emergency Emergency Response Team (ERT) member - Stop filler plant operations, notify others nearby & coordinate evacuation of facility. Call 911 and UPI.		Role and responsibilities in emergency ERT (Emergency Response Team) Coordinator	
2. Facility Contact Personnel - Alternate Contact		6. Name of Facility Manager	
Name Wayne Riebot	For Office Use - Party No.	Name Heather Brooks	For Office Use - Party No.
Official Title Clerk		Official Title Manager	
Telephone No. 905-878-2391	Fax No. 905-878-9784	Telephone No. 905-878-2391	Fax No. 905-878-9784
E-mail milton@tscstores.com		E-mail milton@tscstores.com	
Role and responsibilities in emergency Emergency Response Team (ERT) member - Stop filler plant operations, notify others nearby & coordinate evacuation of facility. Call 911 and UPI.		Role and responsibilities in emergency Emergency Response Team (ERT) member - Stop filler plant operations, notify others nearby & coordinate evacuation of facility. Call 911 and UPI.	
3. Local Fire Services - Key Contact		7. Propane Supplier Key Contact Person	
Name Brian Ellsworth	For Office Use - Party No.	Name Dana Wells (UPI Energy LP)	For Office Use - Party No.
Official Title Fire Chief, CMMIII	E-mail fireservices@milton.ca	Official Title Manager, ERT, Compliance & Fleet S	E-mail dwells@upi.on.ca
Telephone No. 905-878-9251	Fax No. 905-878-5914	Telephone No. 519-240-8591	Fax No. 519-821-4919
Role and responsibilities in emergency Internal and external evacuation, establish safety zones, fire suppression, cool propane tank		Role and responsibilities in emergency ERT (Emergency Response Team) Coordinator	
Fire Services Address 610 Savoline Blvd, Milton ON L9T 0N3		Propane Supplier Address 105 Silvercreek Parkway N, Suite 200, Guelph ON N1H 8M1	
4. Local Fire Services - Alternate Contact		8. Municipal Contact	
Name Doug Shortt	For Office Use - Party No.	Name Marlo Belvedere	For Office Use - Party No.
Official Title Chief Fire Prevention Officer, CMMII	E-mail	Official Title CAO	
Telephone No. 905-878-9251 x2810	Fax No. 905-878-5914	Telephone No. 908-878-7252 x 2102	Fax No. 905-876-5024
Role and responsibilities in emergency Internal and external evacuation, establish safety zones, fire suppression, cool propane tank		E-mail	
Fire Services Address 610 Savoline Blvd, Milton ON L9T 0N3		Municipality Name and Address 150 Mary St, Milton L9T 8Z5	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) JUDY IFE	Official Title	
Signature 	Telephone No. 416-298-9563	Date (dd-mm-yyyy) 25-09-2013



Technical Standards and Safety Authority
 www.tssa.org
 14th Floor - Centre Tower
 3300 Bloor Street West
 Toronto Ontario MBX 2X4
 Fax: 416.231.4903
 Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
 Technical Standards and Safety Act
 Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

2. Additional Safety Measures

Describe any other measures in place at the facility that exceed the minimum Code and Standards requirements.
 All staff members are trained on proper usage of fire extinguishers.
 All staff members are aware of emergency procedures.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) <i>JUDY HE</i>		Official Title	
Signature <i>Judy He</i>	Telephone No. <i>416-298-9563</i>	Date (dd-mm-yyyy) <i>25-09-2013</i>	



Technical Standards and Safety Authority
 www.tssa.org
 14th Floor - Centre Tower
 3300 Bloor Street West
 Toronto Ontario M8X2X4
 Fax: 416.231.4903
 Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
 Technical Standards and Safety Act
 Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

3. Record of Emergency Training Provided - For most recent 12-month period.

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Training Date (dd-mm-yyyy) May 2013	Print Name of Training Provider: TSC Stores LP
	Print Name of Instructor: Robert Axtmann
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Training on the facility's Emergency Management Procedures provided to staff.

Training Date (dd-mm-yyyy) May 2013	Print Name of Training Provider: TSC Stores LP
	Print Name of Instructor: Robert Axtmann
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

On-site specific training provided to certificate holders / persons with Records of Training.

Training Date (dd-mm-yyyy) May 2013	Print Name of Training Provider: TSC Stores LP
	Print Name of Instructor: Robert Axtmann
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) JUDY WE	Official Title	
Signature 	Telephone No. 416-298-9563	Date (dd-mm-yyyy) 25-09-2013



Technical Standards and Safety Authority
www.issa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

4. Emergency Training Plan for Coming Year

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Target Date (dd-mm-yyyy) May 2014	Print Name of Training Provider: TSC Stores LP
	Print Name of Instructor: Heather Brooks
Target Date (dd-mm-yyyy) September 2014	Print Name of Training Provider: TSC Stores LP
	Print Name of Instructor: Heather Brooks
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Training on the facility's Emergency Management Procedures provided to staff.

Target Date (dd-mm-yyyy) May 2014	Print Name of Training Provider: TSC Stores LP
	Print Name of Instructor: Heather Brooks
Target Date (dd-mm-yyyy) September 2014	Print Name of Training Provider: TSC Stores LP
	Print Name of Instructor: Heather Brooks
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

On-site specific training provided to certificate holders / persons with Records of Training.

Target Date (dd-mm-yyyy) May 2014	Print Name of Training Provider: TSC Stores LP
	Print Name of Instructor: Heather Brooks
Target Date (dd-mm-yyyy) September 2014	Print Name of Training Provider: TSC Stores LP
	Print Name of Instructor: Heather Brooks
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) JUDY UE	Official Title	
Signature 	Telephone No. 416-298-9563	Date (dd-mm-yyyy) 25-09-2013



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.662.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

5. Emergency Response Communications Plan

Warnings and Actions

Describe who gives warnings to whom, and how and when the warning will be given (including public notification as appropriate).
The propane facility employee is an Emergency Response Team (ERT) member. Upon detection of ignited or unignited propane leak that is not contained, he/she will verbally notify personnel nearby to evacuate safely to the mustering point and ensure that all directions are followed. From a safe location, he/she will then call 911 and UPI Energy LP emergency response @ 1-800-396-2667.

Describe what action is to be taken and by whom when a warning is issued (including details of a meeting place in a safe identified area and activating the evacuation plan, if necessary).

See above. The mustering point is northeast of the facility, at the parking lot across Bronte street. The internal evacuation script is "We have a propane emergency. Evacuate to mustering area. Take your belongings. Mustering point is at the gas station (Petrol Canada at 5 Main Street East) parking lot, the opposite side of Bronte Street (northeast)!"

Communication with Emergency Response Authorities

Describe when and how the licence holder will give early warning to emergency response authorities (including a process to ensure that a call is placed to 911).
Upon detection of ignited or unignited propane leak that is not contained, the ERT member will call 911, as well as UPI Energy LP @ 1-800-396-2667, from a safe location.

Describe provisions for fire department entry when there are no operations or staffing at the propane site.
The propane facility is accessible at all times. The metal cabinet which houses the propane cylinder fill pump is closed and locked outside of operating hours. This lock can be broken open for fire department access.

Describe how the licence holder will ensure continual flow of updated information to authorities.
UPI Energy LP Emergency Response Team (ERT) Coordinator is available 24 hr/day, 365 days/year @ 1-800-396-2667. When the ERT member places the call to alert the ERT Coordinator, the ERT Coordinator will assign a Qualified Local Person to be the main liaison to the local authorities responsible for the external emergency plan and will provide an estimated time for a the Qualified Local Person to respond to the site.

How long will it take the facility liaison person to respond to the site.
30 min to 60 min.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print)	Official Title	
Signature	Telephone No.	Date (dd-mm-yyyy)
JUDY UE 	416-298-9563	25-09-2013



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services

6 Building and Site Security and Procedures

	Yes	No
1. Does the propane location have controlled access to limit unnecessary risk and entry (lock out procedures)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
2. Is there adequate night lighting at the site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
3. Are procedures in place that ensure access routes, aisles, storage area, filling areas and the grounds are kept clear from unwanted materials?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
4. Are there procedures that capture and record the daily inspection of hoses and inspection requirements for filling systems and mechanical devices used in the transfer of propane?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
5. Does the facility have procedures that include a process to isolate and purge any overfilled propane cylinders?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
6. Are weighing systems validated for accuracy?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
7. Are storage areas clearly marked with the vessels' capacity status (i.e., filled, empty, purged and other hazardous materials)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
8. Are quality assurance procedures in place to ensure that all valves are closed after the propane cylinders are filled?(e.g., QCC valves)	<input checked="" type="checkbox"/>	<input type="checkbox"/>
9. Is the schedule of maintenance and testing activities retained on site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>

7. Water Supply

The propane licence holder should work with the local fire department to determine water supply capabilities that are available based on the propane facility's location.

	Yes	No
1. Is a pressurized water system available at the propane facility site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
2. Can the municipal fire department pump 375 GPM (1420 LPM) of water at this location?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
3. What is the unobstructed distance to the closest water supply that could be used for firefighting activities? (distance in metres only)	20 m	
4. What is the unobstructed distance to the closest approved water supply with year round access if there are no hydrants? (distance in metres only)	N/A	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) JUDY UE	Official Title	
Signature <i>J. UE</i>	Telephone No. 416-298-9563	Date (dd-mm-yyyy) 25-09-2013

From: "Julia Ceccotti" <jceccotti@upi.on.ca>
To: <fireservices@milton.ca>
Cc: <judy.ue@mcl-miley.com>
Sent: Friday, October 04, 2013 1:27 PM
Attach: TSC Stores Milton Level 1 RSMP App - signed.pdf.pdf
Subject: Milton RSMP

Good afternoon Chief Ellsworth,

For Fire Services information, please find the attached "Level 1 Risk and Safety Management Plan (RSMP)" ("Level 1 RSMP") for TSC Stores LP propane facility located at 28 Bronte St N, Milton ON ("Facility"). This Level 1 RSMP is prepared for the Facility 2013 propane licence renewal, and is based on the Level 2 RSMP prepared in previous years.

There have been no changes to the facility since the last licence renewal.

For your records, we will forward the signed application for submission after we have incorporated your review comments.

Should you have any questions, please let me know. Kindly please acknowledge receipt of this RSMP by return email.

Sincerely,

Julia Ceccotti
Administration & Operations

UPI Energy LP | Southwestern Ontario Direct Operations | 7060 Wellington Road 124, Guelph, ON N1H 6J3

P: 519.824.7370 | TF: 1.800.265.7292 | F: 519.824.1780 | www.upienergylp.com



Please consider the environment before printing this email.



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

B. Licence holder and local Fire Services Review

To be completed by the Local Fire Services

Has the local fire service had an opportunity to review the Emergency Response and Preparedness Plan?

Yes

No

If not, please explain (e.g., no fire services).

Fire services comments, if any:

To be completed by the Licence Holder

In response to the above comments, the following action(s) is required:

The licence holder will respond to the Local Fire Services comments by:

(dd-mm-yyyy)

LOCAL FIRE SERVICES

The undersigned has reviewed Section B of the Risk and Safety Management Plan Fire Services.

Print name	Signature	Date (dd-mm-yyyy)
Local Fire Services Name		

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print)	Official Title	
Signature	Telephone No.	Date (dd-mm-yyyy)
JUDY I.E	416-298-9563	25-09-2013



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS

Applicant must include a Facility Site Plan and Map of Surrounding Area.

Facility Site Plan.

The licence holder will submit a copy of the original facility site plan updated with the following information:

1. The storage location of fixed, portable, and mobile vessels.
2. The maximum volume, types and storage location of hazardous materials.
3. Location of permanent structures on site.
4. Access and egress points and location of barriers.
5. Location of fire and emergency equipment (e.g., sprinkler systems, extinguishers, suppression systems) on site and location of fire hydrant or water supply where available.
6. Location of emergency shut off/shut down switches/valves.

Map of Surrounding Area.

The licence holder will submit a scaled aerial map of the surrounding area showing the following information:

7. The capacity and placement of the single largest propane storage vessel, including its setback from the front, rear and side property lines.
8. GPS co-ordinates of the single largest vessel.
9. Visual indication of the single largest fixed vessel and a circle made using the distance in Table 1 as the radius from the single largest fixed vessel.
10. Clear indication of the municipality or municipalities present within the circle.
11. Visual indication of property line information.
12. The location and name of roads within or abutting the site.
13. Key note to the drawing indicating the facility's municipal address, municipal lot number(s) and concession lines as applicable, and the date the map was prepared.
14. Address and contact information for each municipality (municipal clerk or secretary-treasurers of planning board). (Refer to page 5.)
15. Complete "Required Mapping Information from Updated Site Plan" in table below.

Required Mapping Information from Updated Site Plan

Date Map Prepared (dd-mm-yyyy) August 2011	Capacity of single largest propane storage vessel (USWG) 1,000 USWG
Tank setback coordinates. Indicate placement on the map.	
Front: 35'	Right side property line: 340'
Rear: 135'	Left side property line: 70'
GPS coordinates of single largest vessel: 43° 30' 30.96"N 79° 53' 18.82"W	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) <i>AUDY UE</i>	Official Title	
Signature <i>Audy UE</i>	Telephone No. <i>416-298-9563</i>	Date (dd-mm-yyyy) <i>25-09-2013</i>



Technical Standards and Safety Authority
www.issa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)

Applicant must include a Facility Site Plan and Map of Surrounding Area


Table 1: Distance Table

Water Capacity (litres)	Nominal Water Capacity (USWG)	Distance to 1 psi overpressure (m)
1,890	500	155
3,780	1,000	195
4,920	1,300	213
6,620	1,750	235
7,130	1,885	241
7,560	2,000	246
18,900	5,000	333

Formula: $D = 16.94 \times (1.524 \times C)^{1/3}$
 D = Distance to overpressure of 1 psi (meters)
 C = Tank Total Capacity in USWG

Parameters: Density of Propane is 0.5033 kg per litre @ 15 C
 Assume all vessels are 80% full
 1 gallon [US, liquid] = 0.003785411784 cubic meter
 1 cubic metre = 264.17 USWG

Hazard Distance Chart (EPA-TNT model)

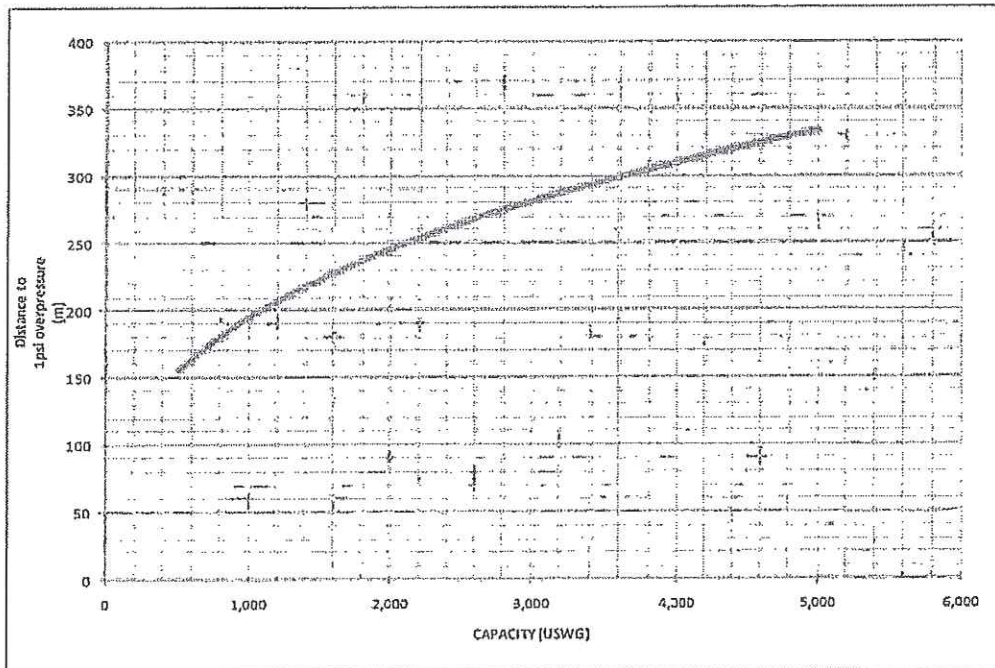



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)
Applicant must include a Facility Site Plan and Map of Surrounding Area

As an accompaniment to the Map of Surrounding Area, provide the following information about buildings and features present within the circle in Table 2.

Table 2: Buildings and Features

Buildings and Features Present within the Circle on the Map of the Surrounding Area AND Name and Address of Closest Building or Feature	* Number of Buildings and Features (mark with an "X")				Distance from Tank to Closest Building or Feature
	0	1	2-10	11+	
Industrial buildings or parks or golf courses Name: N/A Address: City: _____ Province _____ Postal Code _____	X				N/A m
Residential building units specifically permanent single family dwellings, condominiums, and apartments. Name: [REDACTED] Address: [REDACTED] City: [REDACTED]				X	57 m
Commercial building units specifically retail, restaurants, entertainment, theatres, and sporting complexes. Name: Petro Canada Address: 5 Main Street East City: Milton Province ON Postal Code L9T 1N2				X	40 m
Commercial building units – continuous occupancy specifically hotels, campgrounds, and resorts. Name: N/A Address: City: _____ Province _____ Postal Code _____	X				N/A m
Sensitive Institutions specifically hospitals, schools and day cares, nursing and retirement homes, mental health institutions, and prisons. Name: N/A Address: City: _____ Province _____ Postal Code _____	X				N/A m
Emergency responders specifically fire stations, ambulance stations, and police stations. Name: N/A Address: City: _____ Province _____ Postal Code _____	X				N/A m

* For multi-unit buildings, count each unit as "1".

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) JUDY UE	Official Title	
Signature [Signature]	Telephone No. 416-298-9563	Date (dd-mm-yyyy) 25-09-2013



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.582.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

WORKSHEET


Portable Storage Additional Information Worksheet

Cylinder Size	Capacity in USWG	Quantity	Total Volume in USWG
# 420	123.9	0	0
# 100	29.5	8	236
# 40	11.75	0	0
# 33.3	9.62	0	0
# 30	8.8	8	70.4
# 20	5.8	84	487.2
# 10	2.9	0	0
# 5	1.5	0	0
Total Cylinder Capacity			794 USWG

Tanks Stored On-site Not Connected for Use

Tank Size In USWG	Quantity	Total Volume in USWG
N/A	N/A	0
Total Tank Capacity		0

Total Cylinder Capacity	794 USWG
Total Tank Capacity	0 USWG
Total Portable Capacity (Total Cylinder Capacity + Total Tank Capacity)	794 USWG

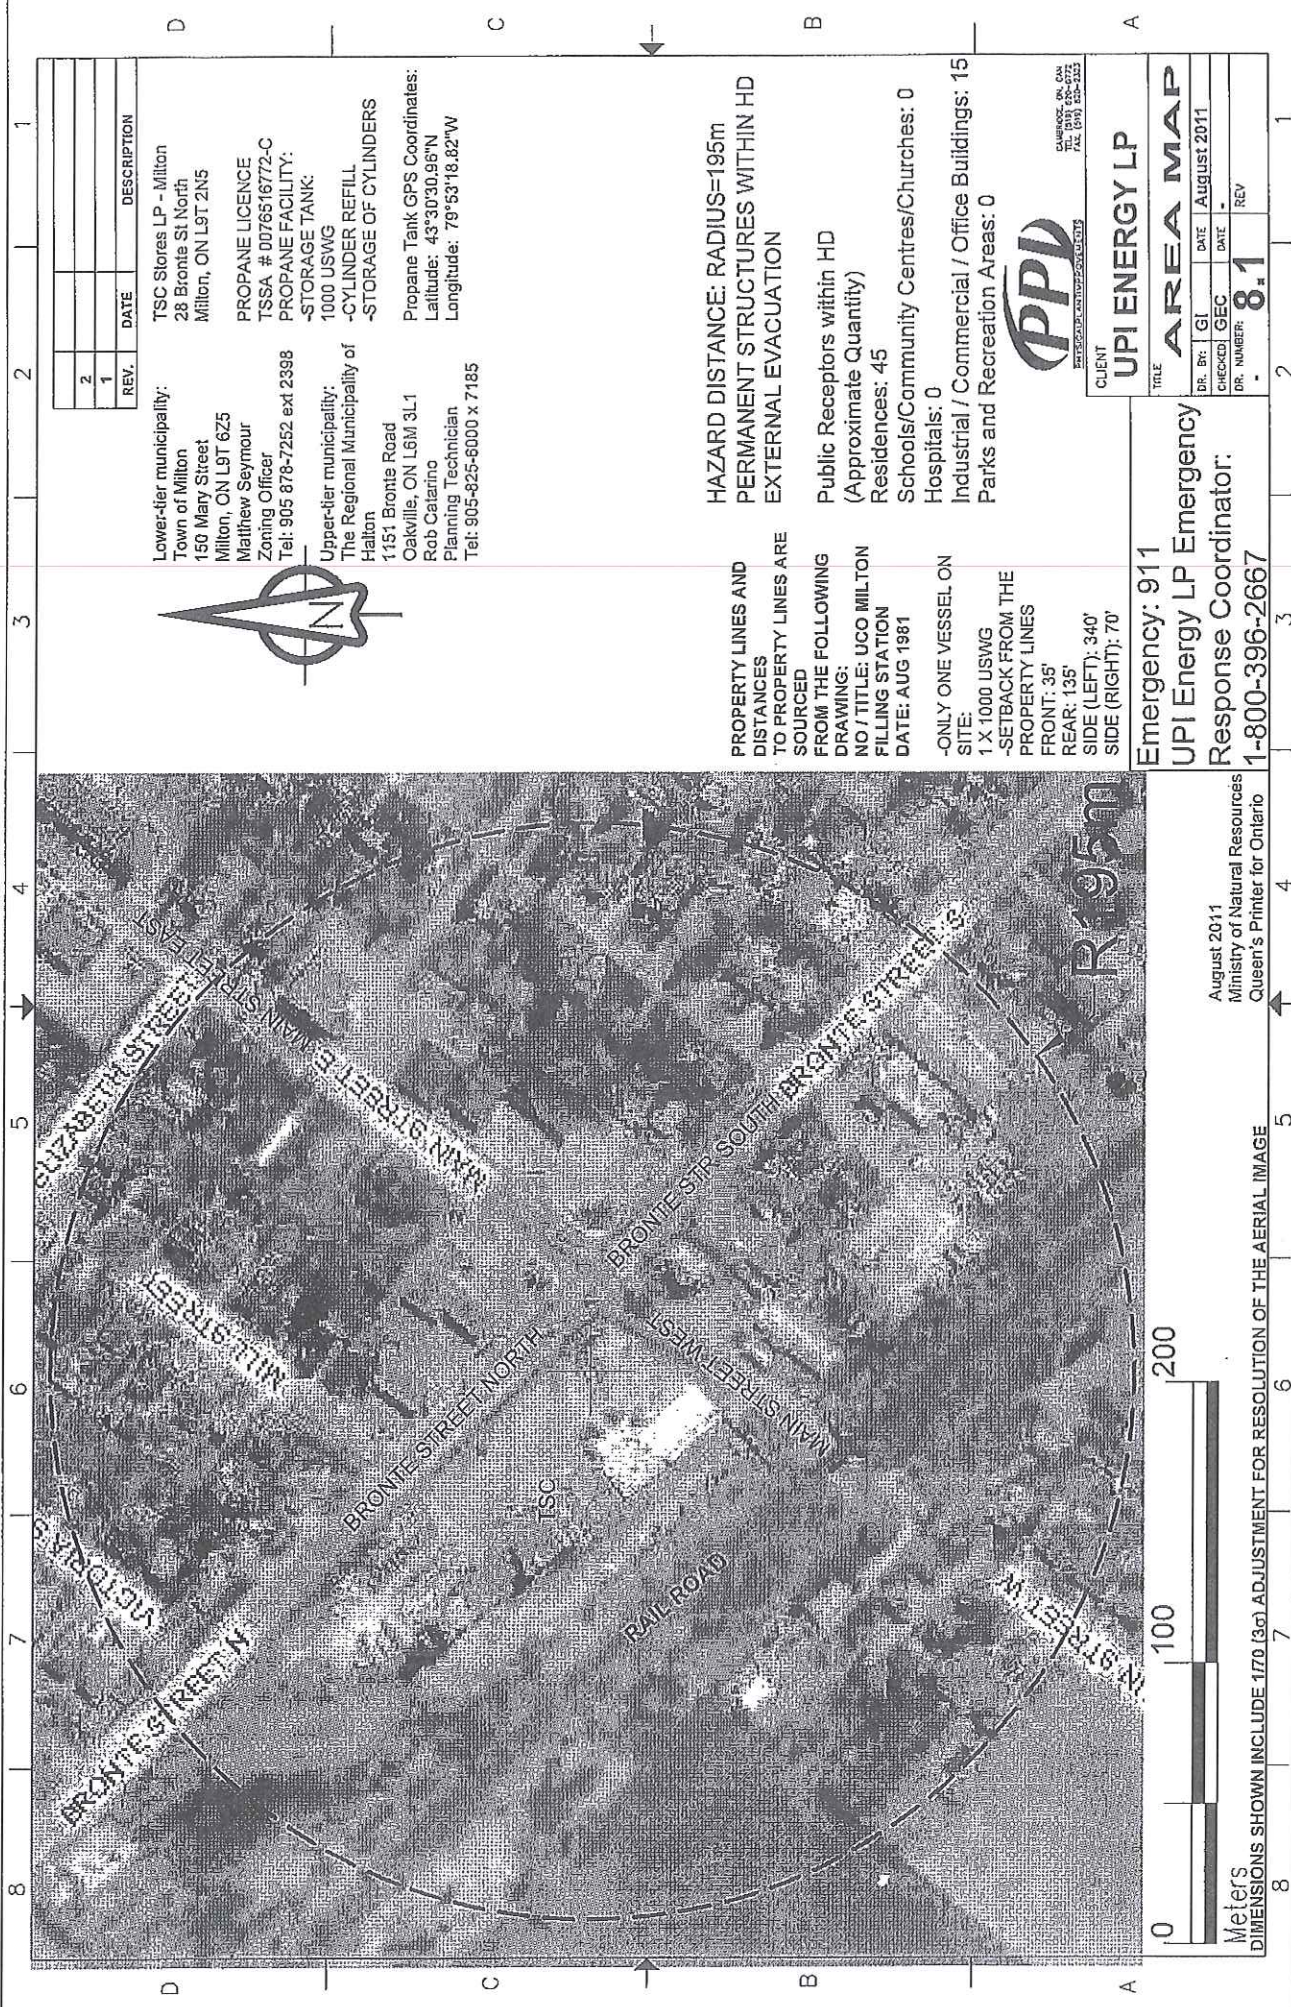

REV.	DATE	DESCRIPTION
2		
1		

Lower-tier municipality:
 Town of Milton
 150 Mary Street
 Milton, ON L9T 6Z5
 Matthew Seymour
 Zoning Officer
 Tel: 905 878-7252 ext 2398

Upper-tier municipality:
 The Regional Municipality of
 Halton
 1151 Bronte Road
 Oakville, ON L6M 3L1
 Rob Catarino
 Planning Technician
 Tel: 905-825-6000 x 7185

Propane Tank GPS Coordinates:
 Latitude: 43°30'30.96"N
 Longitude: 79°53'18.82"W

HAZARD DISTANCE: RADIUS=195m
 PERMANENT STRUCTURES WITHIN HD
 EXTERNAL EVACUATION

Public Receptors within HD
 (Approximate Quantity)
 Residences: 45
 Schools/Community Centres/Churches: 0
 Hospitals: 0
 Industrial / Commercial / Office Buildings: 15
 Parks and Recreation Areas: 0

PROPERTY LINES AND
 DISTANCES
 TO PROPERTY LINES ARE
 SOURCED
 FROM THE FOLLOWING
 DRAWING:
 NO / TITLE: UGO MILTON
 FILLING STATION
 DATE: AUG 1981

-ONLY ONE VESSEL ON
 SITE:
 1 X 1000 USWG
 -SETBACK FROM THE
 PROPERTY LINES
 FRONT: 35'
 REAR: 135'
 SIDE (LEFT): 340'
 SIDE (RIGHT): 70'



CLIENT		UPI ENERGY LP	
TITLE			
AREA MAP			
DR. BY:	GI	DATE	AUGUST 2011
CHECKED:	GEC	DATE	
DR. NUMBER:	8.1		REV

Emergency: 911
 UPI Energy LP Emergency
 Response Coordinator:
 1-800-396-2667



August 2011
 Ministry of Natural Resources
 Queen's Printer for Ontario

DIMENSIONS SHOWN INCLUDE 1/70 (3σ) ADJUSTMENT FOR RESOLUTION OF THE AERIAL IMAGE



REV.	DATE	DESCRIPTION
2	2013-05-22	Feature 4 identified, feature 10 added
1		

TSC Stores LP - Milton
28 Bronte St North
Milton, ON L9T 2N5

PROpane LICENCE
TSSA # 0076516772-C
PROpane FACILITY:
-STORAGE TANK:
1000 USWG
-CYLINDER REFILL
-STORAGE OF
CYLINDERS

Propane Tank GPS
Coordinates:
Latitude: 43°30'30.96"N
Longitude: 79°53'18.82"W

PROPERTY LINES AND DISTANCES
TO PROPERTY LINES ARE
SOURCED
FROM THE FOLLOWING DRAWING:
NO / TITLE: UCO MILTON FILLING
STATION
DATE: AUG 1981

NOTE: NO MORE THAN 500 LBS (225 KG) OF PROpane IN STORAGE
CAPACITY OF PARKING FOR PROpane
TANK TRUCK: NONE
CYLINDERS CONTAINING ANY PROpane (VAPOUR OR
LIQUID) ARE STORED IN VENTILATED STORAGE ONLY

- ① PROpane TANK
- ② PROpane CYLINDER FILLING STATION (CABINET)
- ③ BOLLARDS
- ④ FENCED AREA FOR STORAGE OF PROpane CYLINDERS-EMPTY
NEW, EXPIRED
- ⑤ PROpane DELIVERY TRUCK-DURING DELIVERY
(UNLOADING INTO THE FILLER PLANT)
- ⑥ FERTILIZERS
- ⑦ STORE-FARMING SUPPLIES, HARDWARE
- ⑧ STORAGE OF FLAMMABLE AND COMBUSTIBLE SUBSTANCES
- ⑨ PARKING
- ⑩ Storage of propane cylinders -
expired



CLIENT
UPI ENERGY LP

TITLE	
DR. BR.	DATE
DATE	DATE
DR. NUMBER	REV

Emergency: 911
UPI Energy LP Emergency
Response Coordinator:
1-800-396-2667

1 x 1,000 USWG PROpane STORAGE TANK
HORIZONTAL: 41" OD X 194" L

August 2011
Ministry of Natural Resources
Queen's Printer for Ontario



DIMENSIONS SHOWN INCLUDE 1770 (3σ) ADJUSTMENT FOR RESOLUTION OF THE AERIAL IMAGE

