



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

Dec 21

This Level 1 RSMP applies to:
 • a facility with a total propane storage capacity of 5,000 USWG or less; or
 • a facility with a fixed propane storage capacity of exactly 5,000 USWG and no more than 500 USWG of portable propane storage capacity on site.

Failure to fully complete this form may result in rejection.
Making a false statement may result in a fine or prosecution under the *Technical Standards and Safety Act*

Licence Number [REDACTED]

Check applicable type of propane operations.

Cylinder Motor Fill Filling Plant Card/Keylock

Submit along with this completed application a Facility Site Plan and a Map of the Surrounding Area.



SECTION A: GENERAL INFORMATION

The Undersigned applies to TSSA for a review for an RSMP under Ontario's *Technical Standards and Safety Act*, Propane Storage and Handling Regulation.

Company Name Ontario Corporation No., if applicable
A K&S Petro Canada Service Centre [REDACTED]

Operator Name (if different from above)
[REDACTED]

Telephone No. 807-934-2953 Fax No. 807-934-2953 E-mail kevward@hotmail.com

B Street No. 311 Street Name / 911 Number / Address, if applicable Main Street - Highway 17

Town / City or Township / County Ignace Province Ontario Postal Code P0T 1T0

Mailing address if different from above.

C Street No. [REDACTED] Street Name / 911 Number / Address, if applicable P.O. Box 1018

Town / City or Township / County Ignace Province Ontario Postal Code P0T 1T0

Information on Container Refill Centre or Filling Plant

D Location of facility.
Street No. 311 Street Name / 911 Number / Address, if applicable Main Street - Highway 17 Nearest Major Intersection Main Street and East Street

Town / City or Township / County Ignace Province Ontario Postal Code P0T 1T0

Name of Licence Holder K&S Petro Canada Service Centre

Name of a Senior Management person as defined in the regulation holding the Record of Training (ROT). ROT type
Kevin Twardowsky 100-08

Municipality (or municipalities if the facility or its hazard distance touches multiple borders)
Ignace, Ontario

Hours of operation. [REDACTED]

This document is valid until the next licence renewal date. You are required by law to notify TSSA of any change of information.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Print name	Signature	Date (dd-mm-yyyy)
Name of Licence Holder <u>K&S Petro Canada Service Centre</u>		<u>01/10/2011</u>
Name of Senior Management person as defined in the Regulation holding the Record of Training <u>Kevin Twardowsky</u>		<u>01/10/2011</u>



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION A: GENERAL INFORMATION (cont'd)


Indicate the year the facility was established. 2004 Indicate the year of any significant modifications, as defined in s.1, O.Reg 211/01, since establishment. 2004

Identify the psig rating and serial number for each fixed propane storage tank on site.


	PSIG	Serial Number
Tank 1:	<u>250 PSI</u>	<u>2-000-9514</u>
Tank 2:	_____	_____
Tank 3:	_____	_____

Enter capacity of propane in USWG, fixed, portable, and mobile, and provide detailed inventory that includes the number of tank/vessel for each type (fixed, portable, and mobile) and the capacity of each tank/vessel, on a separate document.

Fixed: 1000 Gallons Portable: 300 Gallons Mobile: 0



Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) <u>Kevin Twardowsky</u>	Official Title <u>Owner/Operator</u>	
Signature 	Telephone No. <u>807-934-2953</u>	Date (dd-mm-yyyy) <u>01/10/2011</u>



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

1. Contacts for Emergency Response

1. Facility Contact Personnel - Key Contact		5. Facility 24-Hour Contact Person	
Name Kevin Twardowsky	For Office Use - Party No.	Name Kevin Twardowsky	For Office Use - Party No.
Official Title Owner/Operator		Official Title Owner/Operator	
Telephone No. 807-934-2953	Fax No. 807-934-2953	Cell No. 807-938-8042	Fax No. 807-934-2953
E-mail kevtward@hotmail.com		E-mail kevtward@hotmail.com	
Role and responsibilities in emergency - call 911 - Shut off power - Assist emergency services - assist any injured / establish safety zone (if necessary)		Role and responsibilities in emergency - call 911 - Shut off power - Assist emergency services - assist any injured / establish safety zone (if necessary)	
2. Facility Contact Personnel - Alternate Contact		6. Name of Facility Manager	
Name Sandy Twardowsky	For Office Use - Party No.	Name Sandy Twardowsky	For Office Use - Party No.
Official Title Owner/Operator		Official Title Owner/Operator	
Telephone No. 807-934-2953	Fax No. 807-934-2953	Telephone No. 807-936-0066	Fax No. 807-934-2953
E-mail kevinandsandywardowsky@hotmail.com		E-mail kevinandsandywardowsky@hotmail.com	
Role and responsibilities in emergency - call 911 - Shut off power - Assist emergency services - assist any injured / establish safety zone (if necessary)		Role and responsibilities in emergency - call 911 - Shut off power - Assist emergency services - assist any injured / establish safety zone (if necessary)	
3. Local Fire Services - Key Contact		7. Propane Supplier Key Contact Person	
Name Robert Berube	For Office Use - Party No.	Name Kirk Shaughnessy / Cal-Gas	For Office Use - Party No.
Official Title Fire Chief	E-mail ignacefire@bellnet.ca	Official Title Area Manager	E-mail kshaughnessy@calgasinc.com
Telephone No. 807-934-2211	Fax No. 807-934-2541	Telephone No. 807-344-3300	Fax No. 807-344-3221
Role and responsibilities in emergency - respond to 911 call / - co-ordinate emergency services on-site - assist any injured		Role and responsibilities in emergency - clean/dispose of contaminated material - complete written reports in accordance with equipment information	
Fire Services Address 115 Front Street Ignace, Ontario P0T 1T0		Propane Supplier Address 1950 Mountdale Avenue Thunder Bay, Ontario P7E 3B1	
4. Local Fire Services - Alternate Contact		8. Municipal Contact	
Name Sean DeTracey	For Office Use - Party No.	Name Wayne Hanchard	
Official Title Deputy Fire Chief	E-mail ignacefire@bellnet.ca	Official Title Township of Ignace Administrator	
Telephone No. 807-934-2211	Fax No. 807-934-2541	Telephone No. 807-934-2202	Fax No. 807-934-2864
Role and responsibilities in emergency - respond to 911 call / - co-ordinate emergency services on-site - assist any injured		E-mail admintreasurer@tbaytel.net	
Fire Services Address 115 Front Street Ignace, Ontario P0T 1T0		Municipality Name and Address 34 Highway 17 West P.O. Box 248 Ignace, ON P0T 1T0	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Kevin Twardowsky	Official Title Owner/Operator
Signature 	Telephone No. 807-934-2953
	Date (dd-mm-yyyy) 01/10/2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation


SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

2. Additional Safety Measures

Describe any other measures in place at the facility that exceed the minimum Code and Standards requirements.

- Full response measures are in place for each type of situation (specific items/procedures, etc. are included in attached Emergency Response Plan for Petro Canada 53800 Ignace, Ontario site)

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Kevin Twardowsky	Official Title Owner/Operator	
Signature 	Telephone No. 807-934-2953	Date (dd-mm-yyyy) 01/10/2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

3. Record of Emergency Training Provided - For most recent 12-month period.

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Training Date (dd-mm-yyyy) 15/02/2011	Print Name of Training Provider: Kevin Twardowsky
	Print Name of Instructor: Dan Pontisso
Training Date (dd-mm-yyyy) 15/02/2011	Print Name of Training Provider: Sandy Twardowsky
	Print Name of Instructor: Dan Pontisso
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Training on the facility's Emergency Management Procedures provided to staff.

Training Date (dd-mm-yyyy) 19/02/2011	Print Name of Training Provider: Jordan Tilley
	Print Name of Instructor: Kevin Twardowsky
Training Date (dd-mm-yyyy) 19/02/2011	Print Name of Training Provider: Brayden Moore
	Print Name of Instructor: Kevin Twardowsky
Training Date (dd-mm-yyyy) 26/02/2011	Print Name of Training Provider: Brandon Rousseau
	Print Name of Instructor: Sandy Twardowsky

On-site specific training provided to certificate holders / persons with Records of Training.

Training Date (dd-mm-yyyy) 01/10/2011	Print Name of Training Provider: Jordan Tilley
	Print Name of Instructor: Kevin Twardowsky
Training Date (dd-mm-yyyy) 08/10/2011	Print Name of Training Provider: Brandon Rousseau
	Print Name of Instructor: Kevin Twardowsky
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Kevin Twardowsky	Official Title Owner/Operator
Signature 	Telephone No. 807-934-2953
	Date (dd-mm-yyyy) 20/10/2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

4. Emergency Training Plan for Coming Year

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Target Date (dd-mm-yyyy) 09/01/2012	Print Name of Training Provider: Kevin Twardowsky
	Print Name of Instructor: Dan Pontisso
Target Date (dd-mm-yyyy) 09/01/2012	Print Name of Training Provider: Sandy Twardowsky
	Print Name of Instructor: Dan Pontisso
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Training on the facility's Emergency Management Procedures provided to staff.

Target Date (dd-mm-yyyy) 14/01/2012	Print Name of Training Provider: Jordan Tilley
	Print Name of Instructor: Kevin Twardowsky
Target Date (dd-mm-yyyy) 14/01/2012	Print Name of Training Provider: Brayden Moore
	Print Name of Instructor: Kevin Twardowsky
Target Date (dd-mm-yyyy) 14/01/2012	Print Name of Training Provider: Brandon Rousseau
	Print Name of Instructor: Kevin Twardowsky

On-site specific training provided to certificate holders / persons with Records of Training.

Target Date (dd-mm-yyyy) 08/31/2012	Print Name of Training Provider: Jordan Tilley
	Print Name of Instructor: Kevin Twardowsky
Target Date (dd-mm-yyyy) 08/31/2012	Print Name of Training Provider: Brandon Rousseau
	Print Name of Instructor: Kevin Twardowsky
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Kevin Twardowsky	Official Title Owner/Operator
Signature 	Telephone No. 807-934-2953
	Date (dd-mm-yyyy) 20/10/2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

5. Emergency Response Communications Plan

Warnings and Actions

Describe who gives warnings to whom, and how and when the warning will be given (including public notification as appropriate).
Depending on emergency and if danger is immediate, License holder will give the appropriate warnings until Emergency Services arrive on-site. The Emergency Action Plan is followed, 911 is called, and as Emergency Services arrive on-site, they will take over and direct whatever further action they deem necessary to ensure the safety of the site, employees, and surrounding area. Depending on the type of emergency and current situation, Emergency Services will communicate any further information to the Propane Supplier (Cal-Gas), the Township of Ignace, TSSA, Petro Canada, etc. until the situation is resolved.

Describe what action is to be taken and by whom when a warning is issued (including details of a meeting place in a safe identified area and activating the evacuation plan, if necessary).
Site owner/operator who is the license holder takes first action as per the Emergency Response Plan depending on the type of emergency. 911 is called and if evacuation is required, license holder co-ordinates actions until Emergency Services arrives on-site. Once on site, Emergency Services gives directions and warnings including any further actions that need to be taken, including any further evacuations. Evacuation procedures are followed as per the Emergency Action Plan, and if necessary, further instructions are provided in the "safe area" identified on the site map.

Communication with Emergency Response Authorities

Describe when and how the licence holder will give early warning to emergency response authorities (including a process to ensure that a call is placed to 911).
If a situation arises, the License holder will evaluate potential threat and hazards as per the Emergency Response Plan. Following the procedures, 911 is called and site is evacuated if necessary. License holder will co-ordinate with Emergency Services and remain in contact with 911 operator until they arrive on-site while providing them with a pertinent information prior to their arrival.

Describe provisions for fire department entry when there are no operations or staffing at the propane site.
Site has an alarm system in place which will contact owner/license holder in the event of an emergency after hours and will contact Emergency Services as required. Emergency Services also has the appropriate contacts including back-up contacts, etc. in the event that site access is required during off hours. Site contacts, due to the geographic nature of the community of Ignace, can be on-site within minutes of being contacted in any emergency.

Describe how the licence holder will ensure continual flow of updated information to authorities.
In the event of an emergency, the License holder will maintain contact with Emergency Services until they arrive on-site. Any pertinent information required by authorities, will be communicated prior to their arrival. As the necessary services arrive on-site, any further communication will continue to be directed towards the necessary action groups, including but not limited to, the police, ambulance, fire services, Petro Canada, Cal-Gas (propane supplier), the Township of Ignace, and TSSA.

How long will it take the facility liaison person to respond to the site.
Response to the site will occur within 3-4 minutes. Due to the geographic proximity to the site, the License holder can arrive in minutes as the residence is within 150 metres.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Kevin Twardowsky	Official Title Owner/Operator	
Signature 	Telephone No. 807-934-2953	Date (dd-mm-yyyy) 01/10/2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

6. Building and Site Security and Procedures

	Yes	No
1. Does the propane location have controlled access to limit unnecessary risk and entry (lock out procedures)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
2. Is there adequate night lighting at the site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
3. Are procedures in place that ensure access routes, aisles, storage area, filling areas and the grounds are kept clear from unwanted materials?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
4. Are there procedures that capture and record the daily inspection of hoses and inspection requirements for filling systems and mechanical devices used in the transfer of propane?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
5. Does the facility have procedures that include a process to isolate and purge any overfilled propane cylinders?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
6. Are weighing systems validated for accuracy?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
7. Are storage areas clearly marked with the vessels' capacity status (i.e., filled, empty, purged and other hazardous materials)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
8. Are quality assurance procedures in place to ensure that all valves are closed after the propane cylinders are filled?(e.g., QCC valves)	<input checked="" type="checkbox"/>	<input type="checkbox"/>
9. Is the schedule of maintenance and testing activities retained on site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>

7. Water Supply

The propane licence holder should work with the local fire department to determine water supply capabilities that are available based on the propane facility's location.

	Yes	No
1. Is a pressurized water system available at the propane facility site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
2. Can the municipal fire department pump 375 GPM (1420 LPM) of water at this location?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
3. What is the unobstructed distance to the closest water supply that could be used for firefighting activities? (distance in metres only)	<u>30 metres</u>	
4. What is the unobstructed distance to the closest approved water supply with year round access if there are no hydrants? (distance in metres only)	<u>200 metres</u>	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Kevin Twardowsky / Robert Berube	Official Title Owner/Operator / Fire Chief
Signature 	Telephone No. 807-934-2953 807-934-2211
	Date (dd-mm-yyyy) 26/10/2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

8. Licence holder and local Fire Services Review

To be completed by the Local Fire Services

Has the local fire service had an opportunity to review the Emergency Response and Preparedness Plan?

Yes	No
<input checked="" type="checkbox"/>	<input type="checkbox"/>

If not, please explain (e.g., no fire services).

N/A

Fire services comments, if any:

None

To be completed by the Licence Holder

In response to the above comments, the following action(s) is required:

The licence holder will respond to the Local Fire Services comments by: _____ (dd-mm-yyyy)

LOCAL FIRE SERVICES

The undersigned has reviewed Section B of the Risk and Safety Management Plan Fire Services.

Print name	Signature	Date (dd-mm-yyyy)
Local Fire Services Name Robert Berube		26/10/2011

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print)	Official Title
Kevin Twardowsky	Owner/Operator
Signature	Telephone No.
	807-934-2953
	Date (dd-mm-yyyy)
	26/10/2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS

Applicant must include a Facility Site Plan and Map of Surrounding Area

Facility Site Plan.

The licence holder will submit a copy of the original facility site plan updated with the following information:

1. The storage location of fixed, portable, and mobile vessels.
2. The maximum volume, types and storage location of hazardous materials.
3. Location of permanent structures on site.
4. Access and egress points and location of barriers.
5. Location of fire and emergency equipment (e.g., sprinkler systems, extinguishers, suppression systems) on site and location of fire hydrant or water supply where available.
6. Location of emergency shut off/shut down switches/valves.

Map of Surrounding Area.

The licence holder will submit a scaled aerial map of the surrounding area showing the following information:

7. The capacity and placement of the single largest propane storage vessel, including its setback from the front, rear and side property lines.
8. GPS co-ordinates of the single largest vessel.
9. Visual indication of the single largest fixed vessel and a circle made using the distance in Table 1 as the radius from the single largest fixed vessel.
10. Clear indication of the municipality or municipalities present within the circle.
11. Visual indication of property line information.
12. The location and name of roads within or abutting the site.
13. Key note to the drawing indicating the facility's municipal address, municipal lot number(s) and concession lines as applicable, and the date the map was prepared.
14. Address and contact information for each municipality (municipal clerk or secretary-treasurers of planning board). (Refer to page 5.)
15. Complete "**Required Mapping Information from Updated Site Plan**" in table below .

Required Mapping Information from Updated Site Plan

Date Map Prepared (dd-mm-yyyy) 01/10/2011	Capacity of single largest propane storage vessel (USWG) 1000 Gallons
Tank setback coordinates. Indicate placement on the map.	
Front: <u>22 Metres (72 ft)</u>	Right side property line: <u>35 Metres (118 ft)</u>
Rear: <u>8 Metres (26 ft)</u>	Left side property line: <u>15 Metres (49 ft)</u>
GPS coordinates of single largest vessel: <u>N 49 25.012' W 091 39.592'</u>	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Kevin Twardowsky	Official Title Owner/Operator	
Signature 	Telephone No. 807-934-2953	Date (dd-mm-yyyy) 01/10/2011



Technical Standards and Safety Authority
 www.tssa.org

14th Floor - Centre Tower
 3300 Bloor Street West
 Toronto Ontario M8X 2X4
 Fax: 416.231.4903
 Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
 Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)

Applicant must include a Facility Site Plan and Map of Surrounding Area


Table 1: Distance Table

Water Capacity (litres)	Nominal Water Capacity (USWG)	Distance to 1 psi overpressure (m)
1,890	500	155
3,780	1,000	195
4,920	1,300	213
6,620	1,750	235
7,130	1,885	241
7,560	2,000	246
18,900	5,000	333

Formula: $D = 16.94 \times (1.524 \times C)^{1/3}$
 D = Distance to overpressure of 1 psi (meters)
 C = Tank Total Capacity in USWG

Parameters: Density of Propane is 0.5033 kg per litre @ 15 C
 Assume all vessels are 80% full
 1 gallon [US, liquid] = 0.003785411784 cubic meter
 1 cubic metre = 264.17 USWG

Hazard Distance Chart (EPA-TNT model)

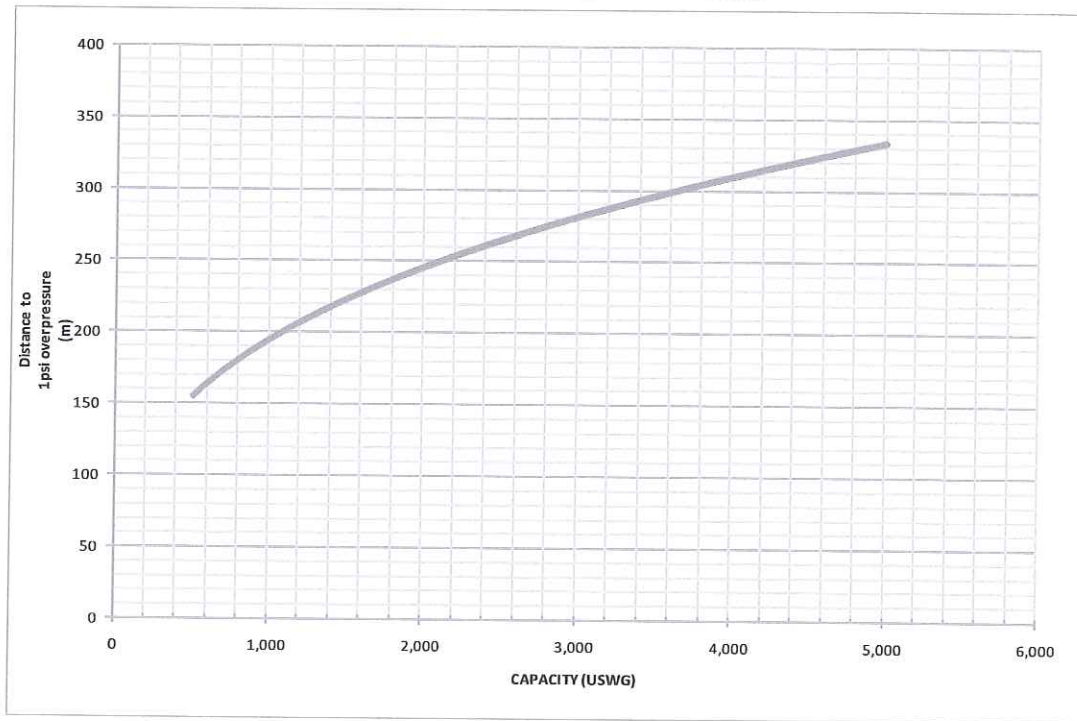



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)

Applicant must include a Facility Site Plan and Map of Surrounding Area

As an accompaniment to the Map of Surrounding Area, provide the following information about buildings and features present within the circle in Table 2.

Table 2: Buildings and Features

Buildings and Features Present within the Circle on the Map of the Surrounding Area AND Name and Address of Closest Building or Feature	* Number of Buildings and Features (mark with an "X")				Distance from Tank to Closest Building or Feature
	0	1	2-10	11+	
Industrial buildings or parks or golf courses Name: <u>Gamma's Grocery and Hardware Store</u> Address: <u>211 Main Street - Highway 17</u> City: <u>Ignace</u> Province <u>Ontario</u> Postal Code <u>P0T 1T0</u>			X		<u>80</u> m
Residential building units specifically permanent single family dwellings, condominiums, and apartments. [Redacted]			X		<u>25</u> m
Commercial building units specifically retail, restaurants, entertainment, theatres, and sporting complexes. Name: <u>Wayfare Restaurant</u> Address: <u>311 Main Street - Highway 17</u> City: <u>Ignace</u> Province <u>Ontario</u> Postal Code <u>P0T 1T0</u>			X		<u>20</u> m
Commercial building units – continuous occupancy specifically hotels, campgrounds, and resorts. Name: <u>Westwood Motel</u> Address: <u>405 Main Street - Highway 17</u> City: <u>Ignace</u> Province <u>Ontario</u> Postal Code <u>P0T 1T0</u>			X		<u>125</u> m
Sensitive institutions specifically hospitals, schools and day cares, nursing and retirement homes, mental health institutions, and prisons. Name: <u>Crossroad Employment Centre / Ignace Nursery School</u> Address: <u>312 Pine Street</u> City: <u>Ignace</u> Province <u>Ontario</u> Postal Code <u>P0T 1T0</u>	X				<u>400</u> m
Emergency responders specifically fire stations, ambulance stations, and police stations. Name: <u>Ontario Provincial Police</u> Address: <u>502 Main Street - Highway 17</u> City: <u>Ignace</u> Province <u>Ontario</u> Postal Code <u>P0T 1T0</u>	X	X			<u>200</u> m <i>100</i>

* For multi-unit buildings, count each unit as "1".

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) <u>Kevin Twardowsky</u>	Official Title <u>Owner/Operator</u>
Signature 	Telephone No. <u>807-934-2953</u>
	Date (dd-mm-yyyy) <u>01/10/2011</u>



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

WORKSHEET


Portable Storage Additional Information Worksheet

Cylinder Size	Capacity in USWG	Quantity	Total Volume in USWG
# 420	123.9		
# 100	29.5	4	118.00
# 40	11.75		
# 33.3	9.62	5	48.10
# 30	8.8		
# 20	5.8	24	139.20
# 10	2.9		
# 5	1.5		
Total Cylinder Capacity			305.30


Tanks Stored On-site Not Connected for Use

Tank Size In USWG	Quantity	Total Volume in USWG
N/A		
Total Tank Capacity		0

Total Cylinder Capacity	305.30
Total Tank Capacity	0
Total Portable Capacity (Total Cylinder Capacity + Total Tank Capacity)	305.30

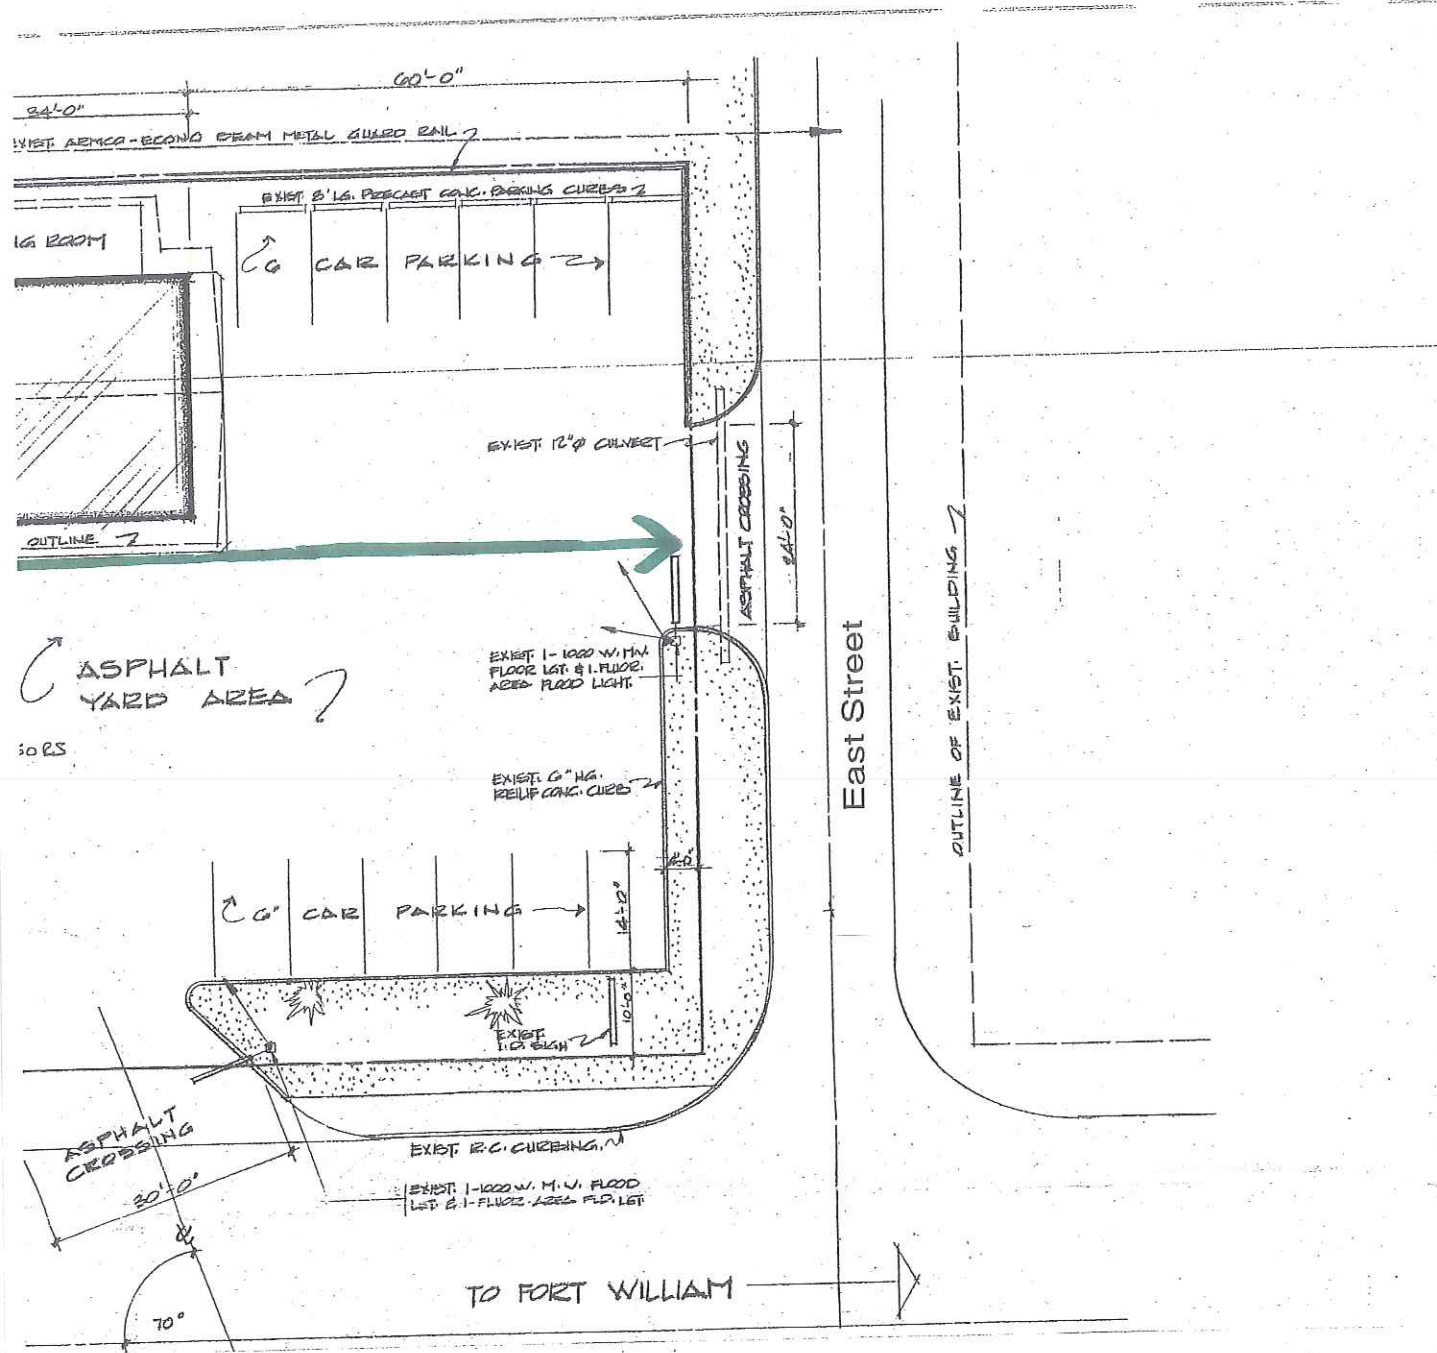

K&S PETRO CANA
 311-319 HWY. 17
 16NACE, ON
 POT ITO

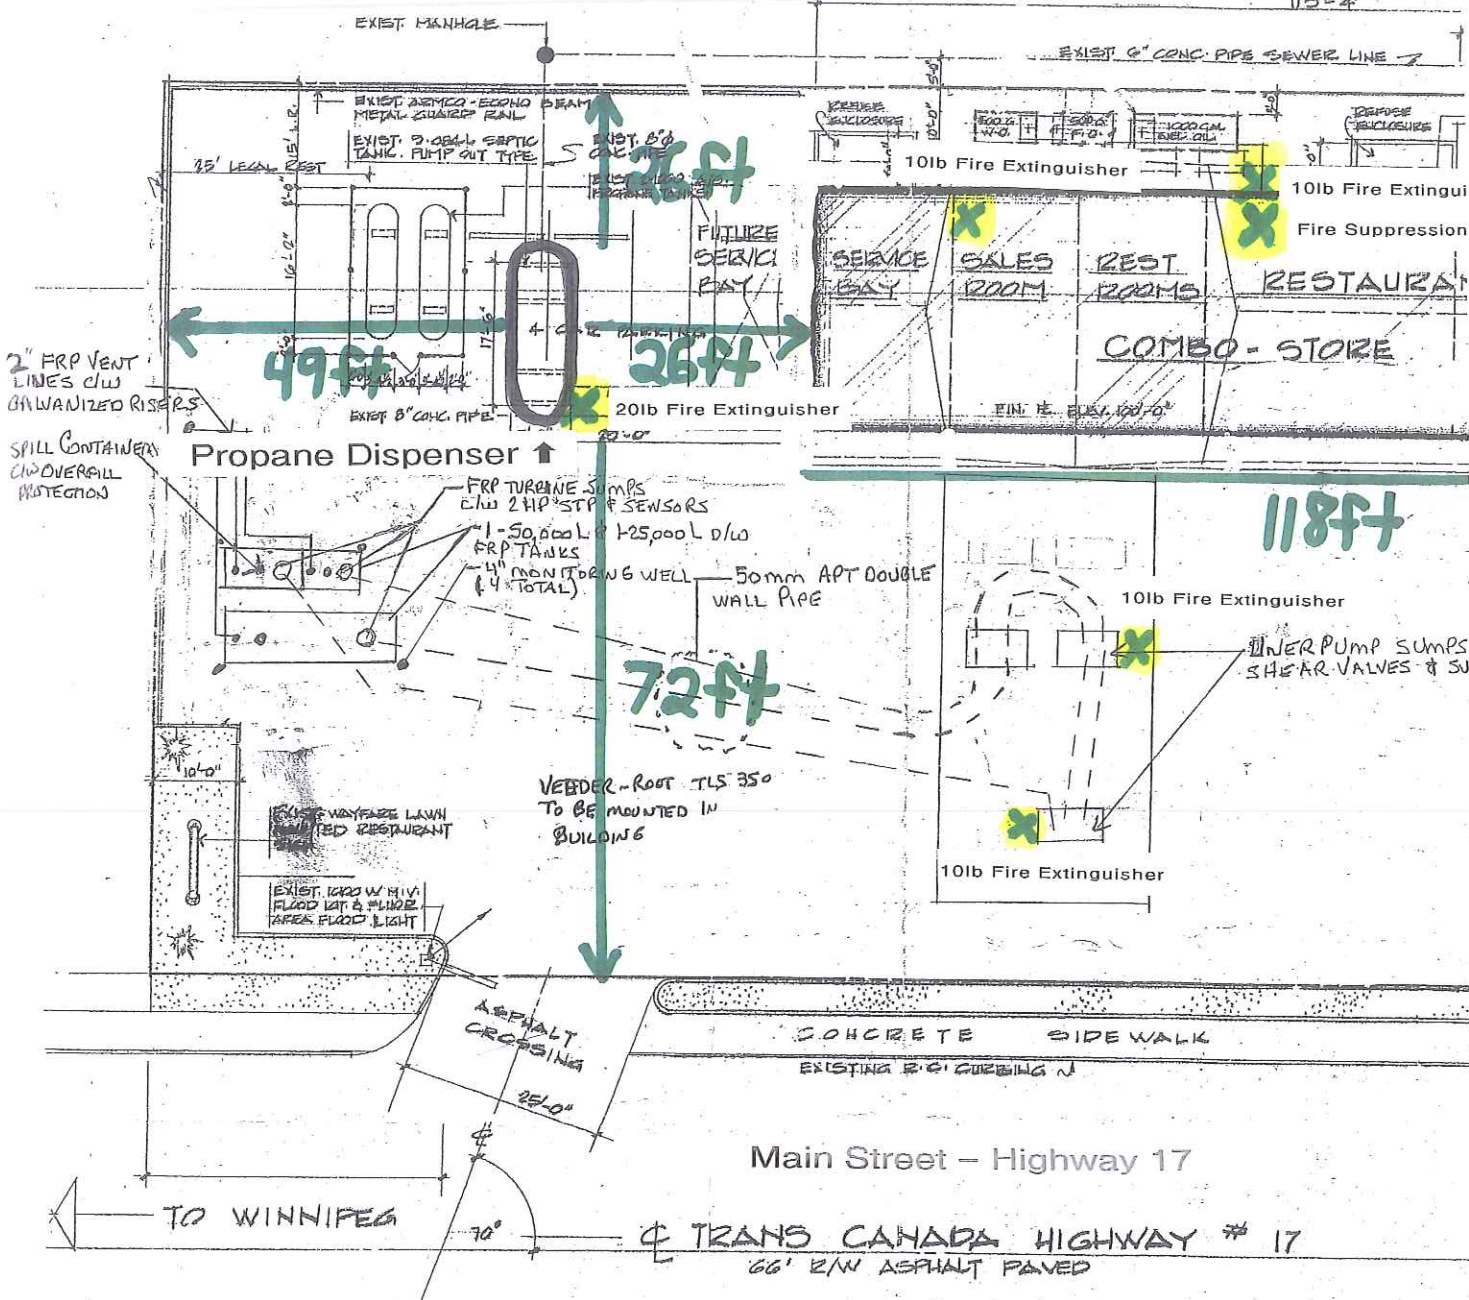

Tanks to be located min. 1.5 m from the property line
 Submit tank removal assessment report to TSSA.

Technical Standards and Safety Authority	Fuels Safety Division
DRAWING REVIEWED	
Revisions / Notes: 08 / No	
Name: MAREK KULIK	
Signature: <i>[Signature]</i>	
Date: Oct 3, 2008	

**EMERGENCY
TELEPHONE
NUMBERS**
FIRE 911
POLICE 911
CAL-GAS
888-580-5660

IT IS AN OFFENCE
TO FILL PROPANE
CYLINDERS AND
CUTTING FUEL
CONTAINERS
IN EXCESS OF
90% CAPACITY
BY VOLUME

1075
2

ELECTRICAL
EMERGENCY
SERVICES



**TRANSPORT
CYLINDERS IN AN
SECURED IN AN
UPRIGHT POSITION
IN A VENTILATED
SPACE.**

K&S Petro Canada Service Centre



Fire Department ↓

Propane Dispenser ↓

K&S Petro Canada ↓

↓ Wayfare Restaurant

Main Street - Highway 17

↓ Safe Meeting Area

O.P.P. ↓

Ignace Plaza ↓

LCBO, CIBC Bank,

Credit Union

East Street

Ignace Nursery School ↓

← Emergency Water Supply