



**Technical Standards and Safety Authority**  
 www.tssa.org  
 14th Floor - Centre Tower  
 3300 Bloor Street West  
 Toronto Ontario M8X 2X4  
 Fax: 416.231.4903  
 Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
**Technical Standards and Safety Act**  
 Propane Storage and Handling Regulation

This Level 1 RSMP applies to:
 

- a facility with a total propane storage capacity of 5,000 USWG or less; or
- a facility with a fixed propane storage capacity of exactly 5,000 USWG and no more than 500 USWG of portable propane storage capacity on site.


Failure to fully complete this form may result in rejection.  
 Making a false statement may result in a fine or prosecution  
 under the *Technical Standards and Safety Act*

Licence Number 0033815001-C

Check applicable type of propane operations.

Cylinder     Motor Fill     Filling Plant     Card/Keylock

Submit along with this completed application a Facility Site Plan and a Map of the Surrounding Area.

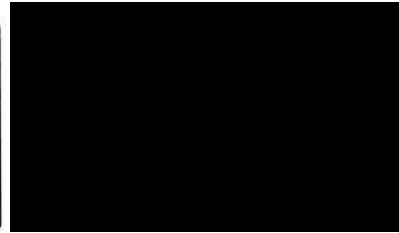

**SECTION A: GENERAL INFORMATION**

The Undersigned applies to TSSA for a review for an RSMP under Ontario's *Technical Standards and Safety Act, Propane Storage and Handling Regulation.*

**A** Company Name Sunset Strip Enterprises Limited (legal name) Ontario Corporation No., if applicable 897462461  
 Operator Name (if different from above) Sunset Strip Husky (trade name)

Telephone No. 807 468-4888 Fax No. 807 468-9204 E-mail sunsethusky@krmts.ca

**B** Street No. 1401 Street Name / 911 Number / Address, if applicable Hwy 17E  
 Town / City or Township / County Kenora Province Ontario Postal Code P9N 1M1

Mailing address if different from above.

**C** Street No. \_\_\_\_\_ Street Name / 911 Number / Address, if applicable \_\_\_\_\_  
 Town / City or Township / County \_\_\_\_\_ Province \_\_\_\_\_ Postal Code \_\_\_\_\_

**Information on Container Refill Centre or Filling Plant**

Location of facility.

**D** Street No. 1401 Street Name / 911 Number / Address, if applicable Hwy 17E Nearest Major Intersection Hwy 17E and Pine Portage Road  
 Town / City or Township / County Kenora Province Ontario Postal Code P9N 1M1

Name of Licence Holder Eugene J Manzie

Name of a Senior Management person as defined in the regulation holding the Record of Training (ROT). Eugene J Manzie ROT type 100-01-82697 Propane Pump Attndt

Municipality (or municipalities if the facility or its hazard distance touches multiple borders) Kenora

Hours of operation.



This document is valid until the next licence renewal date. You are required by law to notify TSSA of any change of information.

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Print name	Signature	Date (dd-mm-yyyy)
Name of Licence Holder <u>Eugene J Manzie</u>		<u>16 NOV 2011</u>
Name of Senior Management person as defined in the Regulation holding the Record of Training <u>Eugene J Manzie</u>		

SR 681210

Level 1 Risk and Safety Management Plan (RSMP)  
Technical Standards and Safety Act  
Propane Storage and Handling Regulation



Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

SECTION A: GENERAL INFORMATION (cont'd)


Indicate the year the facility was established. 1986  
Indicate the year of any significant modifications, as defined in s.1, O.Reg 211/01, since establishment. N/A

Identify the psig rating and serial number for each fixed propane storage tank on site.

	PSIG	Serial Number
Tank 1:	250 PSIG at 11.5 F	249.5123467890
Tank 2:		
Tank 3:		

Enter capacity of propane in USWG, fixed, portable, and mobile, and provide detailed inventory that includes the number of tank/vessel for each type (fixed, portable, and mobile) and the capacity of each tank/vessel, on a separate document.

Fixed: 1996 USWG      Portable: 139.2 USWG      Mobile: N/A



Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Eugene J Manzie	Official Title Vice President
Signature 	Telephone No. 807 468 4888
	Date (dd-mm-yyyy) 22 Feb 2012



**Technical Standards and Safety Authority**  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION A: GENERAL INFORMATION (cont'd)**  
Activity Information

<b>Name of Propane Supplier(s)</b> Superior Propane Prairie Regional Operations Centre			
Street No. 140	Street Name / 911 Number / Address, if applicable Bannatyne Avenue		
Town / City or Township / Country Winnipeg		Province Manitoba	Postal Code R3B 3C5
Telephone No. 204 924-5719	Fax No. 204 924-5718	Contact Name Darell B Plummer	
E-mail plummerd@superiorpropane.com			

<b>Name of Propane Transporter.</b> If same as above, please check box. <input checked="" type="checkbox"/>			
Superior Propane			
Street No. 1303	Street Name / 911 Number / Address, if applicable Railway Street		
Town / City or Township / Country Kenora		Province Ontario	Postal Code P9N 0B2
Telephone No. 807 468-9163	Fax No. 807 468-9175	Contact Name Carmine Fagnilli	
E-mail N/A			

<b>Off-site Cylinder and/or Mobile Storage</b> N/A	Capacity stored off-site, in USWG	For Office Use - Party No.
Street No.	Street Name / 911 Number / Address, if applicable	
Town / City or Township / Country		Province
Telephone No.		Contact Name

Note: Customer storage is not considered off-site storage.

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Eugene J Manzie	Official Title Vice President
Signature 	Telephone No. 807 468 4888
	Date (dd-mm-yyyy) 16 Nov 2011





**Technical Standards and Safety Authority**  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
**Technical Standards and Safety Act**  
Propane Storage and Handling Regulation

**SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN**

The licence holder will complete Section B in consultation with the local Fire Services.

Description of the maximum volume, types and storage location of other hazardous materials on site, if any.

Fuel tank farm - two (2) tanks regular fuel max capacity of 50,000 litres each; one (1) tank diesel fuel max capacity of 35,000 litres; one (1) tank premium fuel with max capacity of 15,000 litres.

Warehouse storage of engine oil; max on site storage at any time 200 litres. See site diagram for location of fuel tank farm and warehouse.

Description of fire and emergency equipment indicated on facility site map.

Ten (10) ABC type fire extinguishers on site (see site diagram for locations)

Closest fire hydrant located 35 metres from propane dispensing location

List of fire protection controls (e.g., fire detection systems, fire notification systems, alarm systems, automatic shut off devices, fusible links, etc.) and describe their function, use and operation.

Two (2) pump emergency shut off switches; one located at gas console inside store; one located at propane refill station (see site diagram for locations)

Maintenance and testing schedule for fire protection controls and devices.

Monthly inspection of all fire extinguishers carried out by Sunset Strip Husky Operations Manager

Yearly inspection of all fire extinguishers carried out by Northwest Fire and Safety

Superior Propane 6 month inspection of propane dispensing station including controls and devices

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Eugene J Manzie	Official Title Vice President
Signature 	Telephone No. 807 468-4888
	Date (dd-mm-yyyy) 16 Nov 2011



**Technical Standards and Safety Authority**  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)**

1. Contacts for Emergency Response

<b>1. Facility Contact Personnel - Key Contact</b>		<b>5. Facility 24-Hour Contact Person</b>	
Name Douglas Rushfeldt	For Office Use - Party No.	Name Douglas Rushfeldt	For Office Use - Party No.
Official Title President		Official Title Operations Manager	
Telephone No. 807 468-7934 (home); 466-6861 (cell)	Fax No. 807 468-9204 (work)	Cell No. 807 467-1145	Fax No. 807 468-9204 (work)
E-mail husky@kmts.ca (home); sunsethusky@kmts.ca (work / webmail)		E-mail husky@kmts.ca (home); sunsethusky@kmts.ca (work / webmail)	
Role and responsibilities in emergency Contact emergency services; contact Superior Propane; contact Husky Energy; order evacuation if appropriate		Role and responsibilities in emergency Ensure all emergency shut offs are activated; power supplies off; contact emergency services; order evacuation if appropriate	
<b>2. Facility Contact Personnel - Alternate Contact</b>		<b>6. Name of Facility Manager</b>	
Name Eigene Manzie	For Office Use - Party No.	Name Gina Sinclair	For Office Use - Party No.
Official Title Vice President		Official Title General Manager	
Telephone No. 807 467-3044 (home); 466-8792 (cell)	Fax No. 807 467-3044 (home)	Telephone No. 807 468-3360 (home); 468-4888 (cell)	Fax No. 807 468-9204 (work)
E-mail ejmagm@shaw.ca (home); sunsethusky@kmts.ca (work / webmail)		E-mail ginga6@hotmail.com (home); sunsethusky1@kmts.ca (work)	
Role and responsibilities in emergency Contact emergency services; contact Superior Propane; contact Husky Energy; order evacuation if appropriate		Role and responsibilities in emergency Contact emergency services; contact Superior Propane; contact Husky Energy; order evacuation if appropriate	
<b>3. Local Fire Services - Key Contact</b>		<b>7. Propane Supplier Key Contact Person</b>	
Name Warren F. Brinkman	For Office Use - Party No.	Name Superior Propane Hot Line	For Office Use - Party No.
Official Title Emergency Services Manager District of Kenora		Official Title	
Telephone No. 807 467-2107 (office); 467-7573 (cell)	Fax No. 807 467-2155	Telephone No. 1 877 873-7467	Fax No.
E-mail wbrinkman@kenora.ca		E-mail	
Role and responsibilities in emergency Lead fire and emergency response coordination; advice to Sunset Strip Husky and emergency response staff re action to take. Cell 807 467-7573		Role and responsibilities in emergency Log the incident; pass incident information to Husky corporate hierarchy; provide advice re action to take; pass call to Husky subject matter experts.	
<b>4. Local Fire Services - Alternate Contact</b>		<b>8. Municipal Contact</b>	
Name Senior member of crew on duty	For Office Use - Party No.	Name Kevin Robertson	
Official Title See above		Official Title Chief Building Official	
Telephone No. 807 467-2090	Fax No. 807 467-2155	Telephone No. 807 467-2022	Fax No. 807 467-2246
E-mail N/A		E-mail	
Role and responsibilities in emergency Response to emergency; on site direction of response to emergency.		Municipality District of Kenora	

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Eugene J Manzie	Official Title Vice President
Signature 	Telephone No. 807 468-4888
	Date (dd-mm-yyyy) 16 Nov 2011





**Technical Standards and Safety Authority**  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
**Technical Standards and Safety Act**  
Propane Storage and Handling Regulation

**SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)**

2. Additional Safety Measures

Describe any other measures in place at the facility that exceed the minimum Code and Standards requirements.

24 hour security camera surveillance in-store and outdoors including continuous recording of last seven days.

Emergency Response Training at time of hire and annually thereafter. Trainees (cashiers, gas attendants, propane dispensing certificate holders) required to take written test and sign that training has been taken. All training records kept on file.

See attached copy of "Propane Emergency Response Procedures" which are posted in the office, at the Cashier counter and at the propane refill station.

See attached copy of Propane Dispenser Operating Procedures". Copies of these procedures are kept in the office area, at the Cashier counter, at the propane refill station and have also been incorporated into the Company's Standard Operating Procedures (SOPs).

See attached copy of "Quick Reference Emergency Response Plan" which is posted in the office, at the Cashier counter and at the propane refill station.

See attached proforma copy of "Daily Storage Tank Inspection" chart, copy of which is held on file in office for reference.

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Eugene J Manzie	Official Title Vice President	
Signature 	Telephone No. 807 468-4888	Date (dd-mm-yyyy) 10 Nov 2011



**Technical Standards and Safety Authority**  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
**Technical Standards and Safety Act**  
Propane Storage and Handling Regulation

**SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)**

3. Record of Emergency Training Provided - For most recent 12-month period.

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Training Date (dd-mm-yyyy) June 2011	Print Name of Training Provider: Husky Energy
	Print Name of Instructor: Dave Brown, District Manager
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Training on the facility's Emergency Management Procedures provided to staff.

Training Date (dd-mm-yyyy) May 2011	Print Name of Training Provider: Sunset Strip Enterprises Limited
	Print Name of Instructor: Dymetro Bordyniuk
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

On-site specific training provided to certificate holders / persons with Records of Training.

Training Date (dd-mm-yyyy) May 2011	Print Name of Training Provider: Superior Propane
	Print Name of Instructor: Carmine Fagnilli
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Eugene J Manzie	Official Title Vice President
Signature 	Telephone No. 807 468-4888
	Date (dd-mm-yyyy) 16 Nov 2011



**Technical Standards and Safety Authority**  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
**Technical Standards and Safety Act**  
Propane Storage and Handling Regulation

**SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)**

4. Emergency Training Plan for Coming Year

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Target Date (dd-mm-yyyy) June 2012	Print Name of Training Provider: Husky Energy
	Print Name of Instructor: District Manager Thomas Langer
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Training on the facility's Emergency Management Procedures provided to staff.

Target Date (dd-mm-yyyy) May - June 2012	Print Name of Training Provider: Sunset Strip Enterprises Limited
	Print Name of Instructor: Doug Rushfeldt
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

On-site specific training provided to certificate holders / persons with Records of Training.

Target Date (dd-mm-yyyy) July 2012	Print Name of Training Provider: Superior Propane
	Print Name of Instructor: Carmine Fagnilli
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Eugene J Manzie	Official Title Vice President
Signature 	Telephone No. 807 468-4888
	Date (dd-mm-yyyy) 16 Nov 2011





**Technical Standards and Safety Authority**  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)**

The licence holder will complete Section B in consultation with the local Fire Services.

5. Emergency Response Communications Plan

**Warnings and Actions**

Describe who gives warnings to whom, and how and when the warning will be given (including public notification as appropriate).

Senior manager on site to call 911 and to take charge; all customers requested to exit through closest exit door and to leave the immediate area of the business location.

Describe what action is to be taken and by whom when a warning is issued (including details of a meeting place in a safe identified area and activating the evacuation plan, if necessary).

All customers to exit through closest exit door and leave immediate area of the business location, on foot or by own vehicle if possible.

Entrances to the business location to be blocked by employees in order to prevent non-emergency response traffic from entering.

Staff to evacuate the premises and meet at the assembly area as shown on site map; senior manager to take head count to ensure all are present.

Senior Manager can be found by the responding Fire and Emergency Services Fire Chief or designate at assembly area or may be contacted by cell phone.

**Communication with Emergency Response Authorities**

Describe when and how the licence holder will give early warning to emergency response authorities (including a process to ensure that a call is placed to 911).

Cashier (a cashier on duty 24/7, 365 days per year) responsible for placing call to 911, if senior management not on site. Cashier to place calls to personnel on call out list if management not on site.

Describe provisions for fire department entry when there are no operations or staffing at the propane site.

Not applicable. Site is manned on a 24/7 basis, 365 days of the year. Facility access immediately off Hwy 17E.

Describe how the licence holder will ensure continual flow of updated information to authorities.

President or General Manager only, responsible for keeping authorities (including Husky Energy and Superior Propane) updated on status of an emergency.

How long will it take the facility liaison person to respond to the site.

10 minutes for primary; five (5) minutes for secondary.

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Eugene J Manzie	Official Title Vice President	
Signature 	Telephone No. 807 468 4888	Date (dd-mm-yyyy) 16 Nov 2011



**Technical Standards and Safety Authority**  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)**

The licence holder will complete Section B in consultation with the local Fire Services.

**6. Building and Site Security and Procedures**

	Yes	No
1. Does the propane location have controlled access to limit unnecessary risk and entry (lock out procedures)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
2. Is there adequate night lighting at the site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
3. Are procedures in place that ensure access routes, aisles, storage area, filling areas and the grounds are kept clear from unwanted materials?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
4. Are there procedures that capture and record the daily inspection of hoses and inspection requirements for filling systems and mechanical devices used in the transfer of propane?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
5. Does the facility have procedures that include a process to isolate and purge any overfilled propane cylinders?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
6. Are weighing systems validated for accuracy?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
7. Are storage areas clearly marked with the vessels' capacity status (i.e., filled, empty, purged and other hazardous materials)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
8. Are quality assurance procedures in place to ensure that all valves are closed after the propane cylinders are filled?(e.g., QCC valves)	<input checked="" type="checkbox"/>	<input type="checkbox"/>
9. Is the schedule of maintenance and testing activities retained on site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>

**7. Water Supply**

The propane licence holder should work with the local fire department to determine water supply capabilities that are available based on the propane facility's location.

	Yes	No
1. Is a pressurized water system available at the propane facility site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
2. Can the municipal fire department pump 375 GPM (1420 LPM) of water at this location?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
3. What is the unobstructed distance to the closest water supply that could be used for firefighting activities? (distance in metres only)	<u>35 metres</u>	
4. What is the unobstructed distance to the closest approved water supply with year round access if there are no hydrants? ( distance in metres only)	<u>N/A</u>	

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Eugene J Manzie	Official Title Vice President
Signature 	Telephone No. 807 468-4888
	Date (dd-mm-yyyy) 16 Nov 2011





**Technical Standards and Safety Authority**  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)**

The licence holder will complete Section B in consultation with the local Fire Services.

8. Licence holder and local Fire Services Review

**To be completed by the Local Fire Services**

Has the local fire service had an opportunity to review the Emergency Response and Preparedness Plan?

Yes

No

If not, please explain (e.g., no fire services).

N/A.

Fire services comments, if any:

See attached letter, dated 20 September 2011, from Emergency Services Manager, City of Kenora Fire and Emergency Services.

**To be completed by the Licence Holder**

In response to the above comments, the following action(s) is required:

All comments keyed to para numbers in above noted letter. (1) Error corrected. (2) Error corrected. (3) Necessary information has been added to the RSMP.

(4) See TSSA email dated 28/09/2011; coverage outside of site not required. (5) Flow rate to be confirmed by test (6) See comment at #4. (7) Site diagram

has been redrawn and a scale added. (8) Information is not required in this plan. (Copy of TSSA email provided to Kenora Emergency Services).

The licence holder will respond to the Local Fire Services comments by: This has been done.

(dd-mm-yyyy)

**LOCAL FIRE SERVICES**

The undersigned has reviewed Section B of the Risk and Safety Management Plan Fire Services.

Print name	Signature	Date (dd-mm-yyyy)
Local Fire Services Name <u>Warren F. Brinkman</u>		<u>17 November 2011</u>

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) <u>Eugene J Manzie</u>	Official Title <u>Vice President</u>	
Signature 	Telephone No. <u>807 468-4888</u>	Date (dd-mm-yyyy) <u>16 Nov 2011</u>





Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.662.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
**Technical Standards and Safety Act**  
**Propane Storage and Handling Regulation**

**SECTION C: SUBMISSIONS**

Applicant must include a Facility Site Plan and Map of Surrounding Area

**Facility Site Plan.**

The licence holder will submit a copy of the original facility site plan updated with the following information:

1. The storage location of fixed, portable, and mobile vessels.
2. The maximum volume, types and storage location of hazardous materials.
3. Location of permanent structures on site.
4. Access and egress points and location of barriers.
5. Location of fire and emergency equipment (e.g., sprinkler systems, extinguishers, suppression systems) on site and location of fire hydrant or water supply where available.
6. Location of emergency shut off/shut down switches/valves.

**Map of Surrounding Area.**

The licence holder will submit a scaled aerial map of the surrounding area showing the following information:

7. The capacity and placement of the single largest propane storage vessel, including its setback from the front, rear and side property lines.
8. GPS co-ordinates of the single largest vessel.
9. Visual indication of the single largest fixed vessel and a circle made using the distance in Table 1 as the radius from the single largest fixed vessel.
10. Clear indication of the municipality or municipalities present within the circle.
11. Visual indication of property line information.
12. The location and name of roads within or abutting the site.
13. Key note to the drawing indicating the facility's municipal address, municipal lot number(s) and concession lines as applicable, and the date the map was prepared.
14. Address and contact information for each municipality (municipal clerk or secretary-treasurers of planning board). (Refer to page 5.)
15. Complete "Required Mapping Information from Updated Site Plan" in table below.

**Required Mapping Information from Updated Site Plan**

Date Map Prepared (dd-mm-yyyy) 27/02/2011	Capacity of single largest propane storage vessel (USWG) 1096 USWG
Tank setback coordinates. Indicate placement on the map.	
Front: 14 metres	Right side property line: 45 metres
Rear: 77 metres	Left side property line: 4 metres
GPS coordinates of single largest vessel:	lat: 49.759603; long:-94.468308

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Eugene J Manzie	Official Title Vice President
Signature 	Telephone No. 807 468-4888
	Date (dd-mm-yyyy) 22 Feb 2012



**Technical Standards and Safety Authority**  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION C: SUBMISSIONS (cont'd)**

Applicant must include a Facility Site Plan and Map of Surrounding Area


**Table 1: Distance Table**

Water Capacity (litres)	Nominal Water Capacity (USWG)	Distance to 1 psi overpressure (m)
1,890	500	155
3,780	1,000	195
4,920	1,300	213
6,620	1,750	235
7,130	1,885	241
7,560	2,000	246
18,900	5,000	333

**Formula:**  $D = 16.94 \times (1.524 \times C)^{1/3}$   
D = Distance to overpressure of 1 psi (meters)  
C = Tank Total Capacity in USWG

**Parameters:** Density of Propane is 0.5033 kg per litre @ 15 C  
Assume all vessels are 80% full  
1 gallon [US, liquid] = 0.003785411784 cubic meter  
1 cubic metre = 264.17 USWG

**Hazard Distance Chart (EPA-TNT model)**

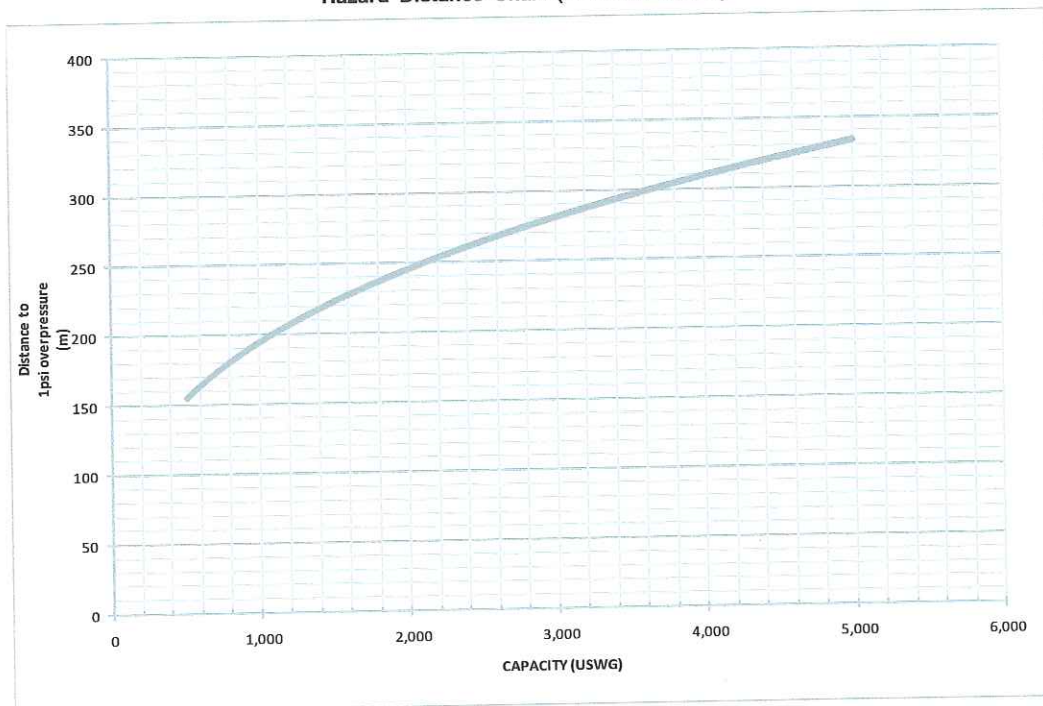

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Eugene J Manzie	Official Title Vice President	Date (dd-mm-yyyy)
Signature <i>E Manzie</i>	Telephone No. 807 468-4888	16 Nov 2011





**Technical Standards and Safety Authority**  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION C: SUBMISSIONS (cont'd)**

Applicant must include a Facility Site Plan and Map of Surrounding Area

As an accompaniment to the Map of Surrounding Area, provide the following information about buildings and features present within the circle in Table 2.

**Table 2: Buildings and Features**

Buildings and Features Present within the Circle on the Map of the Surrounding Area AND Name and Address of Closest Building or Feature	* Number of Buildings and Features (mark with an "X")				Distance from Tank to Closest Building or Feature
	0	1	2-10	11+	
Industrial buildings or parks or golf courses Name: <u>N/A</u> Address: _____ City: _____ Province _____ Postal Code _____	X				_____ m
Residential building units specifically permanent single family dwellings, condominiums, and apartments. [Redacted]				X	<u>15</u> m
Commercial building units specifically retail, restaurants, entertainment, theatres, and sporting complexes. Name: <u>Sunset Baits</u> Address: <u>1407 Hwy 17E</u> City: <u>Kenora</u> Province <u>Ontario</u> Postal Code <u>P9N 1M1</u>				X	<u>15</u> m
Commercial building units – continuous occupancy specifically hotels, campgrounds, and resorts. Name: <u>Tim Hortons</u> Address: <u>1344 Hwy 17E</u> City: <u>Kenora</u> Province <u>Ontario</u> Postal Code <u>P9N 1M2</u>			X		<u>65</u> m
Sensitive institutions specifically hospitals, schools and day cares, nursing and retirement homes, mental health institutions, and prisons. Name: <u>Kenora Jail</u> Address: <u>1430 River Drive</u> City: <u>Kenora</u> Province <u>Ontario</u> Postal Code <u>P9N 1K5</u>		X			<u>225</u> m
Emergency responders specifically fire stations, ambulance stations, and police stations. Name: <u>N/A</u> Address: _____ City: _____ Province _____ Postal Code _____	X				_____ m

\* For multi-unit buildings, count each unit as "1".

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) <u>Eugene J Manzie</u>	Official Title <u>Vice President</u>	Date (dd-mm-yyyy) <u>16 Nov 2011</u>
Signature 	Telephone No. <u>807 468-4888</u>	





**Technical Standards and Safety Authority**  
 www.tssa.org

14th Floor - Centre Tower  
 3300 Bloor Street West  
 Toronto Ontario M8X 2X4  
 Fax: 416.231.4903  
 Customer Service: 1.877.692.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
 Propane Storage and Handling Regulation

**SECTION C: SUBMISSIONS (cont'd)**  
 Applicant must include a Facility Site Plan and Map of Surrounding Area

**Portable Storage Additional Information Sheet**

Cylinder Size	Capacity in USWG	Quantity	Total Volume in USWG
# 420	123.9	N/A	
# 100	29.5	N/A	
# 40	11.75	N/A	
# 33.3	9.62	N/A	
# 30	8.8	N/A	
# 20	5.8	24	139.2
# 10	2.9	N/A	
# 5	1.5	N/A	
<b>Total Cylinder Capacity</b> N/A			

**Tanks Stored On-site Not Connected for Use**

Tank Size in USWG	Quantity	Total Volume in USWG
N/A	N/A	N/A
<b>Total Tank Capacity</b> N/A		

<b>Total Cylinder Capacity</b>	N/A
<b>Total Tank Capacity</b>	N/A
<b>Total Portable Capacity</b>	139.2 USWG

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**


Name of person completing this form (please print) Eugene J Manzie		Official Title Vice President	
Signature 		Telephone No. 807 468-4888	Date (dd-mm-yyyy) 22 Feb 2012

# SITE DIAGRAM


## LEGEND

Fire Extinguishers	O
Electrical Panels	EP
Man Holes	MH
Pump Emerg Shut Off	X
Gas Shut-off	**


Enlarged Unloading area




AA#3



Note:  
Above ground 3" welded unloading lines  
2" Double Wall Flexible Under ground product lines

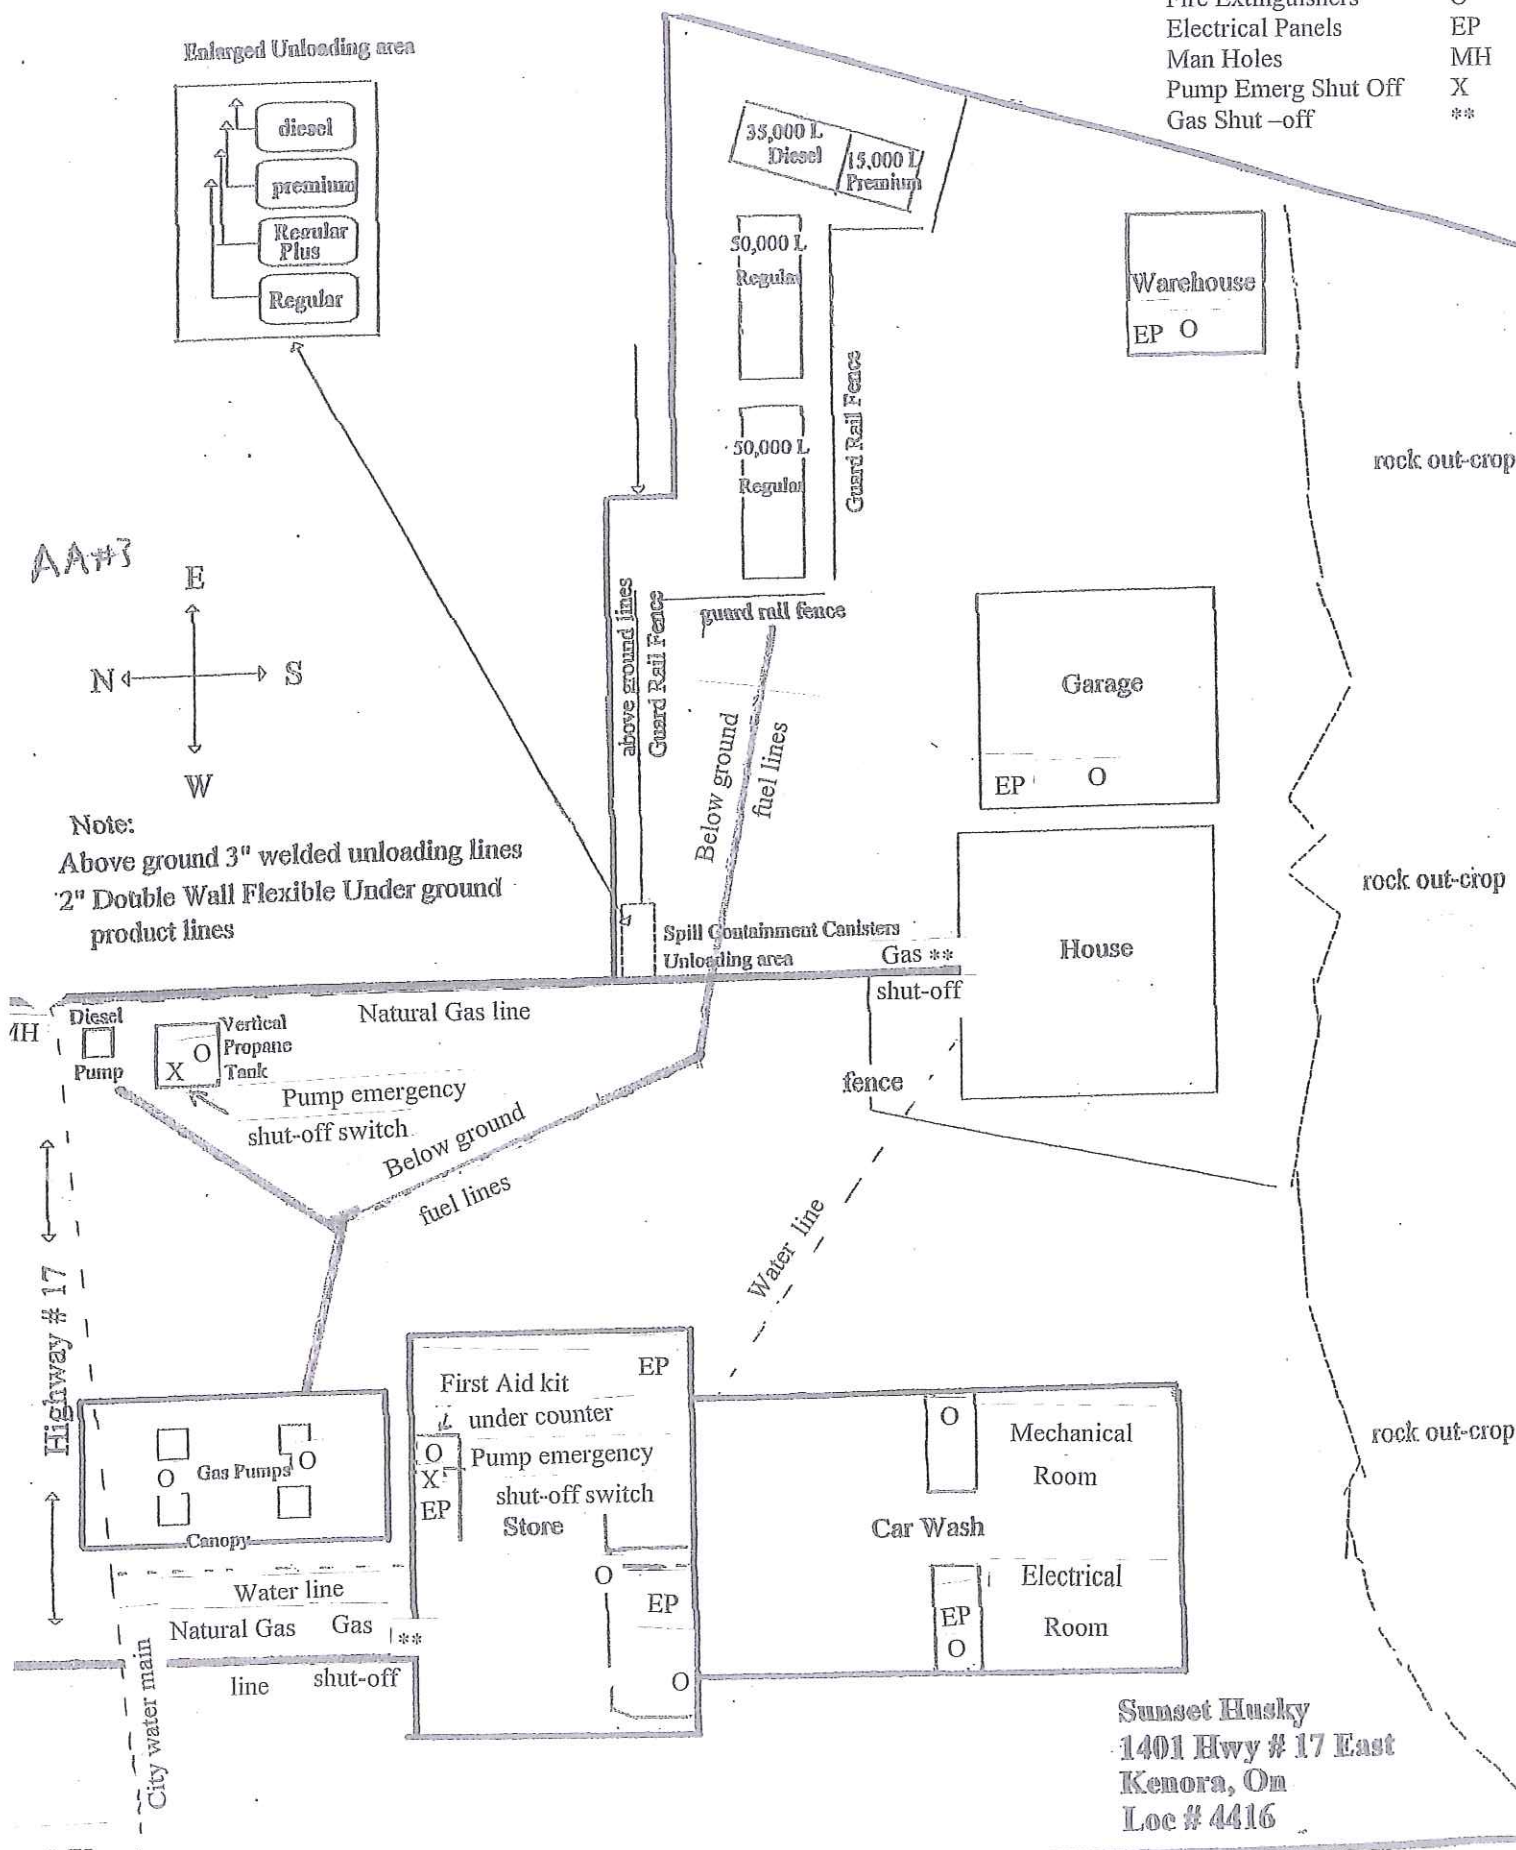

Sunset Husky  
1401 Hwy # 17 East  
Kenora, On  
Loc # 4416



Evacuation Assembly Area

MH



We're changing our privacy policy and terms. This stuff matters. To see all the details that are visible on the screen, use the "Print" link next to the map.



Location: 1401 Hwy 17E, Kenora, Ontario

Prepared: 29 January 2012

Tank setbacks: Front 14 m Right side 45m  
Rear 77m Leftside 4 m

Radius: 246 m

GPS Coordinates: lat: 49.759603 ; long: -94.468308

Municipality: City of Kenora

City Clerk: Joanne McMillin

Address: City Clerk's office, City Hall, 1 Main street, Kenora, Ontario P9N 3X2

Property line  
2000 USING vertical tank