



Technical Standards and Safety Authority
 www.tssa.org
 14th Floor - Centre Tower
 3300 Bloor Street West
 Toronto Ontario M8X 2X4
 Fax: 416.231.4903
 Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
 Propane Storage and Handling Regulation

May 24/14

This Level 1 RSMP applies to:

- a facility with a total propane storage capacity of 5,000 USWG or less; or
- a facility with a fixed propane storage capacity of exactly 5,000 USWG and no more than 500 USWG of portable propane storage capacity on site.

<p>Failure to fully complete this form may result in rejection. Making a false statement may result in a fine or prosecution under the <i>Technical Standards and Safety Act</i></p>	
Licence Number	000076643192
Check applicable type of propane operations. <input checked="" type="checkbox"/> Cylinder <input type="checkbox"/> Motor Fill <input type="checkbox"/> Filling Plant <input type="checkbox"/> Card/Keylock	
Submit along with this completed application a Facility Site Plan and a Map of the Surrounding Area.	

SECTION A: GENERAL INFORMATION

The Undersigned applies to TSSA for a review for an RSMP under Ontario's *Technical Standards and Safety Act*, Propane Storage and Handling Regulation.

Company Name		Ontario Corporation No., if applicable	
A	Veltri Canada - Howard Division	105507719RP0014	
Operator Name (if different from above)			
Telephone No.	Fax No.	E-mail	
519 258 3509	519 258 3238	jwhatley@flexngate.com	
B	Street Name / 911 Number / Address, if applicable		
1425	Howard Avenue		
Town / City or Township / County		Province	Postal Code
Windsor		Ontario	N8X 5C9
Mailing address if different from above.			
C	Street Name / 911 Number / Address, if applicable		
Town / City or Township / County		Province	Postal Code

Information on Container Refill Centre or Filling Plant			
Location of facility.			
D	Street No.	Street Name / 911 Number / Address, if applicable	Nearest Major Intersection
	1425	Howard Avenue	Shepherd St.
Town / City or Township / County		Province	Postal Code
Windsor		Ontario	N8X 5C9

Name of Licence Holder	
Veltri Canada - Howard Division	
Name of a Senior Management person as defined in the regulation holding the Record of Training (ROT).	ROT type
David Ekblad	OPA (PPO-3)
Municipality (or municipalities if the facility or its hazard distance touches multiple borders)	
Windsor, Ontario	
Hours of operation.	

This document is valid until the next licence renewal date. You are required by law to notify TSSA of any change of information.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Print name	Signature	Date (dd-mm-yyyy)
Name of Licence Holder Veltri Canada - Howard Division		29-03-2011
Name of Senior Management person as defined in the Regulation holding the Record of Training Dave Ekblad		



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION A: GENERAL INFORMATION (cont'd)


Indicate the year the facility was established. January 2006	Indicate the year of any significant modifications, as defined in s.1, O.Reg 211/01, since establishment. None
---	---

Identify the psig rating and serial number for each fixed propane storage tank on site.

	PSIG	Serial Number
Tank 1:	250	921-04
Tank 2:	_____	_____
Tank 3:	_____	_____

Enter capacity of propane in USWG, fixed, portable, and mobile, and provide detailed inventory that includes the number of tank/vessel for each type (fixed, portable, and mobile) and the capacity of each tank/vessel, on a separate document.

Fixed: 2000 USWG Portable: _____ Mobile: _____



Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) John Whatley	Official Title Environmental Health & Safety Facilitator	
Signature 	Telephone No. 519 903 7818	Date (dd-mm-yyyy), 29/03/2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION A: GENERAL INFORMATION (cont'd)
Activity Information

Name of Propane Supplier(s) Aabco Propane Inc.		For Office Use - Partv No. [REDACTED]	
Street No. 5475	Street Name / 911 Number / Address, if applicable DiCocco Court		
Town / City or Township / Country Oldcastle		Province Ontario	Postal Code N0R 1L0
Telephone No. 519-737-9635	Fax No. 519-737-9137	Contact Name Andy Burton	
E-mail info@aabcopropane.com			

Name of Propane Transporter. If same as above, please check box. <input checked="" type="checkbox"/>		For Office Use - Partv No. [REDACTED]	
Street No.	Street Name / 911 Number / Address, if applicable		
Town / City or Township / Country		Province	Postal Code
Telephone No.	Fax No.	Contact Name	
E-mail			

Off-site Cylinder and/or Mobile Storage	Capacity stored off-site, in USWG	For Office Use - Party No.	
Street No.	Street Name / 911 Number / Address, if applicable		
Town / City or Township / Country		Province	Postal Code
Telephone No.	Fax No.	Contact Name	

Note: Customer storage is not considered off-site storage.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) John Whatley	Official Title Environmental Health & Safety Facilitator
Signature 	Telephone No. 519 903 7818
	Date (dd-mm-yyyy) 29/03/2011



Technical Standards and Safety Authority
www.issa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN

The licence holder will complete Section B in consultation with the local Fire Services.

Description of the maximum volume, types and storage location of other hazardous materials on site, if any.

Compressed Gas Storage Area Containing:

OXYGEN 6.9 M3 CYLINDER - Max 5	ACETYLENE 3.4 M3 CYLINDER - Max 5
ARGOSHIELD 15.93 M3 CYLINDER - Max 3	ARGON 15.06 M3 CYLINDER - Max 4
ARGOSHIELD BULK PACK 254.92 M3 - Max 3	NITROGEN 4500 PSI 13OZ M3 CYLINDER - Max 8

Description of fire and emergency equipment indicated on facility site map.

Fire Suppression Systems

Fire Extinguishers with monthly inspection

Fire Hydrants (Municipal) (Hydrants have been painted blue indicating a sufficient flow rate)

List of fire protection controls (e.g., fire detection systems, fire notification systems, alarm systems, automatic shut off devices, fusible links, etc.) and describe their function, use and operation.

Fire Alarms

Emergency Exit Lighting

Maintenance and testing schedule for fire protection controls and devices.

Monthly inspection of fire extinguishers

Yearly inspection of fire alarm

Monthly inspections of exit signs and emergency lighting

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) John Whatley	Official Title Environmental Health & Safety Facilitator
Signature 	Telephone No. 519 903 7818
	Date (dd-mm-yyyy) 29/03/2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

1. Contacts for Emergency Response

1. Facility Contact Personnel - Key Contact		5. Facility 24-Hour Contact Person	
Name Darin Anger	For Office Use - Party No.	Name Darin Anger	For Office Use - Party No.
Official Title Manufacturing Manager		Official Title Manufacturing Manager	
Telephone No. 519 562 0153	Fax No. 519 258 3238	Cell No. 519 562 0153	Fax No. 519 258 3238
E-mail danger@veltrimetal.com		E-mail danger@veltrimetal.com	
Role and responsibilities in emergency Emergency Coordinator		Role and responsibilities in emergency Emergency Coordinator	
2. Facility Contact Personnel - Alternate Contact		6. Name of Facility Manager	
Name Dan Bondy	For Office Use - Party No.	Name Roger Verschuire	For Office Use - Party No.
Official Title Maintenance Manager		Official Title General Manager	
Telephone No. 519 562 1403	Fax No. 519 258 3238	Telephone No. 519 670 3747	Fax No. 518 258 3238
E-mail dbondy@veltrimetal.com		E-mail rverschuire@veltrimetal.com	
Role and responsibilities in emergency Assists Emergency Coordinator		Role and responsibilities in emergency Assists Emergency Coordinators and provides necessary financial support	
3. Local Fire Services - Key Contact		7. Propane Supplier Key Contact Person	
Name Tim Dennis	For Office Use - Party No.	Name Andy Burton	For Office Use - Party No.
Official Title Assistant Chief Fire and Rescue		Official Title Owner	
Telephone No. (519) 253-6573 (Ext. 240)	Fax No. (519) 255-6832	Telephone No. 519-737-9635	Fax No. 519 737 9137
E-mail tdennis@city.windsor.on.ca		E-mail a.burton@aabco.com	
Role and responsibilities in emergency Notify and protect public safety		Role and responsibilities in emergency Provides on-going maintenance and support for	
4. Local Fire Services - Alternate Contact		8. Municipal Contact	
Name Steve Laforet	For Office Use - Party No.	Name Valerie Critchley	For Office Use - Party No.
Official Title Deputy Chief Fire and Rescue		Official Title City Clerk/Licence Commissioner	
Telephone No. (519) 253-6573 (Ext. 253)	Fax No. (519) 255-6832	Telephone No. 519-255-6222 ext. 6434	Fax No. 519-255-6868
E-mail slaforet@city.windsor.on.ca		E-mail vcritchley@city.windsor.on.ca	
Role and responsibilities in emergency Notify and protect public safety		Municipality Windsor, Ontario	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) John Whatley	Official Title Environmental Health & Safety Facilitator
Signature 	Telephone No. 519 903 7818
	Date (dd-mm-yyyy) 20-05-2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

1. Contacts for Emergency Response

1. Facility Contact Personnel - Key Contact		5. Facility 24-Hour Contact Person	
Name Darin Anger	For Office Use - Party No.	Name Darin Anger	For Office Use - Party No.
Official Title Manufacturing Manager		Official Title Manufacturing Manager	
Telephone No. 519 562 0153	Fax No. 519 258 3238	Cell No. 519 562 0153	Fax No. 519 258 3238
E-mail danger@veltrimetal.com		E-mail danger@veltrimetal.com	
Role and responsibilities in emergency Emergency Coordinator		Role and responsibilities in emergency Emergency Coordinator	
2. Facility Contact Personnel - Alternate Contact		6. Name of Facility Manager	
Name Dan Bondy	For Office Use - Party No.	Name Randall Dunn	For Office Use - Party No.
Official Title Maintenance Manager		Official Title General Manager	
Telephone No. 519 562 1403	Fax No. 519 258 3238	Telephone No. 519 903 3340	Fax No. 518 258 3238
E-mail dbondy@veltrimetal.com		E-mail rdunn@veltrimetal.com	
Role and responsibilities in emergency Assists Emergency Coordinator		Role and responsibilities in emergency Assists Emergency Coordinators and provides necessary financial support	
3. Local Fire Services - Key Contact		7. Propane Supplier Key Contact Person	
Name Tim Dennis	For Office Use - Party No.	Name Andy Burton	For Office Use - Party No.
Official Title Assistant Chief Fire and Rescue		Official Title Owner	
Telephone No. (519) 253-6573 (Ext. 240)	Fax No. (519) 255-6832	Telephone No. 519-737-9635	Fax No. 519 737 9137
E-mail tdennis@city.windsor.on.ca		E-mail a.burton@aabco.com	
Role and responsibilities in emergency Notify and protect public safety		Role and responsibilities in emergency Provides on-going maintenance and support for	
4. Local Fire Services - Alternate Contact		8. Municipal Contact	
Name Steve Laforet	For Office Use - Party No.	Name	For Office Use - Party No.
Official Title Deputy Chief Fire and Rescue		Official Title	
Telephone No. (519) 253-6573 (Ext. 253)	Fax No. (519) 255-6832	Telephone No.	Fax No.
E-mail slaforet@city.windsor.on.ca		E-mail	
Role and responsibilities in emergency Notify and protect public safety		Municipality	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) John Whatley	Official Title Environmental Health & Safety Facilitator
Signature 	Telephone No. 519 903 7818
	Date (dd-mm-yyyy) 28/03/2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

2. Additional Safety Measures

Describe any other measures in place at the facility that exceed the minimum Code and Standards requirements.

See attached Emergency Plan

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) John Whatley		Official Title Environmental Health & Safety Facilitator	
Signature 		Telephone No. 519 903 7818	Date (dd-mm-yyyy) 28/03/2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

3. Record of Emergency Training Provided - For most recent 12-month period.

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Training Date (dd-mm-yyyy) 30/01/11	Print Name of Training Provider: Veltri Canada - Howard Division
	Print Name of Instructor: John Whatley
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Training on the facility's Emergency Management Procedures provided to staff.

Training Date (dd-mm-yyyy) 15/09/10	Print Name of Training Provider: Veltri Canada - Howard Division
	Print Name of Instructor: John Whatley
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

On-site specific training provided to certificate holders / persons with Records of Training.

Training Date (dd-mm-yyyy) 18/02/2010	Print Name of Training Provider: Ontario Propane Association
	Print Name of Instructor: John Whatley
Training Date (dd-mm-yyyy) 101/04/2010	Print Name of Training Provider: Ontario Propane Association
	Print Name of Instructor: John Whatley
Training Date (dd-mm-yyyy) 29/04/2010	Print Name of Training Provider: Ontario Propane Association
	Print Name of Instructor: John Whatley

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) John Whatley	Official Title Environmental Health & Safety Facilitator
Signature 	Telephone No. 519 903 7818
	Date (dd-mm-yyyy) 28/03/2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

4. Emergency Training Plan for Coming Year

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Target Date (dd-mm-yyyy) 01/12/2011	Print Name of Training Provider: Veltri Canada - Howard Division
	Print Name of Instructor: John Whatley
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Training on the facility's Emergency Management Procedures provided to staff.

Target Date (dd-mm-yyyy) 09/09/2011	Print Name of Training Provider: Supervisors
	Print Name of Instructor: Veltri Canada - Howard Division
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

On-site specific training provided to certificate holders / persons with Records of Training.

Target Date (dd-mm-yyyy) 10/10/2011	Print Name of Training Provider: Ontario Propane Association
	Print Name of Instructor: John Whatley
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) John Whatley	Official Title Environmental Health & Safety Facilitator
Signature 	Telephone No. 519 903 7818
	Date (dd-mm-yyyy) 28/03/2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

5. Emergency Response Communications Plan

Warnings and Actions

Describe who gives warnings to whom, and how and when the warning will be given (including public notification as appropriate). The Emergency Coordinator has the overall responsibility and authority to administer the Emergency Plan. The responsibilities of the Emergency Coordinator (or designate) are to: 1) Communicate with and notify the appropriate outside agencies to deal with and respond to emergency situations (e.g. fire and police departments, ambulance, etc.). 2) Assess the situation to determine whether or not it is necessary to activate emergency procedures, including evacuations. 3) Designate subordinate coordinators and assign responsibilities for emergency operations.

Describe what action is to be taken and by whom when a warning is issued (including details of a meeting place in a safe identified area and activating the evacuation plan, if necessary).

It is the responsibility of Departmental Managers and Supervisors to ensure that each worker is familiar with the emergency exits, evacuation routes and evacuation assembly area. They must account for each worker under their supervision and report this information to the Emergency Coordinator. The designated evacuation assembly area is located in the the west corner of the parking lot adjacent to Ellis Street and McDougall Avenue. Employee knowledge is assessed annually.

Communication with Emergency Response Authorities

Describe when and how the licence holder will give early warning to emergency response authorities (including a process to ensure that a call is placed to 911).

The Emergency Coordinator will communicate with and notify the appropriate outside agencies to deal with and respond to emergency situations (e.g. fire and police departments, ambulance, etc.).

The Emergency Coordinator will designate subordinate coordinators or team captains and assign responsibility for emergency situations in given areas.

Describe provisions for fire department entry when there are no operations or staffing at the propane site.

All emergency responders have access to the propane refill station located on the north side of the property. The property contains a perimeter fence that is locked when there is no one present at the facility. The lock will have to be cut off by fire officials.

Describe how the licence holder will ensure continual flow of updated information to authorities.

The Emergency Coordinator will communicate with and notify the the appropriate outside agencies to deal with and respond to emergency situations by dialing 911. In addition tonotifying outside agencies, The Emergency Coordinator must notify senior management and keep them informed of the status of the emergency situation. During afternoon or midnight shift operations, the Emergency Coordinator, where practical, will ensure prompt notification is communicated to the off-site Emergency Coordinator (Manufacturing Manager).

How long will it take the facility liaison person to respond to the site.

Within 15 minutes.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) John Whatley		Official Title Environmental Health & Safety Facilitator	
Signature 		Telephone No. 519 903 7818	Date (dd-mm-yyyy) 28/03/2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

6. Building and Site Security and Procedures

	Yes	No
1. Does the propane location have controlled access to limit unnecessary risk and entry (lock out procedures)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
2. Is there adequate night lighting at the site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
3. Are procedures in place that ensure access routes, aisles, storage area, filling areas and the grounds are kept clear from unwanted materials?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
4. Are there procedures that capture and record the daily inspection of hoses and inspection requirements for filling systems and mechanical devices used in the transfer of propane?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
5. Does the facility have procedures that include a process to isolate and purge any overfilled propane cylinders?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
6. Are weighing systems validated for accuracy?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
7. Are storage areas clearly marked with the vessels' capacity status (i.e., filled, empty, purged and other hazardous materials)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
8. Are quality assurance procedures in place to ensure that all valves are closed after the propane cylinders are filled?(e.g., QCC valves)	<input checked="" type="checkbox"/>	<input type="checkbox"/>
9. Is the schedule of maintenance and testing activities retained on site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>

7. Water Supply

The propane licence holder should work with the local fire department to determine water supply capabilities that are available based on the propane facility's location.

	Yes	No
1. Is a pressurized water system available at the propane facility site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
2. Can the municipal fire department pump 375 GPM (1420 LPM) of water at this location?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
3. What is the unobstructed distance to the closest water supply that could be used for firefighting activities? (distance in metres only)		<u>60 meters</u>
4. What is the unobstructed distance to the closest approved water supply with year round access if there are no hydrants? (distance in metres only)		<u>N/A</u>

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) John Whatley	Official Title Environmental Health & Safety Facilitator	
Signature 	Telephone No. 519 903 7818	Date (dd-mm-yyyy) 28/03/2011



Technical Standards and Safety Authority
 www.tssa.org
 14th Floor - Centre Tower
 3300 Bloor Street West
 Toronto Ontario M8X 2X4
 Fax: 416.231.4903
 Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
 Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

8. Licence holder and local Fire Services Review

To be completed by the Local Fire Services

Has the local fire service had an opportunity to review the Emergency Response and Preparedness Plan?

Yes No

If not, please explain (e.g., no fire services).

Fire services comments, if any:

To be completed by the Licence Holder

In response to the above comments, the following action(s) is required:

The licence holder will respond to the Local Fire Services comments by: _____
 (dd-mm-yyyy)

LOCAL FIRE SERVICES

The undersigned has reviewed Section B of the Risk and Safety Management Plan Fire Services

Print name	Signature	Date (dd-mm-yyyy)
Local Fire Services Name JOHN SMITH FIRE PREVENTION OFFICER		MARCH 30 / 2011

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) John Whatley	Official Title Environmental Health & Safety Facilitator
Signature	Telephone No. 519 903 7818
	Date (dd-mm-yyyy) 28/03/2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS

Applicant must include a Facility Site Plan and Map of Surrounding Area

Facility Site Plan.

The licence holder will submit a copy of the original facility site plan updated with the following information:

1. The storage location of fixed, portable, and mobile vessels.
2. The maximum volume, types and storage location of hazardous materials.
3. Location of permanent structures on site.
4. Access and egress points and location of barriers.
5. Location of fire and emergency equipment (e.g., sprinkler systems, extinguishers, suppression systems) on site and location of fire hydrant or water supply where available.
6. Location of emergency shut off/shut down switches/valves.

Map of Surrounding Area.

The licence holder will submit a scaled aerial map of the surrounding area showing the following information:

7. The capacity and placement of the single largest propane storage vessel, including its setback from the front, rear and side property lines.
8. GPS co-ordinates of the single largest vessel.
9. Visual indication of the single largest fixed vessel and a circle made using the distance in Table 1 as the radius from the single largest fixed vessel.
10. Clear indication of the municipality or municipalities present within the circle.
11. Visual indication of property line information.
12. The location and name of roads within or abutting the site.
13. Key note to the drawing indicating the facility's municipal address, municipal lot number(s) and concession lines as applicable, and the date the map was prepared.
14. Address and contact information for each municipality (municipal clerk or secretary-treasurers of planning board). (Refer to page 5.)
15. Complete "Required Mapping Information from Updated Site Plan" in table below.

Required Mapping Information from Updated Site Plan

Date Map Prepared (dd-mm-yyyy) 05/02/2011	Capacity of single largest propane storage vessel (USWG) 2,000
Tank setback coordinates. Indicate placement on the map.	
Front: 163 _____	Right side property line: 110 _____
Rear: 135 _____	Left side property line: 44 _____
GPS coordinates of single largest vessel: 42DEG 18' 12.64" N, 83 DEG 01' 22W	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) John Whatley	Official Title Environmental Health & Safety Facilitator
Signature 	Telephone No. 519 903 7818
	Date (dd-mm-yyyy) 28/03/2011



Technical Standards and Safety Authority

www.tssa.org

14th Floor - Centre Tower
 3300 Bloor Street West
 Toronto Ontario M8X 2X4
 Fax: 416.231.4903
 Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
 Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)

Applicant must include a Facility Site Plan and Map of Surrounding Area


Table 1: Distance Table

Water Capacity (litres)	Nominal Water Capacity (USWG)	Distance to 1 psi overpressure (m)
1,890	500	155
3,780	1,000	195
4,920	1,300	213
6,620	1,750	235
7,130	1,885	241
7,560	2,000	246
18,900	5,000	333

Formula: $D = 16.94 \times (1.524 \times C)^{1/3}$
 D = Distance to overpressure of 1 psi (meters)
 C = Tank Total Capacity in USWG

Parameters: Density of Propane is 0.5033 kg per litre @ 15 C
 Assume all vessels are 80% full
 1 gallon [US, liquid] = 0.003785411784 cubic meter
 1 cubic metre = 264.17 USWG

Hazard Distance Chart (EPA-TNT model)

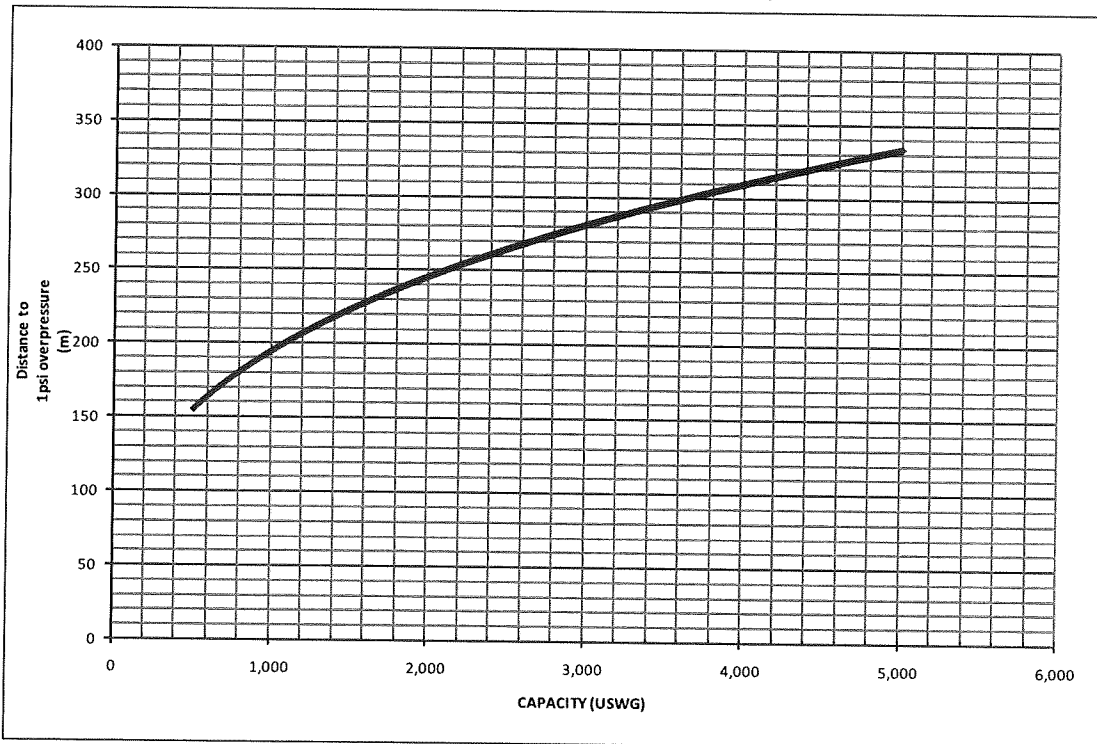

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) John Whatley		Official Title Environmental Health & Safety Facilitator	
Signature 		Telephone No. 519 903 7818	Date (dd-mm-yyyy) 28/03/2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)

Applicant must include a Facility Site Plan and Map of Surrounding Area

As an accompaniment to the Map of Surrounding Area, provide the following information about buildings and features present within the circle in Table 2.

Table 2: Buildings and Features

Buildings and Features Present within the Circle on the Map of the Surrounding Area AND Name and Address of Closest Building or Feature	* Number of Buildings and Features (mark with an "X")				Distance from Tank to Closest Building or Feature
	0	1	2-10	11+	
Industrial buildings or parks or golf courses Name: Emrick Plastics Address: 310 Ellis St E. City: Windsor Province Ontario Postal Code N8X 2H2			x		90 m
Residential building units specifically permanent single family dwellings, condominiums, and apartments [Redacted]				x	180 m
Commercial building units specifically retail, restaurants, entertainment, theatres, and sporting complexes. Name: Depaoli Studio Address: 1441 McDougall City: Windsor Province Ontario Postal Code N8X 3M8			x		145 m
Commercial building units – continuous occupancy specifically hotels, campgrounds, and resorts. Name: _____ Address: _____ City: _____ Province _____ Postal Code _____	x				_____ m
Sensitive institutions specifically hospitals, schools and day cares, nursing and retirement homes, mental health institutions, and prisons. Name: _____ Address: _____ City: _____ Province _____ Postal Code _____	x				_____ m
Emergency responders specifically fire stations, ambulance stations, and police stations. Name: _____ Address: _____ City: _____ Province _____ Postal Code _____	x				_____ m

* For multi-unit buildings, count each unit as "1".

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) John Whatley	Official Title Environmental Health & Safety Facilitator
Signature 	Telephone No. 519 903 7818
	Date (dd-mm-yyyy) 28/03/2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)
Applicant must include a Facility Site Plan and Map of Surrounding Area

Portable Storage Additional Information Sheet

Cylinder Size	Capacity in USWG	Quantity	Total Volume in USWG
# 420	123.9		
# 100	29.5	3	88.5
# 40	11.75		
# 33.3	9.62	64	615.68
# 30	8.8		
# 20	5.8		
# 10	2.9		
# 5	1.5		
Total Cylinder Capacity 704.18 USWG			

Tanks Stored On-site Not Connected for Use


Tank Size In USWG	Quantity	Total Volume in USWG
Total Tank Capacity		

Total Cylinder Capacity	
Total Tank Capacity	2000 USWG
Total Portable Capacity	704.18 USWG

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.


Name of person completing this form (please print) John Whatley	Official Title Environmental Health & Safety Facilitator		
Signature 	<table style="width: 100%; border: none;"> <tr> <td style="width: 70%;"> Telephone No. 519 903 7818 </td> <td style="width: 30%;"> Date (dd-mm-yyyy) 20-05-2011 </td> </tr> </table>	Telephone No. 519 903 7818	Date (dd-mm-yyyy) 20-05-2011
Telephone No. 519 903 7818	Date (dd-mm-yyyy) 20-05-2011		

Veltri Canada - Howard Division Surrounding Area Map

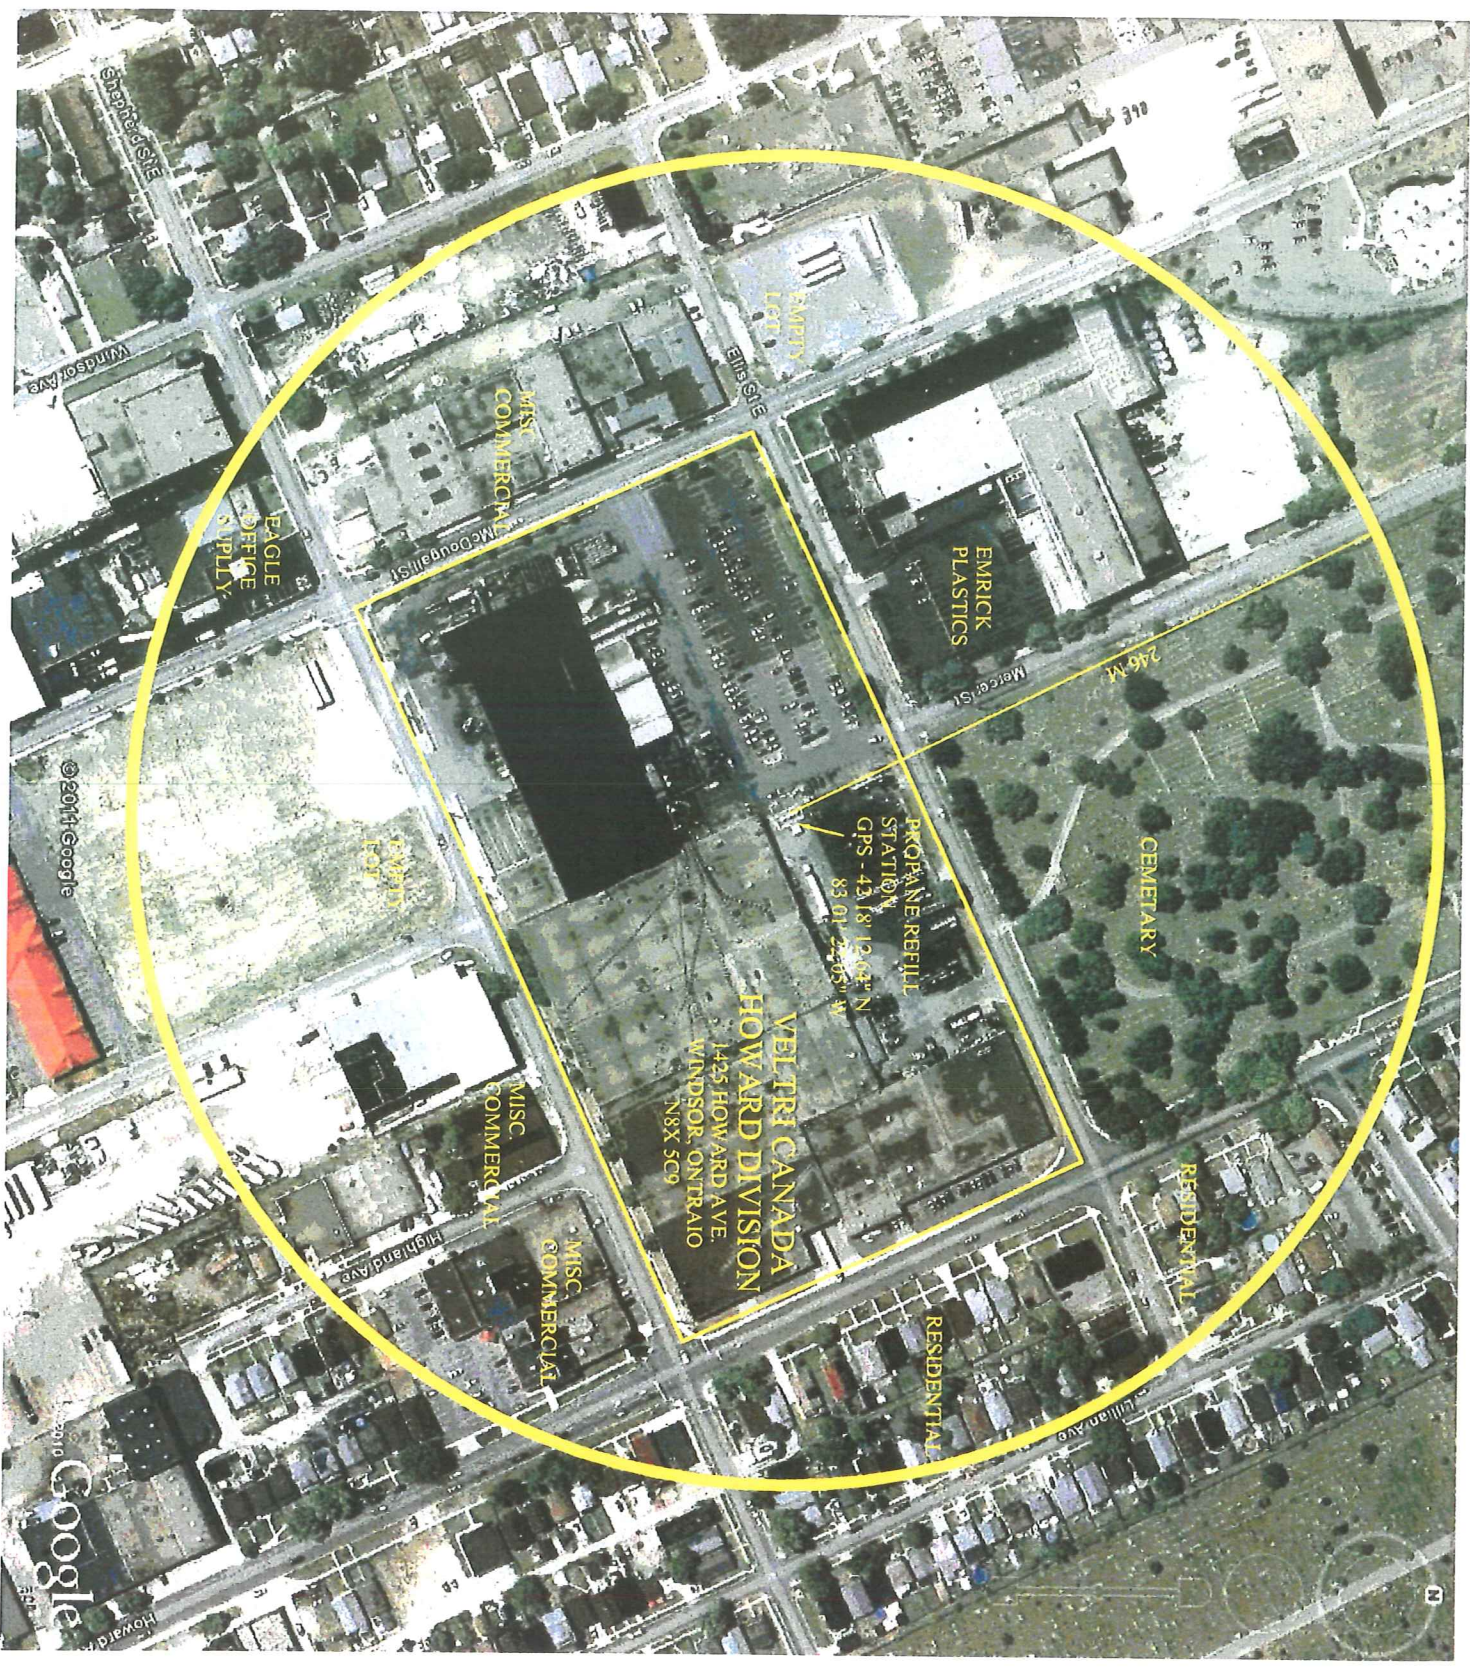


Veltri Canada - Howard Division - Fire Extinguishing Equipment

November 8, 2010

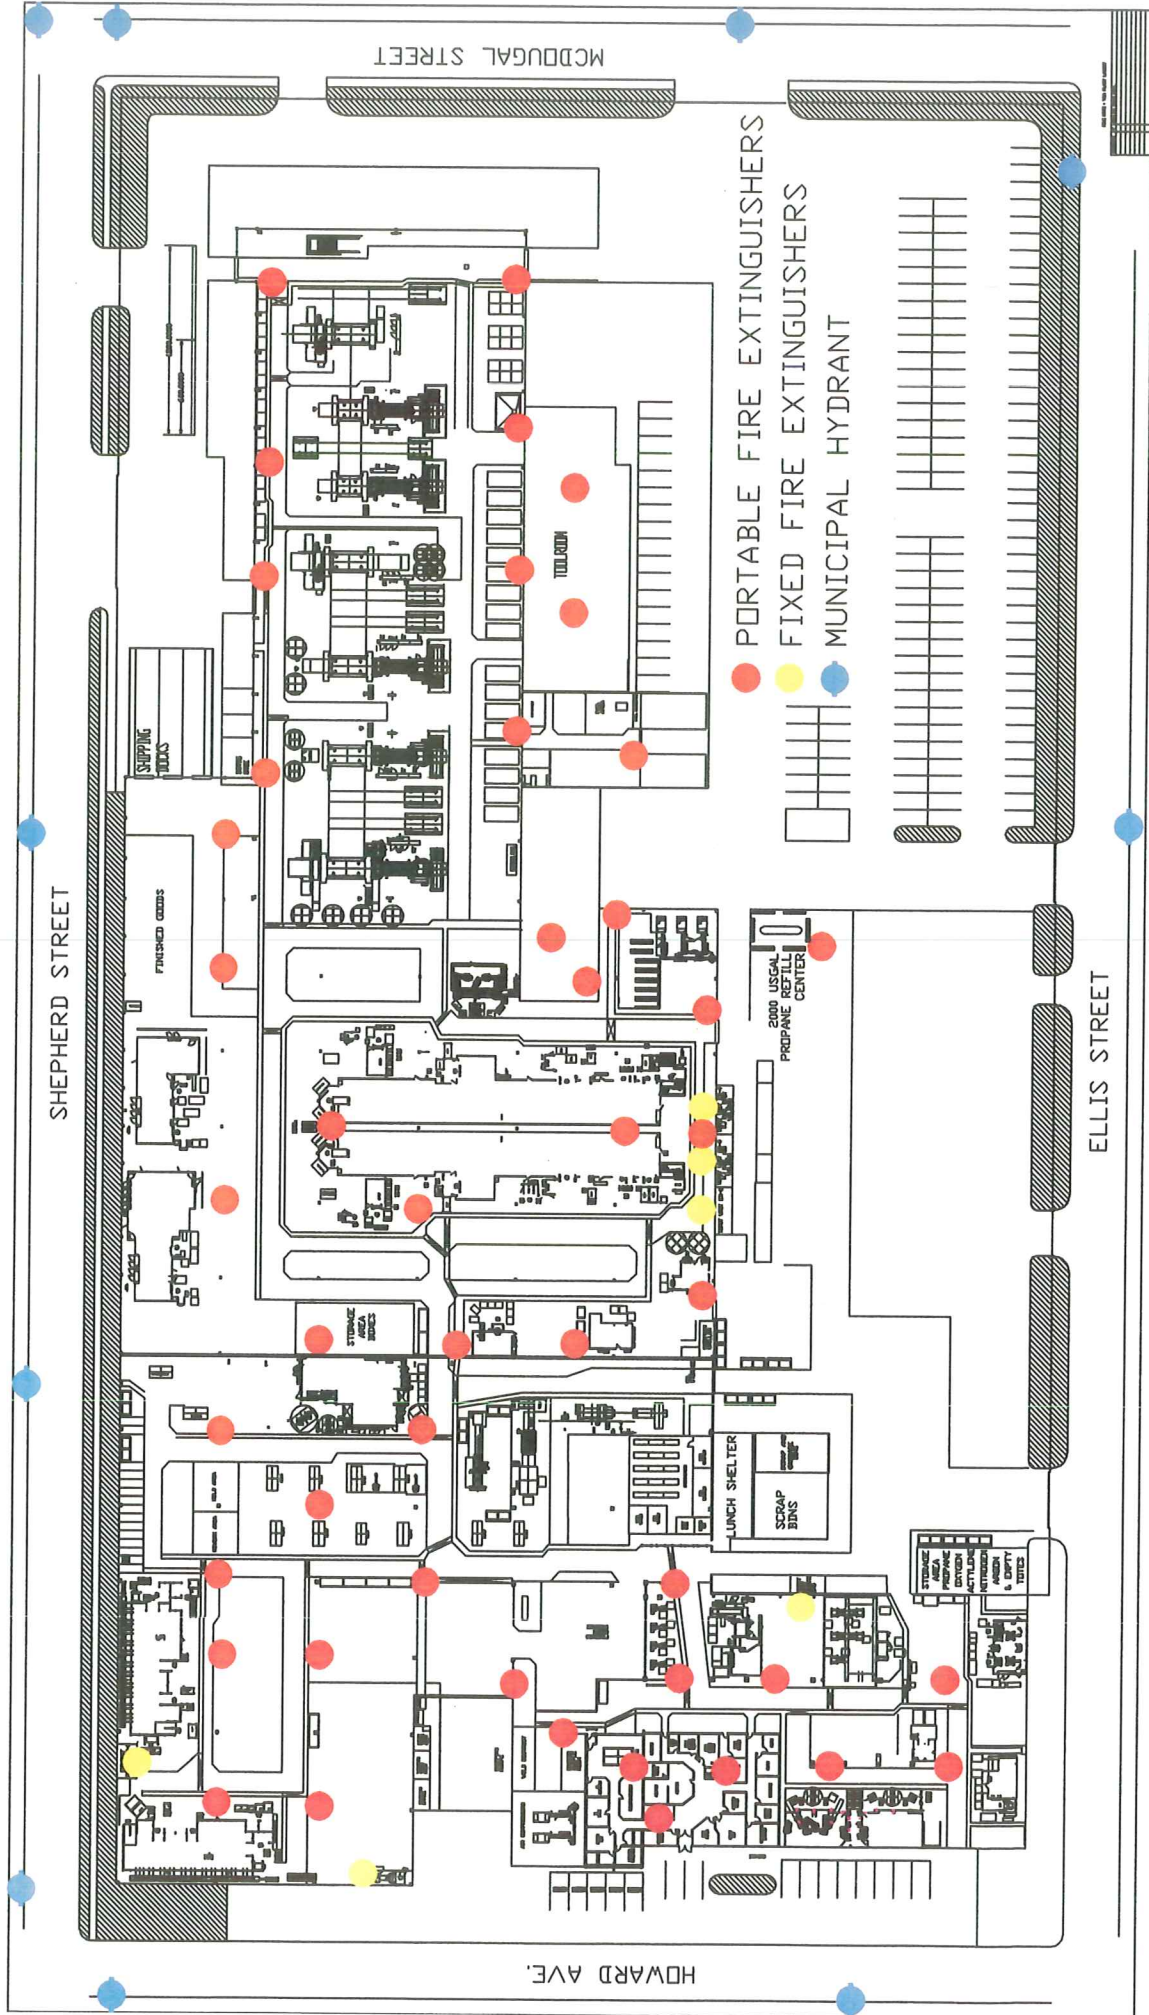

Veltri Canada - Howard Division - Emergency Exits and Utility Disconnects

November 8, 2010

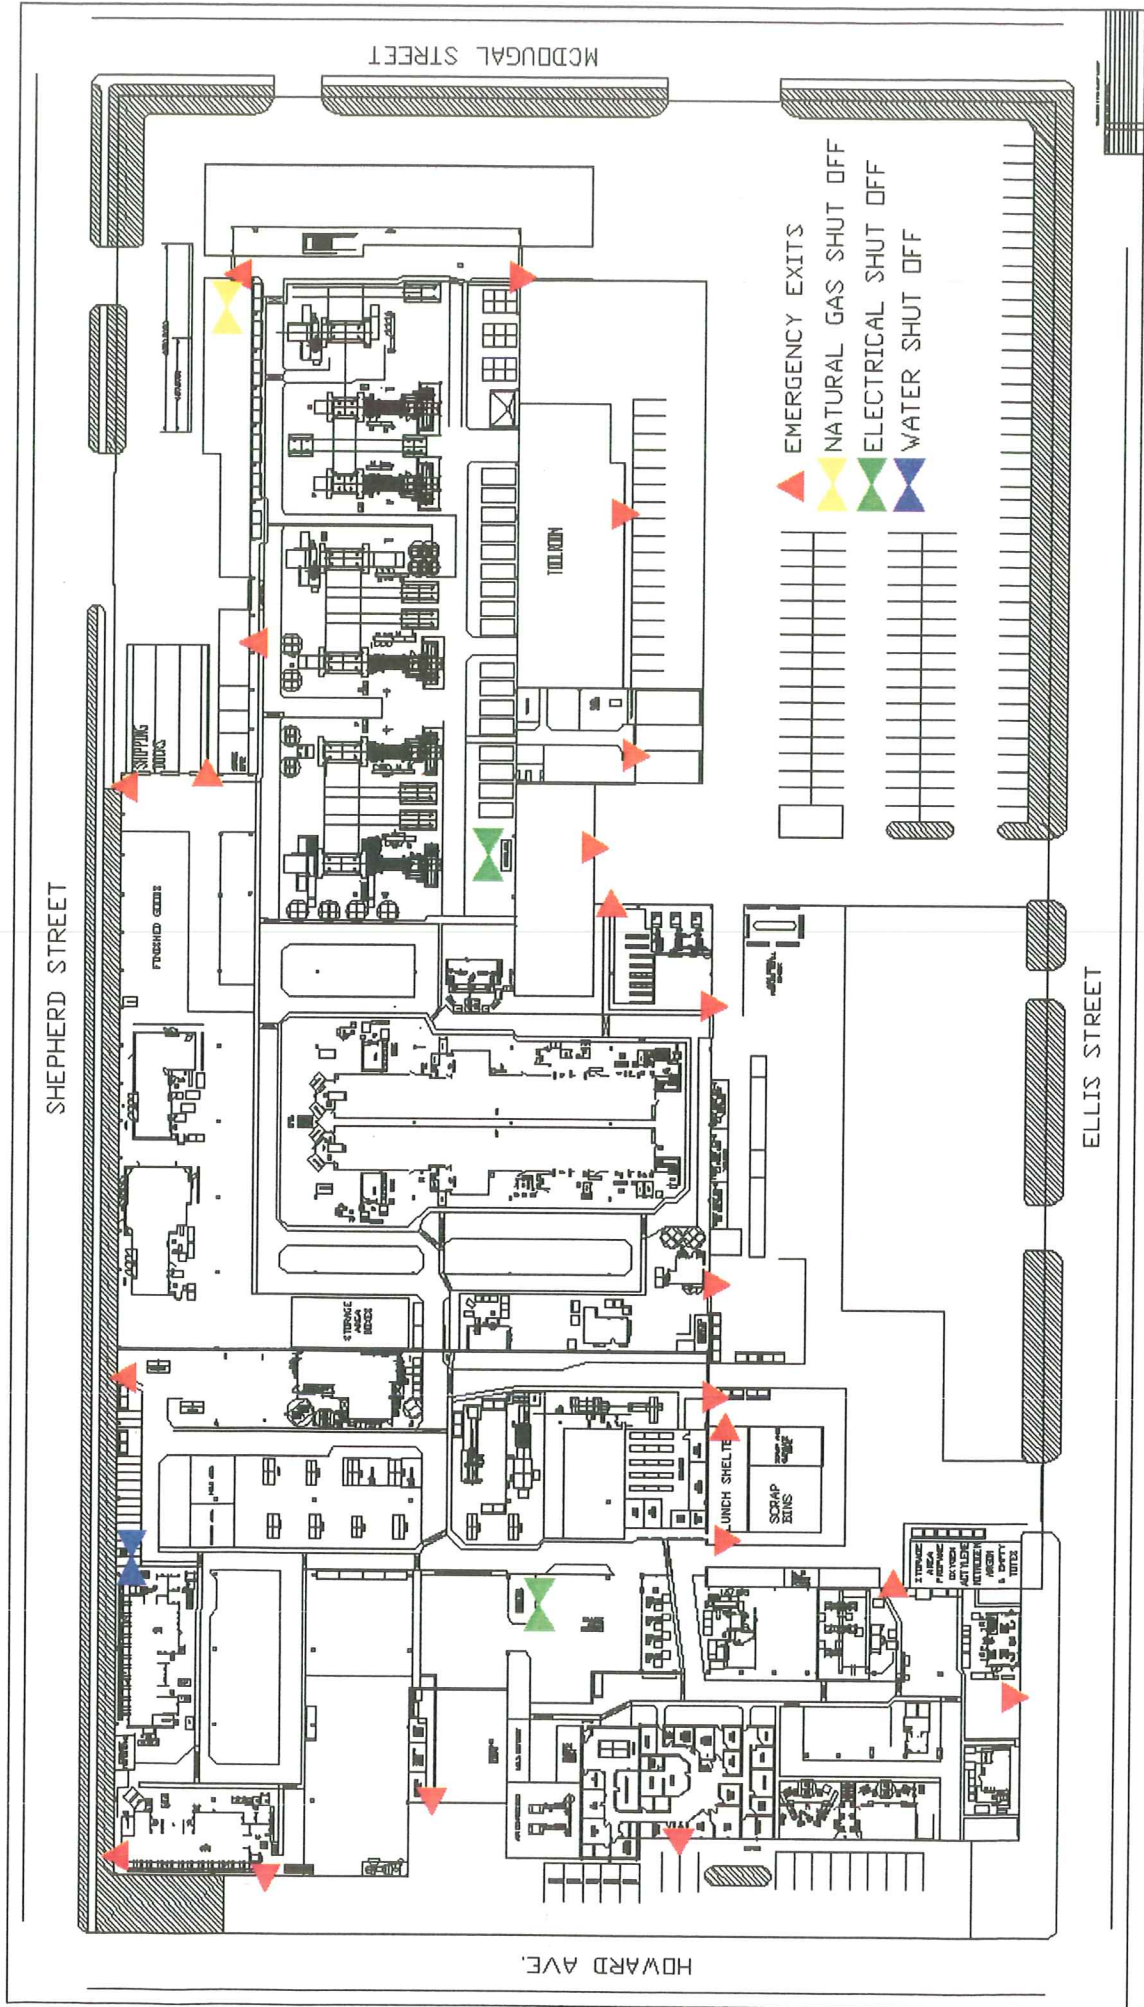



PROPANE
EXCEPTIONAL ENERGY

11 - 1155 North Service Rd. W.
Oakville, Ontario
L6M 3E3
Phone: (905) 469-1941
Fax: (905) 469-1942
Email: opa@propane.ca
Website: www.propane.ca

ROT # 74731 Expiry Date: April 30, 2013
Ontario Propane Association
certifies that:

David Ekblad
has successfully completed recognized training programs for
Filling Forklift Propane Cylinders (PPO-3)

74731 David Ekblad
Flex-N-Gate Canada Co
538 Blanchard Park
Tecumseh Ontario
N8N 2L9



TSSA Accreditation #TTT 000150208

If your address has changed please return this portion only, with your new address.

Remove card and carry with you at all times.

Ontario Propane Association

11 - 1155 North Service Rd. W.
Oakville, Ontario
L6M 3E3
Phone: (905) 469-1941

You are required to notify the Ontario Propane Association
of any change in address or name, and for replacement
of any lost, stolen or destroyed certificate.