



Technical Standards and Safety Authority
 www.tssa.org
 14th Floor - Centre Tower
 3300 Bloor Street West
 Toronto Ontario M8X 2X4
 Fax: 416.231.4903
 Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
 Propane Storage and Handling Regulation

- This Level 1 RSMP applies to:
- a facility with a total propane storage capacity of 5,000 USWG or less; or
 - a facility with a fixed propane storage capacity of exactly 5,000 USWG and no more than 500 USWG of portable propane storage capacity on site.

Failure to fully complete this form may result in rejection.
 Making a false statement may result in a fine or prosecution under the *Technical Standards and Safety Act*


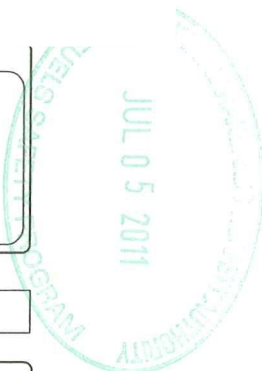
Licence Number 0032529001-C

Check applicable type of propane operations.

Cylinder Motor Fill Filling Plant Card/Keylock

Submit along with this completed application a Facility Site Plan and a Map of the Surrounding Area.

For Office Use Only

SECTION A: GENERAL INFORMATION

The Undersigned applies to TSSA for a review for an RSMP under Ontario's *Technical Standards and Safety Act*, Propane Storage and Handling Regulation.

Company Name Ruston RV Centre Limited Ontario Corporation No., if applicable _____

Operator Name (if different from above) Rob Sneyd

Telephone No. 905-525-8400 Fax No. 905-523-8444 E-mail rob.sneyd@rustonrv.com

Street No. 1428 Street Name / 911 Number / Address, if applicable Plains Rd. West

Town / City or Township / County Burlington Province On Postal Code L7T 1H6

Mailing address if different from above.

Street No. _____ Street Name / 911 Number / Address, if applicable _____

Town / City or Township / County _____ Province _____ Postal Code _____

Information on Container Refill Centre or Filling Plant

Location of facility.


Street No. 1428 Street Name / 911 Number / Address, if applicable Plains Rd Nearest Major Intersection _____

Town / City or Township / County Burlington Province On Postal Code L7T 1H6

Name of Licence Holder Rob Sneyd


Name of a Senior Management person as defined in the regulation holding the Record of Training (ROT). Rob Sneyd ROT type 100-08-82085

Municipality (or municipalities if the facility or its hazard distance touches multiple borders) Halton Region



This document is valid until the next licence renewal date. You are required by law to notify TSSA of any change of information.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Print name	Signature	Date (dd-mm-yyyy)
Name of Licence Holder <u>Rob Sneyd</u>		<u>14/06/2011</u>
Name of Senior Management person as defined in the Regulation holding the Record of Training <u>Rob Sneyd</u>		



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

2012 Application for Renewal of Level 1 Propane Licence
Technical Standards and Safety Act
Propane Storage and Handling Regulation

CAPACITY INFORMATION

A. Fixed Tanks

	PSIG	Serial Number	Capacity
Tank 1:	250 PSIG	6975	1300 USWG
Tank 2:			
Tank 3:			
Total Fixed Capacity:			

B. Portable Storage

Cylinder Size	Capacity in USWG	Quantity	Total Capacity in USWG
# 420	123.9		
# 100	29.5		
# 40	11.75		
# 33.3	9.62		
# 30	8.8	25	220
# 20	5.8	10	58
# 10	2.9		
# 5	1.5		
Total Cylinder Capacity		Line A	

Tanks Stored On-site Not Connected for Use

Tank Size In USWG	Quantity	Total Capacity in USWG
	0	
	0	
Total Tank Capacity	Line B	

Total Portable Capacity. Line A plus Line B: 1578 USWG

C. Mobile Tanks

Type	Tank Size In USWG	Quantity	Total Capacity in USWG
Tankers		0	
Cargo Liners		0	
Total Mobile Tank Capacity			

You are required by law to notify TSSA of any change of information contained in the Risk and Safety Management Plan within 15 days.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Print name of person completing this form. <u>Rob Sneyd</u>		Official Title <u>COO</u>	
Signature 		Telephone No. <u>905 525 8400</u>	Date (dd-mm-yyyy) <u>24/11/11</u>



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION A: GENERAL INFORMATION (cont'd)

Activity Information

Name of Propane Supplier(s) Superior Propane - Ontario Regional Operations Centre		For Office Use - Party No. [REDACTED]	
Street No. 251	Street Name / 911 Number / Address, if applicable Woodlawn Road West, Unit 217		
Town / City or Township / Country Guelph		Province Ontario	Postal Code N1H 8J1
Telephone No. 1-877-873-7467	Fax No. 519-836-7766	Contact Name Mike Mullins	
E-mail mullinsm@superiorpropane.com			

Name of Propane Transporter. If same as above, please check box. <input type="checkbox"/>		For Office Use - Party No. [REDACTED]	
Superior Propane - Smithville			
Street No. 3089	Street Name / 911 Number / Address, if applicable Regional Rd. 12		
Town / City or Township / Country Smithville		Province ON	Postal Code LOR 2A0
Telephone No. 905-516-2301	Fax No.	Contact Name Tom Amies	
E-mail amies@superiorpropane.com			

Off-site Cylinder and/or Mobile Storage None		Capacity stored off-site, in USWG	For Office Use - Party No.
Street No. / Street Name / 911 Number / Address, if applicable			
Town / City or Township / Country		Province	Postal Code
Telephone No.	Fax No.	Contact Name	

Note: Customer storage is not considered off-site storage.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Rob Sneyd		Official Title COO	
Signature 	Telephone No. 905-525-8400	Date (dd-mm-yyyy) 14/06/2011	



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN

The licence holder will complete Section B in consultation with the local Fire Services.

Description of the maximum volume, types and storage location of other hazardous materials on site, if any.

Gasoline - 500 gallons - stored 20 feet from propane dispenser

Diesel - 240 USWG stored 20 feet from propane dispenser

Description of fire and emergency equipment indicated on facility site map.

Fire Extinguisher Type: BC

1. located at fill station

2. Inside shop door

List of fire protection controls (e.g., fire detection systems, fire notification systems, alarm systems, automatic shut off devices, fusible links, etc.) and describe their function, use and operation.

1. E Stop is installed at S/W corner of shop

Maintenance and testing schedule for fire protection controls and devices.


Maintenance and testing is undertaken by Superior Propane according to Superior Propane's Maintenance Standard. Schedule for key equipment is:

1. Pumps (Pump every 3 months; Pump Motor: check belts monthly; grease motor every 6 months)

2. ISC Valves (test for closure every 6 months)

3. Storage tank Relief Valves - inspect every 2 years; replacement schedule as per provincial regulations.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Rob Sneyd	Official Title COO	
Signature 	Telephone No. 905-525-8400	Date (dd-mm-yyyy) 14/06/2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

1. Contacts for Emergency Response

1. Facility Contact Personnel - Key Contact

Name: Steve Sohm
For Office Use - Party No.

Official Title: Shop Foreman

Telephone No.: 905-525-9400
Fax No.: 905-523-8444

E-mail: steve@rustonrv.com

Role and responsibilities in emergency: Coordinate site response

5. Facility 24-Hour Contact Person

Name: Rob Sneyd
For Office Use - Party No.

Official Title: COO

Cell No.: 905-516-6166
Fax No.: 905-523-8444

E-mail: rob.sneyd@rustonrv.com

Role and responsibilities in emergency: Coordinate site response

2. Facility Contact Personnel - Alternate Contact

Name: Rob Sneyd
For Office Use - Party No.

Official Title: COO

Telephone No.: 905-525-8400
Fax No.: 905-523-8444

E-mail: rob.sneyd@rustonrv.com

Role and responsibilities in emergency: Coordinate site response if agent unavailable.

6. Name of Facility Manager

Name: Rob Sneyd
For Office Use - Party No.

Official Title: COO

Telephone No.: 905-525-8400
Fax No.: 905-523-8444

E-mail: rob.sneyd@rustonrv.com

Role and responsibilities in emergency: Coordinate site response

3. Local Fire Services - Key Contact

Name: Shane Mintz
For Office Use - Party No.

Official Title: Fire Chief

Telephone No.: 905-333-0772 ext 202
Fax No.

E-mail: mintzs@burlington.ca

Role and responsibilities in emergency: Coordinate/advise on Fire Service response. Liaise with police.

7. Propane Supplier Key Contact Person

Name: Superior Propane Hotline
For Office Use - Party No.

Official Title

Telephone No.: 1-877-873-7467
Fax No.

E-mail

Role and responsibilities in emergency: Identify and dispatch Superior Propane and or LPERGC emergency response personnel as required.

4. Local Fire Services - Alternate Contact

Name: Tony Bavota
For Office Use - Party No.

Official Title: Deputy Fire Chief

Telephone No.: 905-333-0772 ext. 227
Fax No.

E-mail: bavotat@burlington.ca

Role and responsibilities in emergency: Coordinate/advise on Fire Service response, Liase with police.

8. Municipal Contact

Name: Angela Morgan
For [REDACTED]

Official Title: City Clerk

Telephone No.: 905-335-7702,
Fax No.

E-mail: morgana@burlington.ca

Municipality: Halton

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print)

Rob Sneyd

Signature

Official Title

COO

Telephone No.

905-525-8400

Date (dd-mm-yyyy)

14/06/2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

2. Additional Safety Measures

Describe any other measures in place at the facility that exceed the minimum Code and Standards requirements.

Emergency Shut Off push button to shut down pump and close solenoid valve upstream of dispensing hoses.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print)	Official Title	
Rob Sneyd	COO	
Signature	Telephone No.	Date (dd-mm-yyyy)
	905-525-8400	14/06/2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

3. Record of Emergency Training Provided - For most recent 12-month period.

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Training Date (dd-mm-yyyy)	Print Name of Training Provider: <i>None</i>
	Print Name of Instructor:
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Training on the facility's Emergency Management Procedures provided to staff.

Training Date (dd-mm-yyyy)	Print Name of Training Provider: <i>None</i>
	Print Name of Instructor:
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

On-site specific training provided to certificate holders / persons with Records of Training.

Training Date (dd-mm-yyyy)	Print Name of Training Provider: <i>Propane Training Institute</i>	<i>Note: a ROT is valid for 3 years</i>
<i>29/04/2010</i>	Print Name of Instructor: <i>Unknown</i>	
Training Date (dd-mm-yyyy)	Print Name of Training Provider:	
	Print Name of Instructor:	
Training Date (dd-mm-yyyy)	Print Name of Training Provider:	
	Print Name of Instructor:	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print)	Official Title	
<i>Rob Sneyd</i>	<i>COO</i>	
Signature	Telephone No.	Date (dd-mm-yyyy)
	<i>905-525-8400</i>	<i>14/06/2011</i>



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

4. Emergency Training Plan for Coming Year

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Target Date (dd-mm-yyyy) Q4 2011	Print Name of Training Provider: Superior Propane or Alternate	Please Note - the course content is
	Print Name of Instructor: to be arranged	currently being developed by the TSSA
Target Date (dd-mm-yyyy)	Print Name of Training Provider:	and should be available for teaching in the
	Print Name of Instructor:	fourth quarter of this year
Target Date (dd-mm-yyyy)	Print Name of Training Provider:	
	Print Name of Instructor:	

Training on the facility's Emergency Management Procedures provided to staff.

Target Date (dd-mm-yyyy) Q4 2011	Print Name of Training Provider: Key Site Contact to train staff
	Print Name of Instructor: to be arranged
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

On-site specific training provided to certificate holders / persons with Records of Training.

Target Date (dd-mm-yyyy) As Required	Print Name of Training Provider: Superior Propane, FSN, or Alternate	Please Note - a ROT is valid for 3 years
	Print Name of Instructor: to be arranged	
Target Date (dd-mm-yyyy)	Print Name of Training Provider:	
	Print Name of Instructor:	
Target Date (dd-mm-yyyy)	Print Name of Training Provider:	
	Print Name of Instructor:	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Rob Sneyd	Official Title COO
Signature 	Telephone No. 905-525-8400
	Date (dd-mm-yyyy) 14/06/2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

5. Emergency Response Communications Plan

Warnings and Actions

Describe who gives warnings to whom, and how and when the warning will be given (including public notification as appropriate).

The operator or alternate will contact emergency services by calling 911 and will provide warnings outlined in the attached "Propane Emergency Response Procedures" card (to be posted on site and part of the employee training). If it is safe to do so this could involved advising neighbors to evacuate. The owner/operator may also contact Superior Propane via the emergency number identified in the ERP.

Describe what action is to be taken and by whom when a warning is issued (including details of a meeting place in a safe identified area and activating the evacuation plan, if necessary).

The owner/operator or alternate should first follow the actions in the ERP provided herein. Staged evacuation, if the release of propane cannot be stopped by cutting electrical power may be required. The initial muster location will be on Plains Road, at least 80 m from the site and away from a dispensing cloud. Subsequent evacuation instructions potentially up to the Hazard Distance to be provided by municipal emergency responders.

Communication with Emergency Response Authorities

Describe when and how the licence holder will give early warning to emergency response authorities (including a process to ensure that a call is placed to 911).

When the system is operational, a ROT person will be on duty and be in the propane tank area. They key contact or alternate will be implementing ER actions including notifying emergency responders. Calling 911 will occur immediately after any attempts to shut down the system.

When the system is not in operation, the ISC valve (main isolation valve) is closed and the propane system is unattended but shutdown. Any incidents involving the propane tank during such times will require the intervention of random, nearby individuals or staff.

Describe provisions for fire department entry when there are no operations or staffing at the propane site.

The propane tank system is located in a wide open area that is easily accessible

Describe how the licence holder will ensure continual flow of updated information to authorities.

The critical information required from the license holder is information on how to shut down the system and the fill level in the tank (if known)


Fill level is relevant from a time to BLEVE perspective (a nearby empty tank will BLEVE sooner than a full tank if there is fire impingement on the tank).

This information will be provided to the authorities by Rob Sneyd or Steve Sohm.

How long will it take the facility liaison person to respond to the site.

15 minutes

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Rob Sneyd	Official Title COO	
Signature 	Telephone No. 905-525-8400	Date (dd-mm-yyyy) 14/06/2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

6. Building and Site Security and Procedures

	Yes	No
1. Does the propane location have controlled access to limit unnecessary risk and entry (lock out procedures)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
2. Is there adequate night lighting at the site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
3. Are procedures in place that ensure access routes, aisles, storage area, filling areas and the grounds are kept clear from unwanted materials?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
4. Are there procedures that capture and record the daily inspection of hoses and inspection requirements for filling systems and mechanical devices used in the transfer of propane?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
5. Does the facility have procedures that include a process to isolate and purge any overfilled propane cylinders?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
6. Are weighing systems validated for accuracy?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
7. Are storage areas clearly marked with the vessels' capacity status (i.e., filled, empty, purged and other hazardous materials)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
8. Are quality assurance procedures in place to ensure that all valves are closed after the propane cylinders are filled?(e.g., QCC valves)	<input checked="" type="checkbox"/>	<input type="checkbox"/>
9. Is the schedule of maintenance and testing activities retained on site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>

7. Water Supply

The propane licence holder should work with the local fire department to determine water supply capabilities that are available based on the propane facility's location.

	Yes	No
1. Is a pressurized water system available at the propane facility site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
2. Can the municipal fire department pump 375 GPM (1420 LPM) of water at this location?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
3. What is the unobstructed distance to the closest water supply that could be used for firefighting activities? (distance in metres only)	<u>165 m</u>	
4. What is the unobstructed distance to the closest approved water supply with year round access if there are no hydrants? (distance in metres only)	<u>N/A</u>	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Rob Sneyd	Official Title COO	
Signature 	Telephone No. 905-525-8400	Date (dd-mm-yyyy) 14/06/2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

8. Licence holder and local Fire Services Review

To be completed by the Local Fire Services	Yes	No
Has the local fire service had an opportunity to review the Emergency Response and Preparedness Plan?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
If not, please explain (e.g., no fire services).		
<hr/> <hr/>		
Fire services comments, if any:		
<hr/> <hr/> <hr/>		
To be completed by the Licence Holder		
In response to the above comments, the following action(s) is required:		
<hr/> <hr/> <hr/>		
The licence holder will respond to the Local Fire Services comments by: _____		
(dd-mm-yyyy)		

LOCAL FIRE SERVICES

The undersigned has reviewed Section B of the Risk and Safety Management Plan Fire Services.

Print name	Signature	Date (dd-mm-yyyy)
Local Fire Services Name G. SAVENOCH		6.24.2011

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Rob Sneyd	Official Title COO
Signature 	Telephone No. 905-525-8400 Date (dd-mm-yyyy) 14/06/2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS

Applicant must include a Facility Site Plan and Map of Surrounding Area

Facility Site Plan.

The licence holder will submit a copy of the original facility site plan updated with the following information:

1. The storage location of fixed, portable, and mobile vessels.
2. The maximum volume, types and storage location of hazardous materials.
3. Location of permanent structures on site.
4. Access and egress points and location of barriers.
5. Location of fire and emergency equipment (e.g., sprinkler systems, extinguishers, suppression systems) on site and location of fire hydrant or water supply where available.
6. Location of emergency shut off/shut down switches/valves.

Map of Surrounding Area.

The licence holder will submit a scaled aerial map of the surrounding area showing the following information:

7. The capacity and placement of the single largest propane storage vessel, including its setback from the front, rear and side property lines.
8. GPS co-ordinates of the single largest vessel.
9. Visual indication of the single largest fixed vessel and a circle made using the distance in Table 1 as the radius from the single largest fixed vessel.
10. Clear indication of the municipality or municipalities present within the circle.
11. Visual indication of property line information.
12. The location and name of roads within or abutting the site.
13. Key note to the drawing indicating the facility's municipal address, municipal lot number(s) and concession lines as applicable, and the date the map was prepared.
14. Address and contact information for each municipality (municipal clerk or secretary-treasurers of planning board). (Refer to page 5.)
15. Complete "**Required Mapping Information from Updated Site Plan**" in table below .

Required Mapping Information from Updated Site Plan

Date Map Prepared (dd-mm-yyyy) 10-06-2011	Capacity of single largest propane storage vessel (USWG) 1300 USWG
Tank setback coordinates. Indicate placement on the map.	
Front: <u>52 ft.</u>	Right side property line: <u>163 ft.</u>
Rear: <u>412 ft.</u>	Left side property line: <u>135 ft.</u>
GPS coordinates of single largest vessel: <u>43.295637,-79.893737</u>	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Rob Sneyd	Official Title COO	
Signature 	Telephone No. 905-525-8400	Date (dd-mm-yyyy) 14/06/2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)
Applicant must include a Facility Site Plan and Map of Surrounding Area


Table 1: Distance Table

Water Capacity (litres)	Nominal Water Capacity (USWG)	Distance to 1 psi overpressure (m)
1,890	500	155
3,780	1,000	195
4,920	1,300	213
6,620	1,750	235
7,130	1,885	241
7,560	2,000	246
18,900	5,000	333

Formula: $D = 16.94 \times (1.524 \times C)^{1/3}$
 D = Distance to overpressure of 1 psi (meters)
 C = Tank Total Capacity in USWG

Parameters: Density of Propane is 0.5033 kg per litre @ 15 C
 Assume all vessels are 80% full
 1 gallon [US, liquid] = 0.003785411784 cubic meter
 1 cubic metre = 264.17 USWG

Hazard Distance Chart (EPA-TNT model)

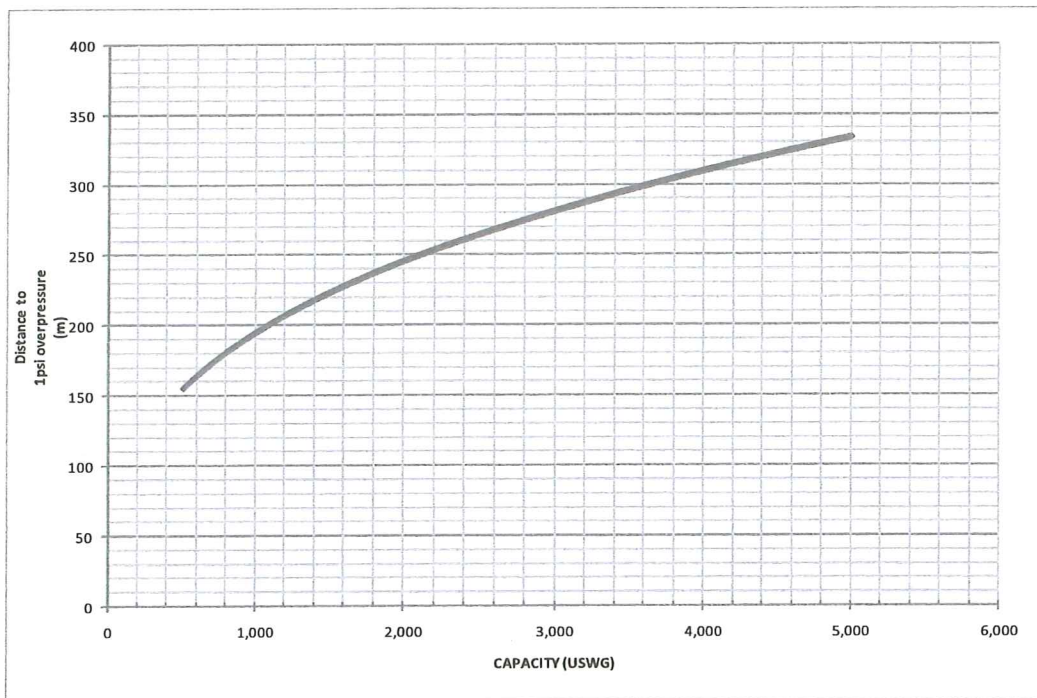

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) <i>Nothing completed on this page.</i>	Official Title	
Signature	Telephone No.	Date (dd-mm-yyyy)



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)

Applicant must include a Facility Site Plan and Map of Surrounding Area

As an accompaniment to the Map of Surrounding Area, provide the following information about buildings and features present within the circle in Table 2.

Table 2: Buildings and Features

Buildings and Features Present within the Circle on the Map of the Surrounding Area AND Name and Address of Closest Building or Feature	* Number of Buildings and Features (mark with an "X")				Distance from Tank to Closest Building or Feature
	0	1	2-10	11+	
Industrial buildings or parks or golf courses Name: <u>Burlington Paving</u> Address: <u>Plains Rd</u> City: _____ Province _____ Postal Code _____		x			<u>10</u> m
Residential building units specifically permanent single family dwellings, condominiums, and apartments. [Redacted]				x	<u>20-250</u> m
Commercial building units specifically retail, restaurants, entertainment, theatres, and sporting complexes. Name: _____ Address: _____ City: _____ Province _____ Postal Code _____	x				<u>0</u> m
Commercial building units – continuous occupancy specifically hotels, campgrounds, and resorts. Name: <u>City View Motel</u> Address: <u>Plains Rd</u> City: _____ Province _____ Postal Code _____		x			<u>40</u> m
Sensitive institutions specifically hospitals, schools and day cares, nursing and retirement homes, mental health institutions, and prisons. Name: _____ Address: _____ City: _____ Province _____ Postal Code _____	x				<u>0</u> m
Emergency responders specifically fire stations, ambulance stations, and police stations. Name: _____ Address: _____ City: _____ Province _____ Postal Code _____	x				<u>0</u> m

* For multi-unit buildings, count each unit as "1".

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) <u>Rob Sneyd</u>	Official Title <u>COO</u>	
Signature 	Telephone No. <u>905-525-8500</u>	Date (dd-mm-yyyy) <u>14/06/2011</u>



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)

Applicant must include a Facility Site Plan and Map of Surrounding Area

Portable Storage Additional Information Sheet

Cylinder Size	Capacity in USWG	Quantity	Total Volume in USWG
# 420	123.9		
# 100	29.5		
# 40	11.75		
# 33.3	9.62		
# 30	8.8	15	264
# 20	5.8	15	116
# 10	2.9		
# 5	1.5		
Total Cylinder Capacity 380 USWG			

Tanks Stored On-site Not Connected for Use


Tank Size In USWG	Quantity	Total Volume in USWG
1300 USWG	1	1300 USWG
Total Tank Capacity 0		

Total Cylinder Capacity	380 USWG
Total Tank Capacity	1300 USWG
Total Portable Capacity	380 USWG

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Rob Sneyd	Official Title COO	
Signature 	Telephone No. 905-525-8400	Date (dd-mm-yyyy) 14/06/2011

Scale (m):
0 50 100 150

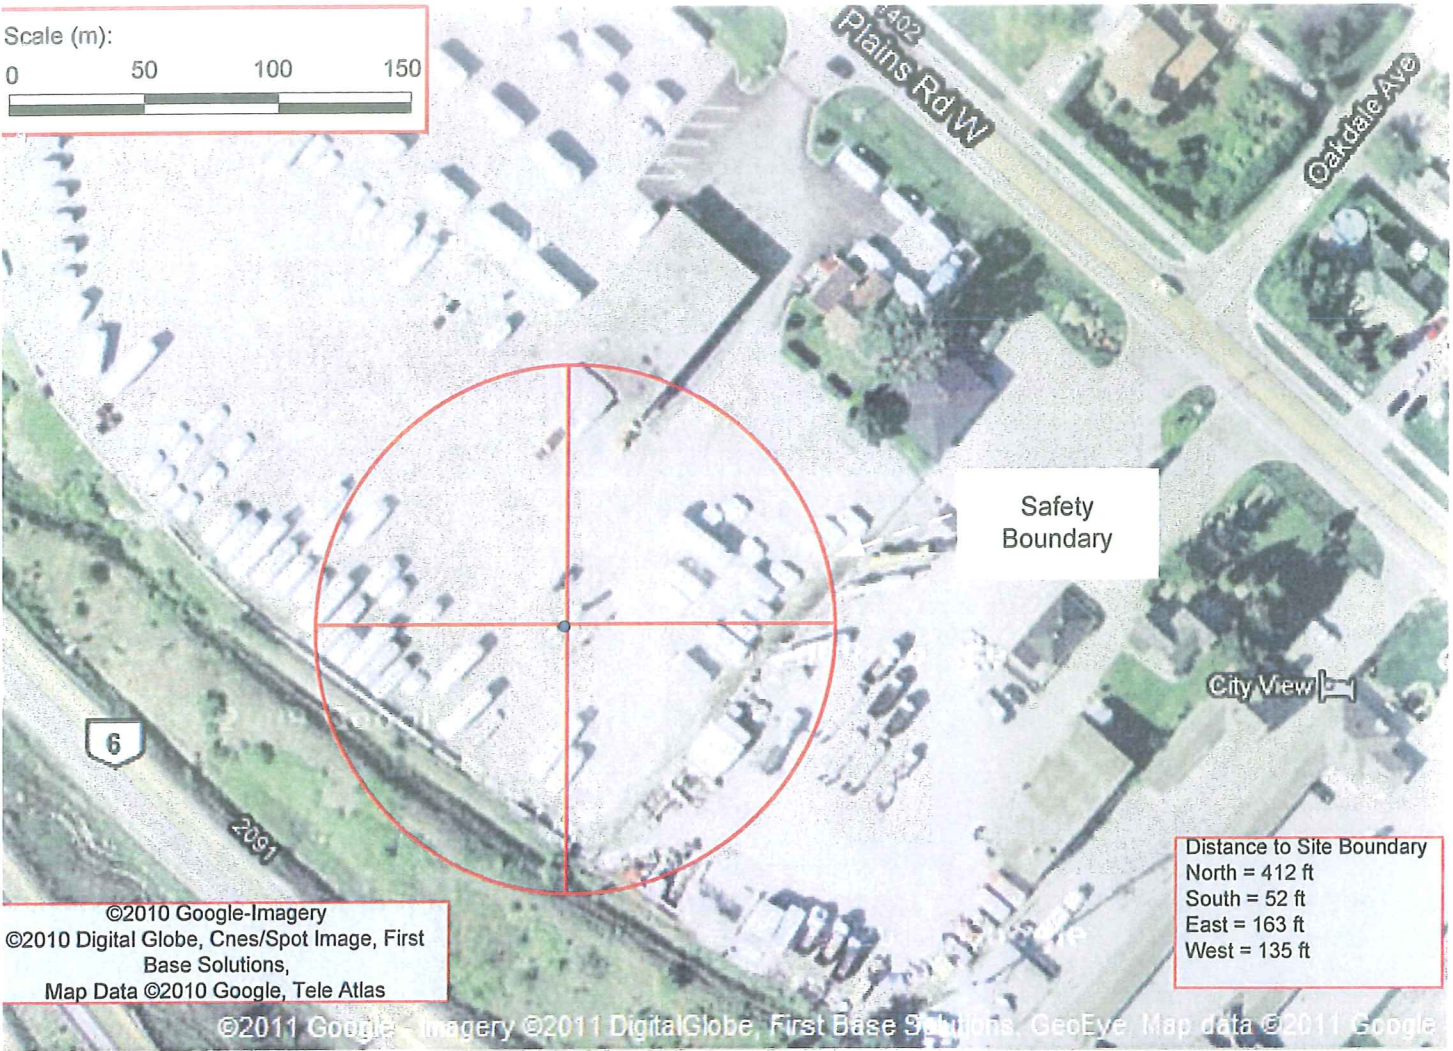


Safety Boundary

Distance to Site Boundary
 North = 412 ft
 South = 52 ft
 East = 163 ft
 West = 135 ft

©2010 Google-Imagery
 ©2010 Digital Globe, Cnes/Spot Image, First Base Solutions,
 Map Data ©2010 Google, Tele Atlas

©2011 Google - Imagery ©2011 DigitalGlobe, First Base Solutions, GeoEye, Map data ©2011 Google

<p>Location of Propane Storage Tank: Demarcated by ● in center of circle</p>	<p>Property Lines and Setbacks North = 412 ft East = 163 ft South = 52 ft West = 135 ft</p>	<p>Map of Surrounding Area</p> <p>Ruston RV Centre 1428 Plains Road West Burlington, Ontario</p>
<p>Capacity of Propane Storage Tank: Capacity of Propane Tank = 1300 USWG</p>	<p>Municipality (es) within the 1 psi overpressure circle: City of Burlington</p>	
<p>GPS Co-ordinates of Propane Storage tank: GPS Co-ordinates = 43.295637,-79.893737</p>	<p>Municipal Contact: Roman Martiuk City Clerk City of Burlington Tel: 905-336-7708 martiukr@curlington.ca</p>	
<p>Circular Distance to 1 psi overpressure: Notes by circle centred on tank: radial distance = 213 m</p>	<p>Drawn by: L. Forget Date: June 13th 2011</p>	

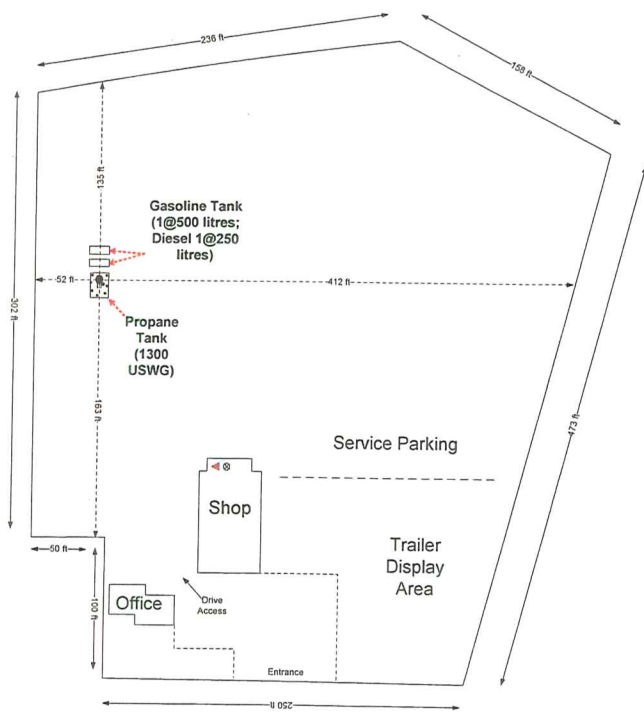

Municipal Fire Hydrant
(Plains Rd West)


Plains Road West

Municipal Fire Hydrant
(Plains Rd West)

Scale (ft):



Key Plan:

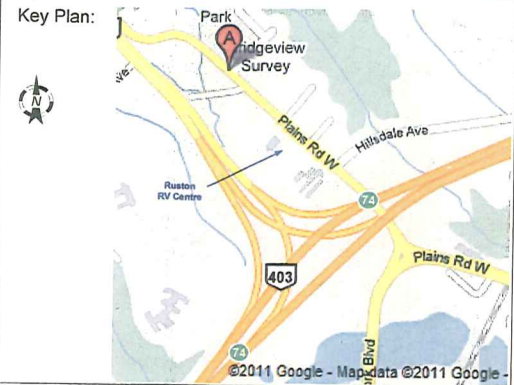

Notes:

1. Tank distances to property lines:

Property Line Setbacks	Distance
East (Right Side)	163 ft
South (Front Side)	52 ft
West (Left Side)	135 ft
North (Back Side)	412 ft

2. Fire Extinguisher

3. Egress/Fire Access Route:
Site is open, egress/access point from Plains Road West.

4. E-Stop

Superior Propane Ltd.

Title:
**Site Plan
Ruston RV Centre
1428 Plains Road West
Burlington, Ontario**

**LOTS 21,22
PLAN 337**

Drawn by: L. Forget

Checked by: C. Britskey

Date: June 10th 2011

Rev 0