



**Technical Standards and Safety Authority**  
 www.tssa.org  
 14th Floor - Centre Tower  
 3300 Bloor Street West  
 Toronto Ontario M8X 2X4  
 Fax: 416.231.4903  
 Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
 Propane Storage and Handling Regulation

This Level 1 RSMP applies to:
 

- a facility with a total propane storage capacity of 5,000 USWG or less; or
- a facility with a fixed propane storage capacity of exactly 5,000 USWG and no more than 500 USWG of portable propane storage capacity on site.


Failure to fully complete this form may result in rejection.  
 Making a false statement may result in a fine or prosecution under the *Technical Standards and Safety Act*.

Licence Number: 0034236001-C

Check applicable type of propane operations

Cylinder     Motor Fill     Filling Plant     Card/Keylock

Submit along with this completed application a Facility Site Plan and a Map of the Surrounding Area.



**SECTION A: GENERAL INFORMATION**

The Undersigned applies to TSSA for a review for an RSMP under Ontario's *Technical Standards and Safety Act*, Propane Storage and Handling Regulation.

Company Name: A&B Rental Centre (London) Limited    Ontario Corporation No., if applicable: [ ]

Operator Name (if different from above): Ivor deLance

Telephone No.: 519-471-7470    Fax No.: 519-471-9506    E-mail: ivor@abrental.com

Street No.: 1579    Street Name / 911 Number / Address, if applicable: Fanshawe Park Road West

Town / City or Township / County: London    Province: Ontario    Postal Code: N6H 5L3

Mailing address if different from above:

Street No.: Same    Street Name / 911 Number / Address, if applicable: [ ]

Town / City or Township / County: [ ]    Province: [ ]    Postal Code: [ ]

**Information on Container Refill Centre or Filling Plant**

Location of facility:

Street No.: 1579    Street Name / 911 Number / Address, if applicable: Fanshawe Park Road West    Nearest Major Intersection: Fanshawe Park Road West & Hyde Park Road

Town / City or Township / County: London    Province: On    Postal Code: N6H 5L3

Name of Licence Holder: Ivor deLance

Name of a Senior Management person as defined in the regulation holding the Record of Training (ROT): Ivor deLance    ROT type: PTI 100-8 cert # 86681 (PP0-3)

Municipality (or municipalities if the facility or its hazard distance touches multiple borders): City of London

Hours of operation: [Redacted]

This document is valid until the next licence renewal date. You are required by law to notify TSSA of any change of information.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Print name	Signature	Date (dd-mm-yyyy)
Name of Licence Holder: Ivor deLance	<i>Ivor deLance</i>	14/09/2011
Name of Senior Management person as defined in the Regulation holding the Record of Training: Ivor deLance		



Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION A: GENERAL INFORMATION (cont'd)**


Indicate the year the facility was established: Unknown 1994      Indicate the year of any significant modifications, as defined in s 1, O.Reg 211/01, since establishment: NONE

Identify the psig rating and serial number for each fixed propane storage tank on site.

	PSIG	Serial Number
Tank 1:	<u>250</u>	<u>5-592897</u>
Tank 2:	_____	_____
Tank 3:	_____	_____

Enter capacity of propane in USWG, fixed, portable, and mobile, and provide detailed inventory that includes the number of tank/vessel for each type (fixed, portable, and mobile) and the capacity of each tank/vessel, on a separate document.

Fixed: 2000      Portable: 1588.6      Mobile: 0



**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Ivor deLance	Official Title Owner
Signature <i>Ivor deLance</i>	Telephone No. 519-471-7470
	Date (dd-mm-yyyy) <u>14/09/2016</u>



Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION A: GENERAL INFORMATION (cont'd)**  
Activity Information

<b>Name of Propane Supplier(s)</b> Superior Propane - Ontario Regional Centre		For Office Use - Party No.	
Street No. 251	Street Name / 911 Number / Address, if applicable Woodland Road East Unit 217		
Town / City or Township / Country Guelph		Province On	Postal Code N1H 8J1
Telephone No. 1-877-873-7467	Fax No. 519-836-7766	Contact Name Mike Mullins	
E-mail mullinsm@superiorpropane.com			

<b>Name of Propane Transporter.</b> If same as above, please check box. <input type="checkbox"/>		For Office Use - Party No.	
Superior Propane			
Street No. 7652	Street Name / 911 Number / Address, if applicable Queensline, HWY 2 West		
Town / City or Township / Country Chatham		Province On	Postal Code N7M 5J5
Telephone No. 519-401-1095	Fax No. 519-836-7766	Contact Name Mike Mullins	
E-mail mullinsm@superiorpropane			

<b>Off-site Cylinder and/or Mobile Storage</b>		Capacity stored off-site, in USWG	For Office Use - Party No.
None			
Street No.	Street Name / 911 Number / Address, if applicable		
Town / City or Township / Country		Province	Postal Code
Telephone No.	Fax No.	Contact Name	

Note: Customer storage is not considered off-site storage.

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Ivor deLance		Official Title Owner	
Signature <i>Ivor deLance</i>		Telephone No. 519-471-7470	Date (dd-mm-yyyy) 14/09/2011



Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN**

The licence holder will complete Section B in consultation with the local Fire Services.

Description of the maximum volume, types and storage location of other hazardous materials on site, if any.

None

Description of fire and emergency equipment indicated on facility site map.

20 ABC Fire Extinguisher located @ propane refill centre

ABC Fire extinguisher located throughout the facility

List of fire protection controls (e.g., fire detection systems, fire notification systems, alarm systems, automatic shut off devices, fusible links, etc.) and describe their function, use and operation.

1- Fusible Link on ISC- isolation valve between the tank and the downstream propane dispensing equipment.

2- Power supply breaker @ panel inside the main building. This cuts all power to the propane system - shuts down pump; closes solenoid valve.

3- Source of water 500 metres (fire Hydrant)

Maintenance and testing schedule for fire protection controls and devices.

Maintenance and testing is undertaken by Superior Propane according to Superior Propane's Maintenance Standards. Schedule for key equipment is:

1- Pumps (Pump every 3 months; check belts monthly; grease motor every 6 months)

2- ISC Valves (tested for closure every 6 months).

3- Storage Tank Relief Valves - inspected every 2 years; replacement schedule as per provincial regulations.

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Ivor deLance	Official Title Owner
Signature 	Telephone No. 519-471-7470
	Date (dd-mm-yyyy) 14/09/2011



Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)  
Technical Standards and Safety Act  
Propane Storage and Handling Regulation

**SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)**

1. Contacts for Emergency Response

<b>1. Facility Contact Personnel - Key Contact</b>		<b>5. Facility 24-Hour Contact Person</b>	
Name Ivor deLance	For Office Use - Party No.	Name Ivor deLance	For Office Use - Party No.
Official Title Owner		Official Title Owner	
Telephone No. 519-471-7470	Fax No. 519-471-9506	Cell No. 519-282-6354	Fax No. 519-471-9506
E-mail ivor@abrentalcentre.com		E-mail ivor@abrentalcentre.com	
Role and responsibilities in emergency Coordinate site response (ERP)		Role and responsibilities in emergency Coordinate site response (ERP)	
<b>2. Facility Contact Personnel - Alternate Contact</b>		<b>6. Name of Facility Manager</b>	
Name Ian Baber	For Office Use - Party No.	Name Ian Baber	For Office Use - Party No.
Official Title Rental Manager		Official Title Rental Manager	
Telephone No. 519-204-6848	Fax No. 519-471-9506	Telephone No. 519-204-6848	Fax No. 519-471-9506
E-mail ian.baber@abrentalcentre.com		E-mail ian.baber@abrentalcentre.com	
Role and responsibilities in emergency Co-ordinate site response (ERP)		Role and responsibilities in emergency Co-ordinate site response (ERP)	
<b>3. Local Fire Services - Key Contact</b>		<b>7. Propane Supplier Key Contact Person</b>	
Name John Kobarda	For Office Use - Party No.	Name Superior Propane Hotline	For Office Use - Party No.
Official Title Fire Chief		Official Title	
Telephone No. 519-661-2500 ext 4565	Fax No. 519-661-8419	Telephone No. 1-877-873-7467	Fax No.
E-mail jkobarda@london.ca		E-mail	
Role and responsibilities in emergency Co-ordinate/ advise on London Fire Service response. Liaise with police.		Role and responsibilities in emergency Identify and dispatch Superior Propane and or LPGERC emergency response personal as required	
<b>4. Local Fire Services - Alternate Contact</b>		<b>8. Municipal Contact</b>	
Name Wendy Cowdrie	For Office Use - Party No.	Name Cathy Saunders	For Office Use - Party No.
Official Title Fire Prevention Officer		Official Title City Clerk	
Telephone No. 519-661-2500	Fax No. 519-661-8419	Telephone No. 519-661-4530	Fax No. 519-661-4892
E-mail wcowdrie@london.ca		E-mail csaunders@london.ca	
Role and responsibilities in emergency Alternate- Co-ordinate/advise London Fire Service Response. Liaise with police.		Municipality City of London	

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Ivor deLance	Official Title Owner
Signature 	Telephone No. 519-471-7470
	Date (dd-mm-yyyy) 14/09/11



Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)**

**2. Additional Safety Measures**

Describe any other measures in place at the facility that exceed the minimum Code and Standards requirements.  
Emergency Shut Off push button to shut down power to the pump and close the solenoid valve upstream of dispenser hoses.

[Large empty lined area for describing additional safety measures]

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Ivor deLance	Official Title Owner	
Signature <i>Ivor deLance</i>	Telephone No. 519-471-7470	Date (dd-mm-yyyy) 14/09/2011



Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario MBX 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)**

**3. Record of Emergency Training Provided - For most recent 12-month period.**

**Training on Emergency Response Plan and Procedures provided to facility key contacts.**

Training Date (dd-mm-yyyy) None	Print Name of Training Provider: None
	Print Name of Instructor:
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

**Training on the facility's Emergency Management Procedures provided to staff.**

Training Date (dd-mm-yyyy) None	Print Name of Training Provider: None
	Print Name of Instructor:
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

**On-site specific training provided to certificate holders / persons with Records of Training.**

Training Date (dd-mm-yyyy) 23-06-2010	Print Name of Training Provider: FSN Training & Development Inc.	Please note - a ROT is valid for 3 years
	Print Name of Instructor: Joe McLeod	
Training Date (dd-mm-yyyy)	Print Name of Training Provider:	
	Print Name of Instructor:	
Training Date (dd-mm-yyyy)	Print Name of Training Provider:	
	Print Name of Instructor:	

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Ivor deLance	Official Title Owner
Signature <i>Ivor deLance</i>	Telephone No. 519-471-7470
	Date (dd-mm-yyyy) <i>14/09/2011</i>



Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)**

4. Emergency Training Plan for Coming Year

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Target Date (dd-mm-yyyy) Q4- 2011	Print Name of Training Provider: Superior Propane	Please note: TSSA is currently developing
	Print Name of Instructor: to be arranged	the course and it and its provider should
Target Date (dd-mm-yyyy)	Print Name of Training Provider:	be available to teach in the fourth quarter of this year
	Print Name of Instructor:	
Target Date (dd-mm-yyyy)	Print Name of Training Provider:	
	Print Name of Instructor:	

Training on the facility's Emergency Management Procedures provided to staff.

Target Date (dd-mm-yyyy) Q4- 2011	Print Name of Training Provider: Key contact to train staff
	Print Name of Instructor: to be arranged
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

On-site specific training provided to certificate holders / persons with Records of Training.

Target Date (dd-mm-yyyy) Q4- 2011	Print Name of Training Provider: FSN Training & Development Inc.	Please note - a ROT is valid for 3 years
	Print Name of Instructor: Joe Mcleod	Company to notify training provider if training is
Target Date (dd-mm-yyyy)	Print Name of Training Provider:	required in 2011
	Print Name of Instructor:	
Target Date (dd-mm-yyyy)	Print Name of Training Provider:	
	Print Name of Instructor:	

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Ivor deLance	Official Title Owner
Signature <i>Ivor deLance</i>	Telephone No. 519-471-7470
	Date (dd-mm-yyyy) <i>14/09/2011</i>





Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)**

The licence holder will complete Section B in consultation with the local Fire Services.

**5. Emergency Response Communications Plan**

**Warnings and Actions**

Describe who gives warnings to whom, and how and when the warning will be given (including public notification as appropriate).  
The operator or alternate will contact emergency services by calling 911 and will provide warnings outlined in the attached "Propane Emergency Response Procedures" placard (to be posted on site and part of the employee training). If it is safe to do so this could involve advising neighbors to evacuate. The owner/operator may also contact Superior Propane via the emergency number identified in the ERP.

Describe what action is to be taken and by whom when a warning is issued (including details of a meeting place in a safe identified area and activating the evacuation plan, if necessary).

The owner/operator or alternate should first follow the actions in the ERP provided herein. Staged evacuation, if the release of propane cannot be stopped by cutting electrical power may be required. Note a specific muster point is not advisable, since a propane plume can blow in any direction.

Actions will be taken by on duty person(s)

**Communication with Emergency Response Authorities**

Describe when and how the licence holder will give early warning to emergency response authorities (including a process to ensure that a call is placed to 911).

When the system is operational, an ROT person will be on duty and be in the propane tank area. This person will be able to visually ascertain any abnormal/accident event and implement the appropriate emergency response actions. When the system is not in operation, the ISC valve (main isolation valve) is closed, and the propane system is unattended. Any accidents involving the propane tank during such times will require the intervention of random, nearby individuals or store staff.

Describe provisions for fire department entry when there are no operations or staffing at the propane site.

The propane tank system is in a wide open area that is easily accessible.

These fire access routes are identified in the attached site plan.

Describe how the licence holder will ensure continual flow of updated information to authorities.

The critical information required from the licence holder is (a) how to shut the system down and (b) the fill level in the tank, if known)

Fill level is relevant from a time-to-BLEVE perspective (a near empty tank will BLEVE sooner than a full if there is a fire impingement on the tank)

This information will be provided to the authorities by - Ivor deLance or his Alternate person

How long will it take the facility liaison person to respond to the site.

It would take the owner 30 minutes to respond

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Ivor deLance	Official Title Owner	
Signature 	Telephone No. 519-471-7470	Date (dd-mm-yyyy) 14/09/2011



Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)**

The licence holder will complete Section B in consultation with the local Fire Services.

**6. Building and Site Security and Procedures**

	Yes	No
1. Does the propane location have controlled access to limit unnecessary risk and entry (lock out procedures)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
2. Is there adequate night lighting at the site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
3. Are procedures in place that ensure access routes, aisles, storage area, filling areas and the grounds are kept clear from unwanted materials?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
4. Are there procedures that capture and record the daily inspection of hoses and inspection requirements for filling systems and mechanical devices used in the transfer of propane?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
5. Does the facility have procedures that include a process to isolate and purge any overfilled propane cylinders?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
6. Are weighing systems validated for accuracy?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
7. Are storage areas clearly marked with the vessels' capacity status (i.e., filled, empty, purged and other hazardous materials)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
8. Are quality assurance procedures in place to ensure that all valves are closed after the propane cylinders are filled?(e.g., QCC valves)	<input checked="" type="checkbox"/>	<input type="checkbox"/>
9. Is the schedule of maintenance and testing activities retained on site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>

**7. Water Supply**

The propane licence holder should work with the local fire department to determine water supply capabilities that are available based on the propane facility's location.

	Yes	No
1. Is a pressurized water system available at the propane facility site?	<input type="checkbox"/>	<input checked="" type="checkbox"/>
2. Can the municipal fire department pump 375 GPM (1420 LPM) of water at this location?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
3. What is the unobstructed distance to the closest water supply that could be used for firefighting activities? (distance in metres only)	<u>500 m Fire Hydrant</u>	
4. What is the unobstructed distance to the closest approved water supply with year round access if there are no hydrants? ( distance in metres only)	<u>N/A</u>	

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Ivor deLance	Official Title Owner	
Signature <i>Ivor deLance</i>	Telephone No. 519-471-7470	Date (dd-mm-yyyy) <i>14/09/2011</i>



Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)**

The licence holder will complete Section B in consultation with the local Fire Services.

**8. Licence holder and local Fire Services Review**

<b>To be completed by the Local Fire Services</b>	Yes	No
Has the local fire service had an opportunity to review the Emergency Response and Preparedness Plan?	<input type="checkbox"/>	<input type="checkbox"/>
If not, please explain (e.g., no fire services).		
Fire services comments, if any:		
<b>To be completed by the Licence Holder</b>		
In response to the above comments, the following action(s) is required:		
The licence holder will respond to the Local Fire Services comments by: _____		
(dd-mm-yyyy)		

**LOCAL FIRE SERVICES**

The undersigned has reviewed Section B of the Risk and Safety Management Plan Fire Services.

Print name	Signature	Date (dd-mm-yyyy)
Local Fire Services Name		

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Ivor deLance	Official Title Owner
Signature 	Telephone No. 519-471-7470
	Date (dd-mm-yyyy) 14/09/2011



Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION C: SUBMISSIONS**

Applicant must include a Facility Site Plan and Map of Surrounding Area

**Facility Site Plan.**

The licence holder will submit a copy of the original facility site plan updated with the following information:

1. The storage location of fixed, portable, and mobile vessels.
2. The maximum volume, types and storage location of hazardous materials.
3. Location of permanent structures on site.
4. Access and egress points and location of barriers.
5. Location of fire and emergency equipment (e.g., sprinkler systems, extinguishers, suppression systems) on site and location of fire hydrant or water supply where available.
6. Location of emergency shut off/shut down switches/valves.

**Map of Surrounding Area.**

The licence holder will submit a scaled aerial map of the surrounding area showing the following information:

7. The capacity and placement of the single largest propane storage vessel, including its setback from the front, rear and side property lines.
8. GPS co-ordinates of the single largest vessel.
9. Visual indication of the single largest fixed vessel and a circle made using the distance in Table 1 as the radius from the single largest fixed vessel.
10. Clear indication of the municipality or municipalities present within the circle.
11. Visual indication of property line information.
12. The location and name of roads within or abutting the site.
13. Key note to the drawing indicating the facility's municipal address, municipal lot number(s) and concession lines as applicable, and the date the map was prepared.
14. Address and contact information for each municipality (municipal clerk or secretary-treasurers of planning board). (Refer to page 5.)
15. Complete "Required Mapping Information from Updated Site Plan" in table below .

**Required Mapping Information from Updated Site Plan**

Date Map Prepared (dd-mm-yyyy) 22-09-2011	Capacity of single largest propane storagevessel (USWG) 2000 USWG
Tank setback coordinates. Indicate placement on the map.	
Front: <u>58 m</u>	Right side property line: <u>307 m</u>
Rear: <u>7 m</u>	Left side property line: <u>58 m</u>
GPS coordinates of single largest vessel: <u>Lat. 43.0095 Long. -81.3435</u>	

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Ivor deLance	Official Title Owner
Signature 	Telephone No. 519-471-7470
	Date (dd-mm-yyyy) 14/09/2011



Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION C: SUBMISSIONS (cont'd)**

Applicant must include a Facility Site Plan and Map of Surrounding Area


Table 1: Distance Table

Water Capacity (litres)	Nominal Water Capacity (USWG)	Distance to 1 psi overpressure (m)
1,890	500	155
3,780	1,000	195
4,920	1,300	213
6,620	1,750	235
7,130	1,885	241
7,560	2,000	246
18,900	5,000	333

**Formula:**  $D = 16.94 \times (1.524 \times C)^{1/3}$   
 D = Distance to overpressure of 1 psi (meters)  
 C = Tank Total Capacity in USWG

**Parameters:** Density of Propane is 0.5033 kg per litre @ 15 C  
 Assume all vessels are 80% full  
 1 gallon [US, liquid] = 0.003785411784 cubic meter  
 1 cubic metre = 264.17 USWG

Hazard Distance Chart (EPA-TNT model)

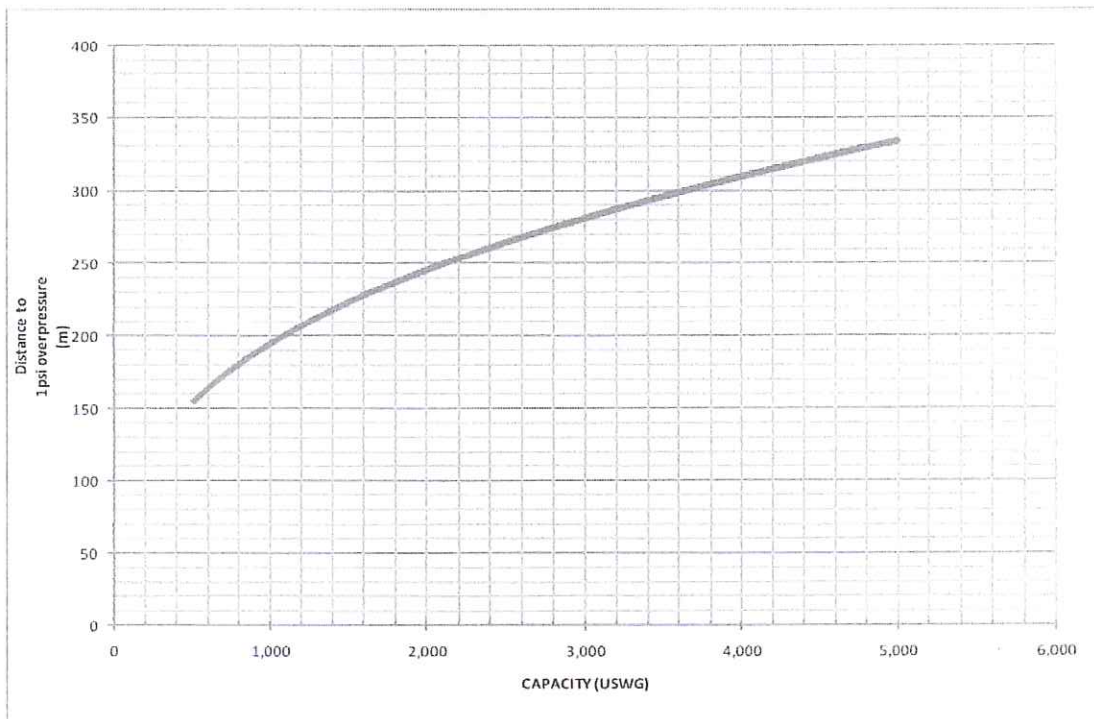

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Ivor deLance	Official Title Owner
Signature <i>Ivor deLance</i>	Telephone No. 519-471-7470
	Date (dd-mm-yyyy) 14/09/2011



Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION C: SUBMISSIONS (cont'd)**

Applicant must include a Facility Site Plan and Map of Surrounding Area

As an accompaniment to the Map of Surrounding Area, provide the following information about buildings and features present within the circle in Table 2.

**Table 2: Buildings and Features**

Buildings and Features Present within the Circle on the Map of the Surrounding Area AND Name and Address of Closest Building or Feature	* Number of Buildings and Features (mark with an "X")				Distance from Tank to Closest Building or Feature
	0	1	2-10	11+	
Industrial buildings or parks or golf courses Name: Hide Park Equipment Rental Address: 2034 Mallard Road City: London Province On Postal Code N6H 5L3			x		87.5 m
Residential building units specifically permanent single family dwellings, condominiums, and apartments [REDACTED]		x			75 m
Commercial building units specifically retail, restaurants, entertainment, theatres, and sporting complexes. Name: _____ Address: _____ City: _____ Province _____ Postal Code _____	x				0 m
Commercial building units – continuous occupancy specifically hotels, campgrounds, and resorts. Name: _____ Address: _____ City: _____ Province _____ Postal Code _____	x				0 m
Sensitive institutions specifically hospitals, schools and day cares, nursing and retirement homes, mental health institutions, and prisons. Name: _____ Address: _____ City: _____ Province _____ Postal Code _____	x				0 m
Emergency responders specifically fire stations, ambulance stations, and police stations. Name: Fire Services Response station # 14 Address: 2225 Hyde Park Road City: London Province On Postal Code N6H 5K2		x			700 m

\* For multi-unit buildings, count each unit as "1".

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Ivor deLance	Official Title Owner	Date (dd-mm-yyyy) 14/09/2011
Signature <i>Ivor deLance</i>	Telephone No. 519-471-7470	



Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION C: SUBMISSIONS (cont'd)**

Applicant must include a Facility Site Plan and Map of Surrounding Area

**Portable Storage Additional Information Sheet**

Cylinder Size	Capacity in USWG	Quantity	Total Volume in USWG
# 420	123.9		
# 100	29.5	50	1475
# 40	11.75		
# 33.3	9.62	10	96.2
# 30	8.8		
# 20	5.8	3	17.4
# 10	2.9		
# 5	1.5		
<b>Total Cylinder Capacity 1588.6</b>			

**Tanks Stored On-site Not Connected for Use**



Tank Size In USWG	Quantity	Total Volume in USWG
none	none	none
<b>Total Tank Capacity none</b>		

<b>Total Cylinder Capacity</b>	1588.6
<b>Total Tank Capacity</b>	2000 USWG dispenser refill centre
<b>Total Portable Capacity</b>	1588.6

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Ivor deLance	Official Title Owner
Signature <i>Ivor deLance</i>	Telephone No. 519-471-7470
	Date (dd-mm-yyyy) 14/09/2011

©2011 Google – Imagery  
 ©2011 Digital Globe, Cnes/Spot Image, First Base Solutions,  
 Map data ©2011 Google, Tele Atlas

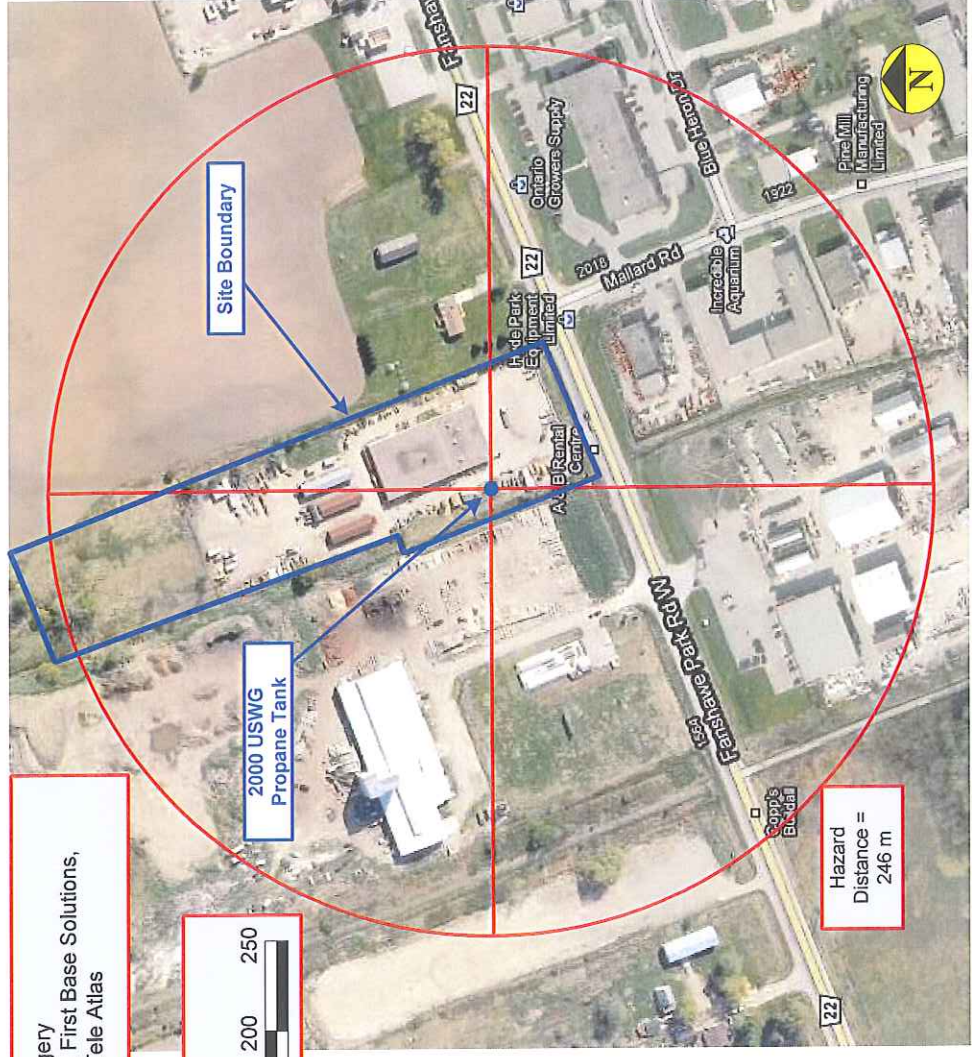

<b>Map of Surrounding Area</b>	
A & B Rental Centre Ltd. 1579 Fanshawe Park Road West, Hyde Park, ON, N6H 5L3 Concession 5 Part Lot 25 and 26, City of London	
Drawn by: S. Oliverio Date: July 22, 2011	
Municipality (ies) within the 1 psi overpressure circle: City of London	
Municipal Contact: Cathy Saunders City Clerk, City of London 300 Dufferin Avenue, 3 <sup>rd</sup> Floor, P.O. Box 5035, London, ON, N6A 4L9 Tel: 519-661-2500 ext. 4937 Email: csaunders@london.ca	
Setback Distances to Site Boundary	Northwest: 307 m Southeast: 58 m Northeast: 67 m Southwest: 7 m
Capacity of Propane Storage Tank	Capacity of Propane Storage Tank = 2000 USWG
GPS Co-ordinates of Propane Storage Tank	GPS Co-ordinates = 43.0095, -81.3435
Circular Distance to 1 psi overpressure	Denoted by circle centred on tank; radial distance = 246 m





Notes:

- Tank distances to property lines:

Property Line Setbacks	Distance
Northwest	307 m
Southeast (Front)	58 m
Northeast	67 m
Southwest	7 m


- Fire Extinguisher
- Egress/Fire Access Route: Site is wide open, egress/access from Fanshawe Park Road.
- E-Stop
- Cylinder Cage

**FSN Training & Development**

Title: **Site Plan**  
**A & B Rental Centre Ltd.**  
 1579 Fanshawe Park Road West, London, ON, N6H 5L3

*Concession 5 Part Lot 25 and 26, City of London*

Drawn by: S.Oliverio  
 Date: August 22, 2011  
 Checked by:  
 Rev 0

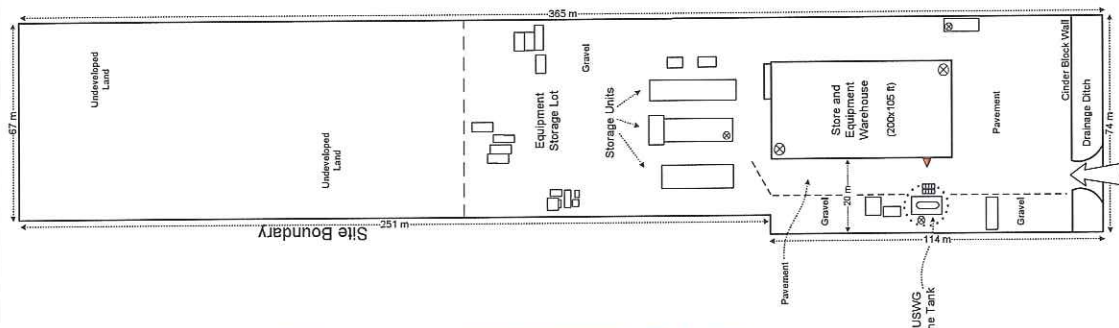

Fanshawe Park Road West



Street View of A & B Rental Centre Ltd. from Fanshawe Park Road West (taken from Google Maps)

