



Technical Standards and Safety Authority
 www.tssa.org
 14th Floor - Centre Tower
 3300 Bloor Street West
 Toronto Ontario M8X 2X4
 Fax: 416.231.4078
 Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
 Propane Storage and Handling Regulation

This Level 1 RSMP applies to:

- a facility with a total propane storage capacity of 5,000 USWG or less; or
- a facility with a fixed propane storage capacity of 5,000 USWG or less; or
- USWG of portable propane storage capacity


Failure to fully complete this form may result in rejection. Making a false statement may result in a fine or prosecution under the Technical Standards and Safety Act

Licence Number 000191579 (Previous License)

Check applicable type of propane operations:

Cylinder Motor Fill Filling Plant Card/Keylock

Submit along with this completed application a Facility Site Plan and a Map of the Surrounding Area.

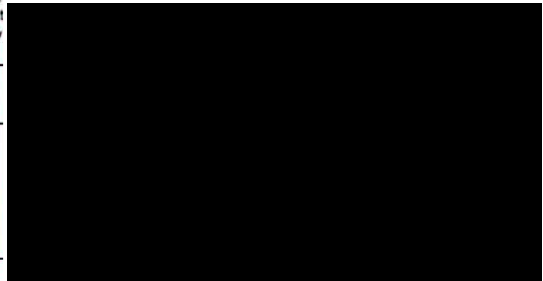

SECTION A: GENERAL INFORMATION

The Undersigned applies to TSSA for a review for an RSMP under Ontario's *Technical Standards and Safety Act*, Propane Storage and Handling Regulation.

A Company Name: 2485399 Ontario Inc. Corporation No.: 2485399 Ontario Inc.

Operator Name (if different from above):

Telephone No.: 519-582-3391 Fax No.: E-mail: shellsimcoe@gmail.com

B Street No.: 489 Street Name / 911 Number / Address, if applicable: MCDOWELL ROAD EAST (RR1)

Town / City or Township / County: SIMCOE Province: ONT Postal Code: N3Y 4J9

Mailing address if different from above:

C Street No.: Street Name / 911 Number / Address, if applicable:

Town / City or Township / County: Province: Postal Code:

Information on Container Refill Centre or Filling Plant

Location of facility:

D Street No.: 489 Street Name / 911 Number / Address, if applicable: MCDOWELL ROAD EAST Nearest Major Intersection: PINEGROVE ROAD/MCDOWELL ROAD EAST

Town / City or Township / County: SIMCOE Province: ONT Postal Code: N3Y 4J9

Name of Licence Holder: Kuldip Sidhu

Name of a Senior Management person as defined in the regulation holding the Record of Training (ROT): Kuldip Sidhu ROT type: 100-01

Municipality (or municipalities if the facility or its hazard distance touches multiple borders): Norfolk

Hours of operation:

This document is valid until the next licence renewal date. You are required by law to notify TSSA of any change of information.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Print name	Signature	Date (dd-mmm-yyyy)
Name of Licence Holder: Kuldip Sidhu		13-Dec-2016
Name of Senior Management person as defined in the Regulation holding the Record of Training: Kuldip Sidhu		



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION A: GENERAL INFORMATION (cont'd)

Indicate the year the facility was established. Indicate the year of any significant modifications, as defined in s.1, O.Reg 211/01, since establishment.
2012 2012

Identify the psig rating and serial number for each fixed propane storage tank on site.

	PSIG	Serial Number
Tank 1:	250	3256L
Tank 2:	_____	_____
Tank 3:	_____	_____

Enter capacity of propane in USWG, fixed, portable, and mobile, and provide detailed inventory that includes the number of tank/vessel for each type (fixed, portable, and mobile) and the capacity of each tank/vessel, on a separate document.

Fixed: 1000 USWG Portable: 60 x 20 LB Mobile: NA



Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Kuldip Sidhu	Official Title Owner
Signature 	Telephone No. 519-582-3391
	Date (dd-mmm-yyyy) 13-Dec-2016



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION A: GENERAL INFORMATION (cont'd)

Activity Information

Name of Propane Supplier(s)			
Dodsley Propane			
Street No.	Street Name / 911 Number / Address, if applicable		
45	Spruce Street		
Town / City or Township / Country		Province	Postal Code
Tillsonburg		Ontario	N5G 5C4
Telephone No.	Fax No.	Contact Name	
519-842-9700	519-842-8102	Jim Smith, Derek Dodsley	
E-mail			
info@dodsleypropane.com			

Name of Propane Transporter. If same as above, please check box. <input checked="" type="checkbox"/>		For Office Use - Party No.	
Street No. Street Name / 911 Number / Address, if applicable			
Town / City or Township / Country		Province	Postal Code
Telephone No.		Fax No.	Contact Name
E-mail			

Off-site Cylinder and/or Mobile Storage		Capacity stored off-site, in USWG	For Office Use - Party No.
NA			
Street No. Street Name / 911 Number / Address, if applicable			
Town / City or Township / Country		Province	Postal Code
Telephone No.		Fax No.	Contact Name

Note: Customer storage is not considered off-site storage.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print)		Official Title	
Kuldip Sidhu		Owner	
Signature		Telephone No.	Date (dd-mmm-yyyy)
		519-582-3391	13-Dec-2016



Technical Standards and Safety Authority
 www.tssa.org
 14th Floor - Centre Tower
 3300 Bloor Street West
 Toronto Ontario M8X 2X4
 Fax: 416.231.4078
 Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
 Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN

The licence holder will complete Section B in consultation with the local Fire Services.

Description of the maximum volume, types and storage location of other hazardous materials on site, if any.

- 1 - UNDERGROUND GAS TANK - 40,000 GAS / 40,000 GAS = 80,000
- 2 - UNDERGROUND DIESEL/GAS TANK - 15,000 DIESEL / 15,000 SUPER = 30,000
- TOTAL OF 2 UNDERGROUND STORAGE TANKS WITH 4 COMPARTMENTS, 110,000 LITRES TOTAL

Description of fire and emergency equipment indicated on facility site map.

- FIRE EXTINGUISHERS (4 IN TOTAL) 1) ABC-10-G 2) ABC-10-H 3) ABC-050-E 4) XN 387593

List of fire protection controls (e.g., fire detection systems, fire notification systems, alarm systems, automatic shut off devices, fusible links, etc.) and describe their function, use and operation.

- The store is equipped with a security and camera system. The security system is monitored.
- The Propane Filling Station is equipped with a pacman cabinet that when closed, assures that the ISC valve is shut. The cabinet will remain locked when no company personnel is present after hours. A fusible link is located between the cabinet door and ISC valve to shut down the ISC in the event of a fire.

Maintenance and testing schedule for fire protection controls and devices.

- A daily inspection form is completed each and every day. The shut down system will be check once per week.
- Fire Extinguishers are checked annually.
- Dodsley Propane to perform periodic maintenance and annual inspection.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Kuldip Sidhu	Official Title Owner	
Signature 	Telephone No. 519-582-3391	Date (dd-mmm-yyyy) 13-Dec-2016



Technical Standards and Safety Authority
 www.tssa.org
 14th Floor - Centre Tower
 3300 Bloor Street West
 Toronto Ontario M8X 2X4
 Fax: 416.231.4078
 Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
 Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

1. Contacts for Emergency Response

1. Facility Contact Personnel - Key Contact		5. Facility 24-Hour Contact Person	
Name Kuldip Sidhu	For Office Use - Party No.	Name Kuldip Sidhu	For Office Use - Party No.
Official Title Owner Operator		Official Title Owner Operator	
Telephone No. 519-582-3391	Fax No.	Cell No. 519-400-5477	Fax No.
E-mail shellsimcoe@gmail.com		E-mail shellsimcoe@gmail.com	
Role and responsibilities in emergency CALL 911, EMPLOYEE/CUSTOMER SAFETY, CLOSE FACILITY, EVACUATE EMPLOYEES AND CUSTOMERS		Role and responsibilities in emergency CALL 911, EMPLOYEE/CUSTOMER SAFETY, CLOSE FACILITY, EVACUATE EMPLOYEES AND CUSTOMERS	
2. Facility Contact Personnel - Alternate Contact		6. Name of Facility Manager	
Name Kuldip Sidhu	For Office Use - Party No.	Name Kuldip Sidhu	For Office Use - Party No.
Official Title		Official Title Owner Operator	
Telephone No.	Fax No.	Telephone No. 519-582-3391	Fax No.
E-mail		E-mail shellsimcoe@gmail.com	
Role and responsibilities in emergency CALL 911, EMPLOYEE/CUSTOMER SAFETY, CLOSE FACILITY, EVACUATE EMPLOYEES AND CUSTOMERS		Role and responsibilities in emergency CALL 911, EMPLOYEE/CUSTOMER SAFETY, CLOSE FACILITY, EVACUATE EMPLOYEES AND CUSTOMERS	
3. Local Fire Services - Key Contact		7. Propane Supplier Key Contact Person	
Name TERRY DICKS	For Office Use - Party No.	Name Jim Smith	For Office Use - Party No.
Official Title FIRE CHIEF	E-mail firechief@norfolkcounty.ca	Official Title Compliance Coordinator	E-mail jimsmith@dodsleypropane.com
Telephone No. 519-	Fax No. 519-426-4140	Telephone No. 519-842-9700	Fax No. 519-842-8102
Role and responsibilities in emergency INCIDENT COMANDER		Role and responsibilities in emergency TECHNICAL SUPPORT	
Fire Services Address 95 Culver St, Simcoe, ON N3Y 2V5		Propane Supplier Address 45 Spruce Street, Tillsonburg Ontario N4G 5C4	
4. Local Fire Services - Alternate Contact		8. Municipal Contact	
Name Scott Pipe	For Office Use - Party No.	Name MARIANNE TALLIAN	For Office Use - Party No.
Official Title Captain/Fire Prevention Officer	E-mail scott.pipe@norfolk.ca	Official Title BUILDING AND BY LAW	
Telephone No. 519 426 4115 ext 2402	Fax No. 519 426 4140	Telephone No. 519-426-1186 EXT 2276	Fax No. 519-426-1186
Role and responsibilities in emergency FIRE PREVENTION		E-mail marianne.tallian@norfolkcounty.ca	
Fire Services Address 95 Culver St, Simcoe, ON N3Y 2V5		Municipality Name and Address NORFOLK COUNTY, 8 SCHELLBURG AVENUE, SIMCOE ON N3Y 2J4	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Kuldip Sidhu	Official Title Owner
Signature 	Telephone No. 519-582-3391
	Date (dd-mmm-yyyy) 13-Dec-2016



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

3. Record of Emergency Training Provided - For most recent 12-month period.

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Training Date (dd-mmm-yyyy) 22-Dec-2016	Print Name of Training Provider: Dodsley Propane
	Print Name of Instructor: Derek Dodsley
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Training on the facility's Emergency Management Procedures provided to staff.

Training Date (dd-mmm-yyyy) 22-Dec-2016	Print Name of Training Provider: Dodsley Propane
	Print Name of Instructor: Derek Dodsley
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

On-site specific training provided to certificate holders / persons with Records of Training.

Training Date (dd-mmm-yyyy) 22-Dec-2016	Print Name of Training Provider: Dodsley Propane
	Print Name of Instructor: Derek Dodsley
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Kuldip Sidhu	Official Title Owner
Signature 	Telephone No. 519-582-3391
	Date (dd-mmm-yyyy) 13-Dec-2016



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416 231 4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

4. Emergency Training Plan for Coming Year

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Target Date (dd-mmm-yyyy) 22-Dec-2016 27-Jan-2017	Print Name of Training Provider: Dodsley Propane
	Print Name of Instructor: Derek Dodsley
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Training on the facility's Emergency Management Procedures provided to staff.

Target Date (dd-mmm-yyyy) 22-Dec-2016 27-Jan-2017	Print Name of Training Provider: Dodsley Propane
	Print Name of Instructor: Derek Dodsley
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

On-site specific training provided to certificate holders / persons with Records of Training.

Target Date (dd-mmm-yyyy) 22-Dec-2016 27-Jan-2017	Print Name of Training Provider: Dodsley Propane
	Print Name of Instructor: Derek Dodsley
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Kuldip Sidhu	Official Title Owner
Signature 	Telephone No. 519-582-3391
	Date (dd-mmm-yyyy) 13-Dec-2016



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

5. Emergency Response Communications Plan

Warnings and Actions

Describe who gives warnings to whom, and how and when the warning will be given (including public notification as appropriate).
In case of a fire, leakage, or any other incident, the staff on duty will call the Owner Operator on his cell phone, or home phone if necessary. If there is no answer, a call to 911 will be placed if necessary.

Describe what action is to be taken and by whom when a warning is issued (including details of a meeting place in a safe identified area and activating the evacuation plan, if necessary).
The staff on duty will immediately close the tank valve and shut off the power to the propane dispenser. They will also clear people from the area and move everyone to the safe area on the South end of the building. Additionally, they will attempt to extinguish any fire, if necessary, as long as it is safe to do so.

Communication with Emergency Response Authorities

Describe when and how the licence holder will give early warning to emergency response authorities (including a process to ensure that a call is placed to 911).
The staff on duty will call 911 through the business phone line, home phone, or cell. They will also phone the Owner Operator or alternate contact on their cell or home number immediately. The Owner Operator or Alternate Contact will ensure the 911 call was made.

Describe provisions for fire department entry when there are no operations or staffing at the propane site.
The propane refill centre will be located on the North East end of the property. Full access can be made by emergency service vehicles. The Fire Department has open access to the tanks through the driveway at the gas station.

Describe how the licence holder will ensure continual flow of updated information to authorities.
The owner Operator lives directly beside the store and propane refill centre. Authorities will kept informed using cell or land line phones.

How long will it take the facility liaison person to respond to the site.
Less than 5 minutes. The Owner Operator lives directly beside the facility. It is open 365 days per year and the Owner Operator works the majority of time.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Kuldip Sidhu	Official Title Owner	
Signature 	Telephone No. 519-582-3391	Date (dd-mmm-yyyy) 13-Dec-2016



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

6. Building and Site Security and Procedures

	Yes	No
1. Does the propane location have controlled access to limit unnecessary risk and entry (lock out procedures)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
2. Is there adequate night lighting at the site?	<input type="checkbox"/>	<input checked="" type="checkbox"/>
3. Are procedures in place that ensure access routes, aisles, storage area, filling areas and the grounds are kept clear from unwanted materials?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
4. Are there procedures that capture and record the daily inspection of hoses and inspection requirements for filling systems and mechanical devices used in the transfer of propane?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
5. Does the facility have procedures that include a process to isolate and purge any overfilled propane cylinders?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
6. Are weighing systems validated for accuracy?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
7. Are storage areas clearly marked with the vessels' capacity status (i.e., filled, empty, purged and other hazardous materials)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
8. Are quality assurance procedures in place to ensure that all valves are closed after the propane cylinders are filled?(e.g., QCC valves)	<input checked="" type="checkbox"/>	<input type="checkbox"/>
9. Is the schedule of maintenance and testing activities retained on site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>

7. Water Supply

The propane licence holder should work with the local fire department to determine water supply capabilities that are available based on the propane facility's location.

	Yes	No
1. Is a pressurized water system available at the propane facility site?	<input type="checkbox"/>	<input checked="" type="checkbox"/>
2. Can the municipal fire department pump 375 GPM (1420 LPM) of water at this location?	<input type="checkbox"/>	<input checked="" type="checkbox"/>
3. What is the unobstructed distance to the closest water supply that could be used for firefighting activities? (distance in metres only)		<u>9 KM (HYDRANT)</u>
4. What is the unobstructed distance to the closest approved water supply with year round access if there are no hydrants? (distance in metres only)		<u>7 KM</u>

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Kuldip Sidhu	Official Title Owner
Signature 	Telephone No. 519-582-3391
	Date (dd-mmm-yyyy) 13-Dec-2016



Technical Standards and Safety Authority
 www.tssa.org
 14th Floor - Centre Tower
 3300 Bloor Street West
 Toronto Ontario M8X 2X4
 Fax: 416.231.4078
 Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
 Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

8. Licence holder and local Fire Services Review

To be completed by the Local Fire Services		Yes	No
Has the local fire service had an opportunity to review the Emergency Response and Preparedness Plan?		<input checked="" type="checkbox"/>	<input type="checkbox"/>
If not, please explain (e.g., no fire services).			
Fire services comments, if any: <i>NO COMMENTS</i>			
To be completed by the Licence Holder			
In response to the above comments, the following action(s) is required.			
The licence holder will respond to the Local Fire Services comments by: _____			
(dd-mmm-yyyy)			

LOCAL FIRE SERVICES

The undersigned has reviewed Section B of the Risk and Safety Management Plan Fire Services.

Local Fire Services Name	Print name <i>SCOTT PIPE</i>	Signature <i>[Signature]</i>	Date (dd-mmm-yyyy) <i>DEC 13/16</i>
--------------------------	---------------------------------	---------------------------------	--

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Kuldip Sidhu	Official Title Owner
Signature <i>[Signature]</i>	Telephone No. 519-582-3391
	Date (dd-mmm-yyyy) 13-Dec-2016



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS
Applicant must include a Facility Site Plan and Map of Surrounding Area

Facility Site Plan.

The licence holder will submit a copy of the original facility site plan updated with the following information:

1. The storage location of fixed, portable, and mobile vessels.
2. The maximum volume, types and storage location of hazardous materials.
3. Location of permanent structures on site.
4. Access and egress points and location of barriers.
5. Location of fire and emergency equipment (e.g., sprinkler systems, extinguishers, suppression systems) on site and location of fire hydrant or water supply where available.
6. Location of emergency shut off/shut down switches/valves.

Map of Surrounding Area.

The licence holder will submit a scaled aerial map of the surrounding area showing the following information:

7. The capacity and placement of the single largest propane storage vessel, including its setback from the front, rear and side property lines.
8. GPS co-ordinates of the single largest vessel.
9. Visual indication of the single largest fixed vessel and a circle made using the distance in Table 1 as the radius from the single largest fixed vessel.
10. Clear indication of the municipality or municipalities present within the circle.
11. Visual indication of property line information.
12. The location and name of roads within or abutting the site.
13. Key note to the drawing indicating the facility's municipal address, municipal lot number(s) and concession lines as applicable, and the date the map was prepared.
14. Address and contact information for each municipality (municipal clerk or secretary-treasurers of planning board). (Refer to page 5.)
15. Complete "Required Mapping Information from Updated Site Plan" in table below .

Required Mapping Information from Updated Site Plan

Date map prepared (dd-mmm-yyyy) 15-Dec-2016	Capacity of single largest propane storage vessel (USWG) 1000 USWG
Tank setback coordinates. Indicate placement on the map.	
Front: 25 Ft	Right side property line: 240 Ft
Rear: 62 Ft	Left side property line: 34 Ft
GPS coordinates of single largest vessel: 42.780832, -80.452432	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Kuldip Sidhu	Official Title Owner	
Signature 	Telephone No. 519-582-3391	Date (dd-mmm-yyyy) 13-Dec-2016



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)
Applicant must include a Facility Site Plan and Map of Surrounding Area


Table 1: Distance Table

Water Capacity (litres)	Nominal Water Capacity (USWG)	Distance to 1 psi overpressure (m)
1,890	500	155
3,780	1,000	195
4,920	1,300	213
6,620	1,750	235
7,130	1,885	241
7,560	2,000	246
18,900	5,000	333

Formula: $D = 16.94 \times (1.524 \times C)^{1/3}$
 D = Distance to overpressure of 1 psi (meters)
 C = Tank Total Capacity in USWG

Parameters: Density of Propane is 0.5033 kg per litre @ 15 C
 Assume all vessels are 80% full
 1 gallon [US, liquid] = 0.003785411784 cubic meter
 1 cubic metre = 264.17 USWG

Hazard Distance Chart (EPA-TNT model)

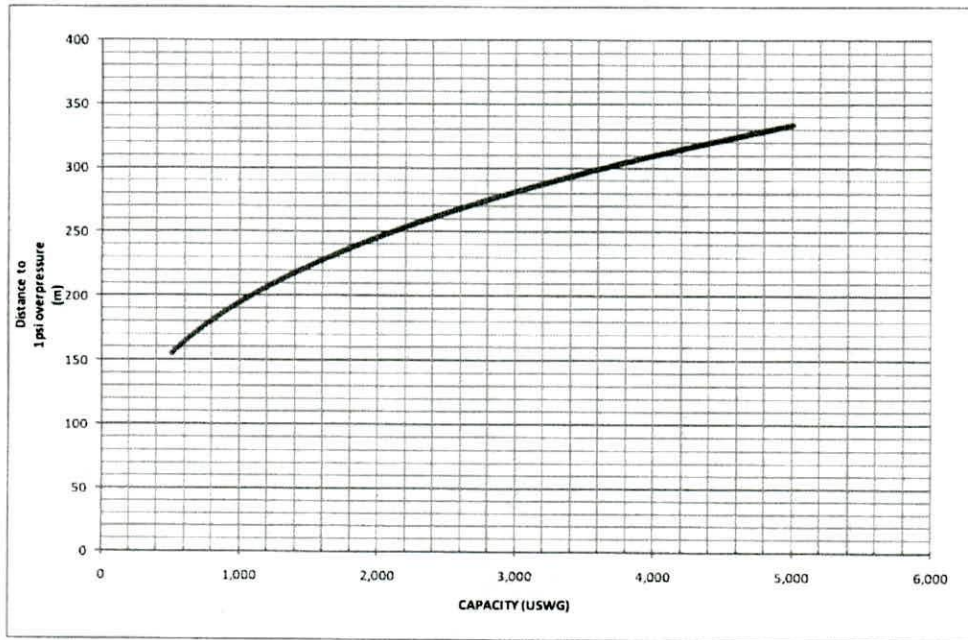



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)
Applicant must include a Facility Site Plan and Map of Surrounding Area

As an accompaniment to the Map of Surrounding Area, provide the following information about buildings and features present within the circle in Table 2.

Table 2: Buildings and Features

Buildings and Features Present within the Circle on the Map of the Surrounding Area AND Name and Address of Closest Building or Feature	* Number of Buildings and Features (mark with an "X")				Distance from Tank to Closest Building or Feature
	0	1	2-10	11+	
Industrial buildings or parks or golf courses Name: _____ Address: _____ City: _____ Province _____ Postal Code _____	0				_____ m
Residential building units specifically permanent single family dwellings, condominiums, and apartments. [Redacted]				x	28 m
Commercial building units specifically retail, restaurants, entertainment, theatres, and sporting complexes. Name: _____ Address: _____ City: _____ Province _____ Postal Code _____	0				_____ m
Commercial building units – continuous occupancy specifically hotels, campgrounds, and resorts. Name: Kuldip Sidhi Address: 489 McDowell rd E City: Simcoe Province On Postal Code N3Y 4J9				x	28 m
Sensitive institutions specifically hospitals, schools and day cares, nursing and retirement homes, mental health institutions, and prisons. Name: _____ Address: _____ City: _____ Province _____ Postal Code _____	0				_____ m
Emergency responders specifically fire stations, ambulance stations, and police stations. Name: _____ Address: _____ City: _____ Province _____ Postal Code _____	0				_____ m

* For multi-unit buildings, count each unit as "1".

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Kuldip Sidhu	Official Title Owner	
Signature 	Telephone No. 519-582-3391	Date (dd-mmm-yyyy) 13-Dec-2016



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

WORKSHEET

Portable Storage Additional Information Worksheet

Cylinder Size	Capacity in USWG	Quantity	Total Volume in USWG
# 420	123.9		
# 100	29.5		
# 40	11.75		
# 33.3	9.62		
# 30	8.8		
# 20	5.8	60	348
# 10	2.9		
# 5	1.5		
Total Cylinder Capacity		348	

Tanks Stored On-site Not Connected for Use

Tank Size In USWG	Quantity	Total Volume in USWG
N/A		
Total Tank Capacity		

Total Cylinder Capacity	348
Total Tank Capacity	1000
Total Portable Capacity (Total Cylinder Capacity + Total Tank Capacity)	1348 USWG

Date: 15-Dec-2016

Capacity: 1000 USWG
Serial No. 3256L
PSIG: 250
GPS Coordinates:
42.780832, -80.452432


Zoning Compliance Officer / Bylaw
Clerk Marrienne Tallian
8 Schellburg Avenue, Simcoe ON
N3Y 2J4
519-426-4377 Ext. 2276

Municipal Address:
Norfolk County
489 McDowell Rd East, Simcoe ON
N3Y 4J9
Assessment Roll
3310-493-010-47400

Tank Setback Coordinates
Front Side Property Line: 25Ft
Rear Side Property Line: 62 Ft
Right Side Property Line: 240 Ft
Left Side Property Line: 34 Ft

Branch Standard #9 Compliance
Sum of Area E plus .1 times Area F
= 7812.5Ft²

Legend

 489 McDowell Rd E

75 Ft Radius

62 Ft Rear Property Line

240 Ft Right Property Line

Fire Extinguisher Inside Cabinet

Emergency Stop

34Ft Left Property Line

25 Ft Front Property Line

Emergency Stop Inside

489 McDowell Rd E

Google Earth

© 2016 Google



10 m

Date: 15-Dec-2016

Capacity: 1000 USWG
Serial No. 3256L
PSIG: 250
GPS Coordinates:
42.780832, -80.452432



Zoning Compliance Officer / Bylaw
Clerk Marrienne Tallian
8 Schellburg Avenue, Simcoe ON
N3Y 2J4
519-426-4377 Ext. 2276

Municipal Address:
Norfolk County
489 McDowell Rd East, Simcoe ON
N3Y 4J9
Assessment Roll
3310-493-010-47400

Tank Setback Coordinates
Front Side Property Line: 25Ft
Rear Side Property Line: 62 Ft
Right Side Property Line: 240 Ft
Left Side Property Line: 34 Ft

Branch Standard #9 Compliance
Sum of Area E plus .1 times Area F
= 7812.5Ft²

Legend

-  489 McDowell Rd E
-  Property Line Setbacks

195m Distance to 1PSI Overpressure

300 Ft Radius

75 Ft Radius

489 McDowell Rd E

McDowell Rd E

Charlotteville West Quarter Line


Google Earth

© 2016 Google




100 m

2485399 ONTARIO INC.
 489 MCDOWELL ROAD EAST
 SIMCOE ONTARIO, N3Y 4J9



Facility Site Plan

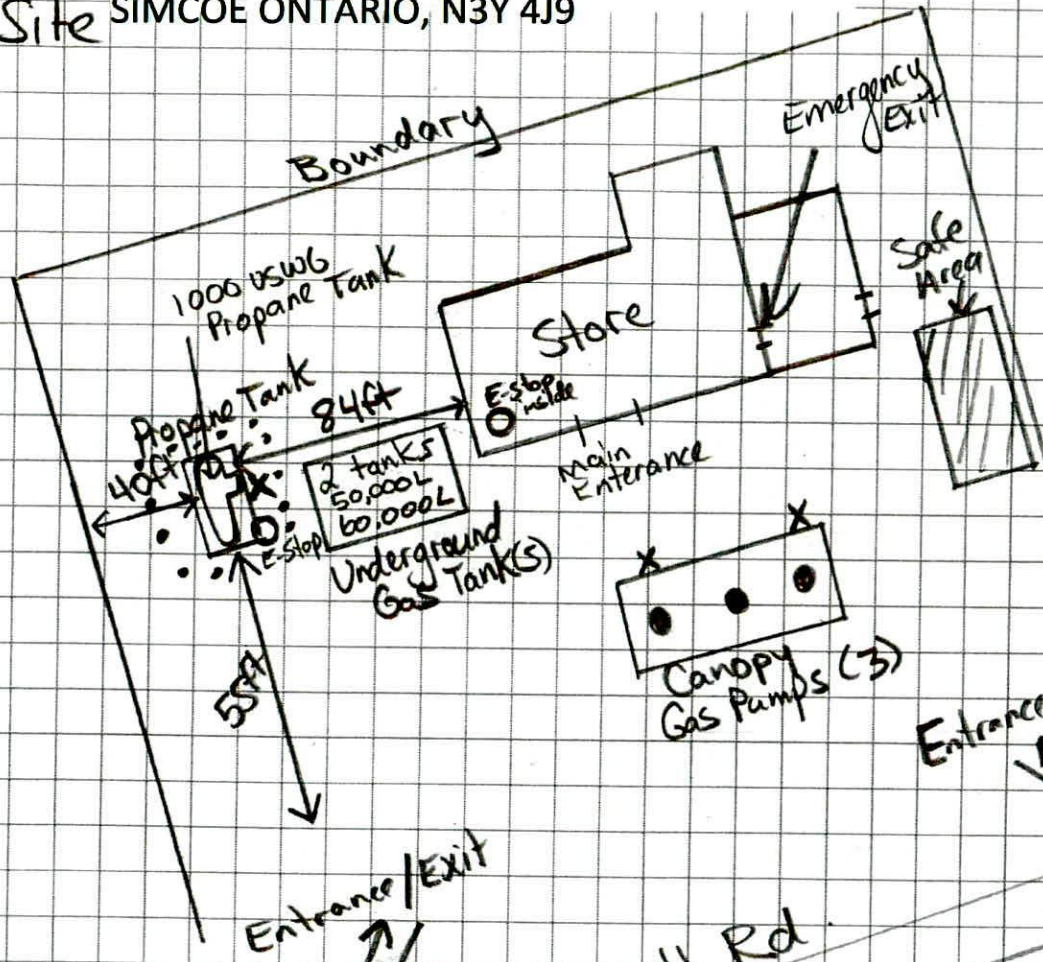

- X Fire Extinguisher
- No Smoking
- No Ignition
- Emergency Stop (E-Stop).

Free Plain Graph Paper from <http://incompetech.com/graphpaper/plain/>

Pine Grove