




Technical Standards and Safety Authority
 www.tssa.org
 14th Floor - Centre Tower
 3300 Bloor Street West
 Toronto Ontario M8X 2X4
 Fax: 416.231.4078
 Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
 Technical Standards and Safety Act
 Propane Storage and Handling Regulation

This Level 1 RSMP applies to:

- a facility with a total propane storage capacity of 5,000 litres
- a facility with a fixed propane storage capacity of 5,000 litres
- USWG of portable propane storage capacity on site

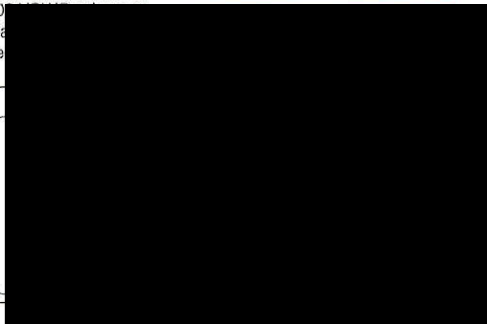

Failure to fully complete this form may result in rejection.
 Making a false statement may result in a fine or prosecution under the *Technical Standards and Safety Act*

Licence Number

Check applicable type of propane operations.

Cylinder Motor Fill Filling Plant Card/Keylock

Submit along with this completed application a Facility Site Plan and a Map of the Surrounding Area.

SECTION A: GENERAL INFORMATION

The Undersigned applies to TSSA for a review for an RSMP under Ontario's *Technical Standards and Safety Act*, Propane Storage and Handling Regulation.

Company Name Corporation No.

A Fish Bay Marina

Operator Name (if different from above)

kevin Simpkin

Telephone No. Fax No. E-mail

705-724-3130 info@fisbaymarina.com

B Street No. Street Name / 911 Number / Address, if applicable

502 Lake Nipissing Road

Town / City or Township / County Province Postal Code

Nipissing ON POH-1W0

Mailing address if different from above.

C Street No. Street Name / 911 Number / Address, if applicable

same

Town / City or Township / County Province Postal Code

Information on Container Refill Centre or Filling Plant

Location of facility.

Street No. Street Name / 911 Number / Address, if applicable Nearest Major Intersection

D same

Town / City or Township / County Province Postal Code

Name of Licence Holder

Kevin Simpkin

Name of a Senior Management person as defined in the regulation holding the Record of Training (ROT). ROT type

Kevin Simpkin Pump Attendant 100% / 11

Municipality (or municipalities if the facility or its hazard distance touches multiple borders)

Nipissing Township

Hours of operation

This document is valid until the next licence renewal date. You are required by law to notify TSSA of any change of information.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Printname	Signature	Date (dd-mmm-yyyy)
Name of Licence Holder Kevin Simpkin		
Name of Senior Management person as defined in the Regulation holding the Record of Training Kevin Simpkin		31-03-2016



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION A: GENERAL INFORMATION (cont'd)

Indicate the year the facility was established. 2015 in progress Indicate the year of any significant modifications, as defined in s.1, O.Reg 211/01, since establishment. NONE N/A

Identify the psig rating and serial number for each fixed propane storage tank on site.

	PSIG	Serial Number
Tank1:	<u>250</u>	<u>340-1</u>
Tank2:	_____	_____
Tank3:	_____	_____

Enter capacity of propane in USWG, fixed, portable, and mobile, and provide detailed inventory that includes the number of tank/vessel for each type (fixed, portable, and mobile) and the capacity of each tank/vessel, on a separate document.

Fixed: 1000 USWG Portable: NONE Mobile: NONE

117 as per page 15

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Kevin Simpkin	Official Title owner/operator	
Signature 	Telephone No. 705-724-3130	Date (dd-mmm-yyyy) 03-31-2016



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION A: GENERAL INFORMATION (cont'd)

Activity Information

Name of Propane Supplier(s) Moore Propane Limited		For Office Use - Party No.	
Street No. 56	Street Name / 911 Number / Address, if applicable Gibson St		
Town / City or Township / Country North Bay		Province On	Postal Code P1B-8Z4
Telephone No. 705-476-2334	Fax No. 705-476-9908	Contact Name Bruce Moore	
E-mail bruce@moorepropane.ca			

Name of Propane Transporter. If same as above, please check box. <input checked="" type="checkbox"/>		For Office Use - Party No.	
Street No.	Street Name / 911 Number / Address, if applicable		
Town / City or Township / Country		Province	Postal Code
Telephone No.	Fax No.	Contact Name	
E-mail			

Off-site Cylinder and/or Mobile Storage n/a	Capacity stored off-site, in USWG	For Office Use - Party No.
Street No.	Street Name / 911 Number / Address, if applicable	
Town / City or Township / Country		Postal Code
Telephone No.	Fax No.	Contact Name

Note: Customer storage is not considered off-site storage.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Kevin Simpkin	Official Title owner/operator	
Signature 	Telephone No. 705-724-3130	Date (dd-mmm-yyyy) 31-03-2016



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN

The licence holder will complete Section B in consultation with the local Fire Services.

Description of the maximum volume, types and storage location of other hazardous materials on site, if any.

This site also operates a small marina Lic # 000186801. The propane tank is located approximately 58 m from the 4500 litres aboveground fuel tank

Description of fire and emergency equipment indicated on facility site map.

Fire extinguishers at propane tank and in store.

List of fire protection controls (e.g., fire detection systems, fire notification systems, alarm systems, automatic shut off devices, fusible links, etc.) and describe their function, use and operation.

Fusible link on cable operated Internal safety control valve, if fire should occur at or under propane tank the fusible link will shut off the flow of propane when fusible links melts, Electrical Emergency Shut off . shut the power supply to dispenser which closes the solenoid valve which stops the flow of propane to the dispenser hose. located at propane tank. Electrical shut off at main power supply.

Maintenance and testing schedule for fire protection controls and devices.

Fire extinguishers are inspected monthly by staff and yearly by fuel supplier

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Kevin Simpkin		Official Title owner/operator
Signature 		Telephone No. 705-724-3130
		Date (dd-mmm-yyyy)



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

1. Contacts for Emergency Response

1. Facility Contact Personnel - Key Contact		5. Facility 24-Hour Contact Person	
Name Kevin Simpkin	For Office Use - Party No.	Name Kevin Simpkin	For Office Use - Party No.
Official Title owner/operator		Official Title owner/operator	
Telephone No. 705-724-3130	Fax No.	Cell No. 705-825-3474	Fax No.
E-mail info@fishbaymarina.com		E-mail info@fishbaymarina.com	
Role and responsibilities in emergency Coordinator for planning and activating emergency response-calling 911 & TSSA		Role and responsibilities in emergency Coordinator for planning and activating emergency response-calling 911 & TSSA	
2. Facility Contact Personnel - Alternate Contact		6. Name of Facility Manager	
Name Samantha Simpkin	For Office Use - Party No.	Name Kevin Simpkin	For Office Use - Party No.
Official Title owner/operator		Official Title owner/operator	
Telephone No. 705-724-3130	Fax No.	Telephone No. 705-724-3130	Fax No.
E-mail info@fishbaymarina.com		E-mail info@fishbaymarina.com	
Role and responsibilities in emergency Alternate -Coordinator for planning and activating emergency response-calling 911 & TSSA		Role and responsibilities in emergency Alternate -Coordinator for planning and activating emergency response-calling 911 & TSSA	
3. Local Fire Services - Key Contact		7. Propane Supplier Key Contact Person	
Name Will Bateman	For Office Use - Party No.	Name Bruce Moore	For Office Use - Party No.
Official Title Deputy Fire Chief	E-mail admin@nipissingtownship.com	Official Title owner/operator	E-mail bruce@moorepropane.ca
Telephone No. 705-493-1837	Fax No. 705-724-5385	Telephone No. 705-476-2334	Fax No. 705-476-9906
Role and responsibilities in emergency Deputy Fire Chief will take lead on arrival		Role and responsibilities in emergency Verifies emergency services and TSSA as been contacted	
Fire Services Address 45 Beatty St Nipissing On P0H-1W0		Propane Supplier Address 56 Gibson St North Bay On. P1B-8Z4	
4. Local Fire Services - Alternate Contact		8. Municipal Contact	
Name Jim Warren	For Office Use - Party No.	Name Charles Barton	For Office Use - Party No.
Official Title Acting Chief	E-mail admin@nipissingtownship.com	Official Title Chief Administration Officer/Clerk	
Telephone No. 705-477-4514	Fax No. 705-724-5385	Telephone No. 705-724-2144	Fax No. 705-724-5385
Role and responsibilities in emergency Will Take over role of Deputy fire chief when fire chief not available		E-mail admin@nipissingtownship.com	
Fire Services Address 45 Beatty St Nipissing On P0H-1W0		Municipality Name and Address Township Of Nipissing 45 Beatty Street Nipissing on P0H-1W0	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Kevin Simpkin	Official Title owner/operator
Signature 	Telephone No. 705-724-3130
	Date (dd-mmm-yyyy)



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario MBX 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

2. Additional Safety Measures

Describe any other measures in place at the facility that exceed the minimum Code and Standards requirements.

n/a

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Kevin Simpkin	Official Title owner/operator	
Signature 	Telephone No. 705-724-3130	Date (dd-mmm-yyyy) 31-03-2016



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

3. Record of Emergency Training Provided - For most recent 12-month period.

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Training Date (dd-mmm-yyyy) 04/11/2015	Print Name of Training Provider: Canadian Propane Association
	Print Name of Instructor: Richard Tetreault
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Training on the facility's Emergency Management Procedures provided to staff.

Training Date (dd-mmm-yyyy) 04/11/2015	Print Name of Training Provider: Canadian Propane Association
	Print Name of Instructor: Richard Tetreault
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

On-site specific training provided to certificate holders / persons with Records of Training.

Training Date (dd-mmm-yyyy) 04/11/2015	Print Name of Training Provider: Canadian Propane Association
	Print Name of Instructor: Richard Tetreault
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Kevin Simpkin	Official Title owner/operator
Signature 	Telephone No. 705-724-3130
	Date (dd-mmm-yyyy) 31-03-2016



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

4. Emergency Training Plan for Coming Year

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Target Date (dd-mmm-yyyy) <i>04/11/2015</i>	Print Name of Training Provider: Canadian Propane Association
	Print Name of Instructor: Richard Tetreault
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Training on the facility's Emergency Management Procedures provided to staff.

Target Date (dd-mmm-yyyy) <i>04/11/2015</i>	Print Name of Training Provider: Canadian Propane Association
	Print Name of Instructor: Richard Tetreault
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

On-site specific training provided to certificate holders / persons with Records of Training.

Target Date (dd-mmm-yyyy) <i>04/11/2015</i>	Print Name of Training Provider: Canadian Propane Association
	Print Name of Instructor: Richard Tetreault
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Kevin Simpkin	Official Title owner/operator
Signature 	Telephone No. 705-724-3130
	Date (dd-mmm-yyyy) <i>31-03-2016</i>



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

5. Emergency Response Communications Plan

Warnings and Actions

Describe who gives warnings to whom, and how and when the warning will be given (including public notification as appropriate).
If an incident should occur. 1=the owner/ operator will assess the situation and take proper action to control the incident. 2=if the owner operator can not control the situation He will evacuate the immediate area and contacted emergency services by calling 911 and the propane fuel supplier. The fuel supplier will contact TSSA

Describe what action is to be taken and by whom when a warning is issued (including details of a meeting place in a safe identified area and activating the evacuation plan, if necessary).
The owner operator will evacuate the area of clients to safe distance. The personnel will meet at the corner of Lake Nipissing Rd. and Promised L R. at which point the fire department will take control of the situation.

Communication with Emergency Response Authorities

Describe when and how the licence holder will give early warning to emergency response authorities (including a process to ensure that a call is placed to 911).
If an incident should occur. 1=the owner/ operator will assess the situation and take proper action to control the incident. 2=if the owner operator can not control the situation He will evacuate the immediate area and contacted emergency services by calling 911 and the propane fuel supplier. The fuel supplier will contact TSSA. When the fuel supplier is contacted he will verify that the owner operator as contacted 911

Describe provisions for fire department entry when there are no operations or staffing at the propane site.
Owner / operator lives on site. The propane fuel supplier as is contact information on the propane supply tank and the the client contact information available true the propane supplier.

Describe how the licence holder will ensure continual flow of updated information to authorities.
The owner operator will contact the Propane fuel supplier which in turn will keep the authorities advised.

How long will it take the facility liaison person to respond to the site.
The owner live on site.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Kevin Simpkin	Official Title owner/operator
Signature 	Telephone No. 705-724-3130
	Date (dd-mmm-yyyy) 31-03-2016



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

6. Building and Site Security and Procedures

- | | Yes | No |
|---|-------------------------------------|--------------------------|
| 1. Does the propane location have controlled access to limit unnecessary risk and entry (lock out procedures)? | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 2. Is there adequate night lighting at the site? | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 3. Are procedures in place that ensure access routes, aisles, storage area, filling areas and the grounds are kept clear from unwanted materials? | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 4. Are there procedures that capture and record the daily inspection of hoses and inspection requirements for filling systems and mechanical devices used in the transfer of propane? | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 5. Does the facility have procedures that include a process to isolate and purge any overfilled propane cylinders? | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 6. Are weighing systems validated for accuracy? | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 7. Are storage areas clearly marked with the vessels' capacity status (i.e., filled, empty, purged and other hazardous materials)? | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 8. Are quality assurance procedures in place to ensure that all valves are closed after the propane cylinders are filled?(e.g., QCC valves) | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 9. Is the schedule of maintenance and testing activities retained on site? | <input checked="" type="checkbox"/> | <input type="checkbox"/> |

7. Water Supply

The propane licence holder should work with the local fire department to determine water supply capabilities that are available based on the propane facility's location.

- | | Yes | No |
|---|-------------------------------------|-------------------------------------|
| 1. Is a pressurized water system available at the propane facility site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| 2. Can the municipal fire department pump 375 GPM (1420 LPM) of water at this location? | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 3. What is the unobstructed distance to the closest water supply that could be used for firefighting activities? (distance in metres only) | <u>20 m</u> | |
| 4. What is the unobstructed distance to the closest approved water supply with year round access if there are no hydrants? (distance in metres only) | <u>20 m</u> | |

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Kevin Simpkin	Official Title owner/operator	
Signature 	Telephone No. 705-724-3130	Date (dd-mmm-yyyy) 31-07-2016



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

8. Licence holder and local Fire Services Review

To be completed by the Local Fire Services

Has the local fire service had an opportunity to review the Emergency Response and Preparedness Plan?

Yes

No

If not, please explain (e.g., no fire services).

Fire services comments, if any:

To be completed by the Licence Holder

In response to the above comments, the following action(s) is required:

The licence holder will respond to the Local Fire Services comments by: _____ (dd-mmm-yyyy)

LOCAL FIRE SERVICES

The undersigned has reviewed Section B of the Risk and Safety Management Plan Fire Services.

Print name	Signature	Date (dd-mmm-yyyy)
Local Fire Services Name <u>Will Bateman</u>		<u>28/06/2016</u>

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Kevin Simpkin	Official Title owner/operator	Date (dd-mmm-yyyy)
Signature 	Telephone No. 705-724-3130	31-03-2016



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS

Applicant must include a Facility Site Plan and Map of Surrounding Area

Facility Site Plan.

The licence holder will submit a copy of the original facility site plan updated with the following information:

1. The storage location of fixed, portable, and mobile vessels.
2. The maximum volume, types and storage location of hazardous materials.
3. Location of permanent structures on site.
4. Access and egress points and location of barriers. *FENCES IN TANK. MAIN GATE IN FRONT & BACK*
5. Location of fire and emergency equipment (e.g., sprinkler systems, extinguishers, suppression systems) on site and location of fire hydrant or water supply where available.
6. Location of emergency shut off/shut down switches/valves.

Map of Surrounding Area.

The licence holder will submit a scaled aerial map of the surrounding area showing the following information:

7. The capacity and placement of the single largest propane storage vessel, including its setback from the front, rear and side property lines.
8. GPS co-ordinates of the single largest vessel.
9. Visual indication of the single largest fixed vessel and a circle made using the distance in Table 1 as the radius from the single largest fixed vessel.
10. Clear indication of the municipality or municipalities present within the circle.
11. Visual indication of property line information.
12. The location and name of roads within or abutting the site.
13. Key note to the drawing indicating the facility's municipal address, municipal lot number(s) and concession lines as applicable, and the date the map was prepared.
14. Address and contact information for each municipality (municipal clerk or secretary-treasurers of planning board). (Refer to page 5.)
15. Complete "Required Mapping Information from Updated Site Plan" in table below .

Required Mapping Information from Updated Site Plan

Date map prepared (dd-mmm-yyyy) <i>14/07/2016</i>	Capacity of single largest propane storage vessel (USWG) 1000 USWG
Tank setback coordinates. Indicate placement on the map.	
Front: 50 m	Right side property line: 103 m
Rear: 170 m	Left side property line: 31 m
GPS coordinates of single largest vessel:	N 46 07.171 W079 31.844

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Kevin Simpkin	Official Title owner/operator	
Signature 	Telephone No. 705-704-3130	Date (dd-mmm-yyyy) 31-07-2016



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)

Applicant must include a Facility Site Plan and Map of Surrounding Area


Table 1: Distance Table

Water Capacity (litres)	Nominal Water Capacity (USWG)	Distance to 1 psi overpressure (m)
1,890	500	155
3,780	1,000	195
4,920	1,300	213
6,620	1,750	235
7,130	1,885	241
7,560	2,000	246
18,900	5,000	333

Formula: $D = 16.94 \times (1.524 \times C)^{1/3}$
 D = Distance to overpressure of 1 psi (meters)
 C = Tank Total Capacity in USWG

Parameters: Density of Propane is 0.5033 kg per litre @ 15 C
 Assume all vessels are 80% full
 1 gallon [US, liquid] = 0.003785411784 cubic meter
 1 cubic metre = 264.17 USWG

Hazard Distance Chart (EPA-TNT model)

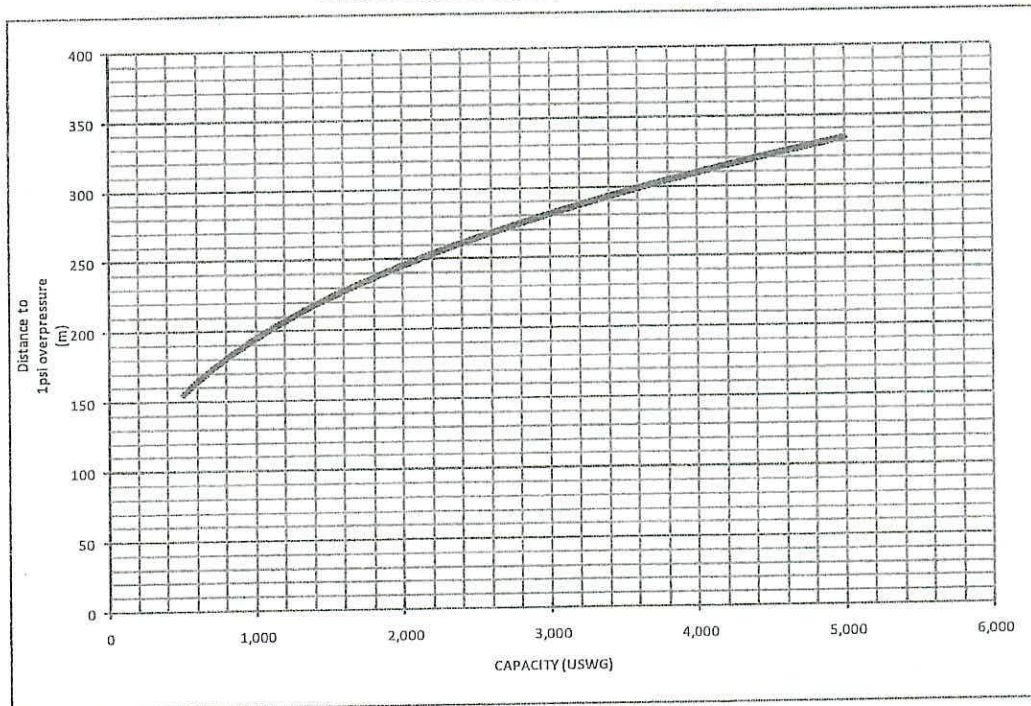



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)

Applicant must include a Facility Site Plan and Map of Surrounding Area

As an accompaniment to the Map of Surrounding Area, provide the following information about buildings and features present within the circle in Table 2.

Table 2: Buildings and Features

Buildings and Features Present within the Circle on the Map of the Surrounding Area AND Name and Address of Closest Building or Feature	* Number of Buildings and Features (mark with an "X")				Distance from Tank to Closest Building or Feature
	0	1	2-10	11+	
Industrial buildings or parks or golf courses Name: <u>Fish Bay Marina Boat storage</u> Address: <u>502 lake Nipissing Road</u> City: <u>Nipissing</u> Province <u>ON</u> Postal Code <u>POH-1W0</u>		x			<u>58</u> m
Residential building units specifically permanent single family dwellings, condominiums, and apartments. [Redacted]			x		<u>72</u> m
Commercial building units specifically retail, restaurants, entertainment, theatres, and sporting complexes. Name: <u>Angler Haven/ Wade landing</u> Address: <u>488B lake Nipissing Road</u> City: <u>Nipissing</u> Province <u>On</u> Postal Code <u>POH-IW0</u>		x			<u>65</u> m
Commercial building units – continuous occupancy specifically hotels, campgrounds, and resorts. Name: <u>Fish Bay Marina (Travel Trailer Parking)</u> Address: <u>502 lake Nipissing Road</u> City: <u>Nipissing</u> Province <u>ON</u> Postal Code <u>POH-1W0</u>			x		<u>100</u> m
Sensitive institutions specifically hospitals, schools and day cares, nursing and retirement homes, mental health institutions, and prisons. Name: <u>n/a</u> Address: _____ City: _____ Province _____ Postal Code _____	x				_____ m
Emergency responders specifically fire stations, ambulance stations, and police stations. Name: <u>Nipissing Township Fire Station # 2</u> Address: <u>3509 HWY 534</u> City: <u>Nipissing</u> Province <u>On</u> Postal Code <u>POH-1W0</u>		X			<u>8.3 KM</u> m

* For multi-unit buildings, count each unit as "1".

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Kevin Simpkin	Official Title owner/operator
Signature 	Telephone No. 705-724-3130
	Date (dd-mmm-yyyy)



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

WORKSHEET

Portable Storage Additional Information Worksheet


Cylinder Size	Capacity in USWG	Quantity	Total Volume in USWG
# 420	123.9		
# 100	29.5	2	59
# 40	11.75		
# 33.3	9.62		
# 30	8.8		
# 20	5.8	10	58
# 10	2.9		
# 5	1.5		
Total Cylinder Capacity			117 USWG

Tanks Stored On-site Not Connected for Use

Tank Size In USWG	Quantity	Total Volume in USWG
Total Tank Capacity		

Total Cylinder Capacity	117 uswg
Total Tank Capacity	1000 uswg
Total Portable Capacity (Total Cylinder Capacity + Total Tank Capacity)	1117 uswg

Map of Surrounding Area

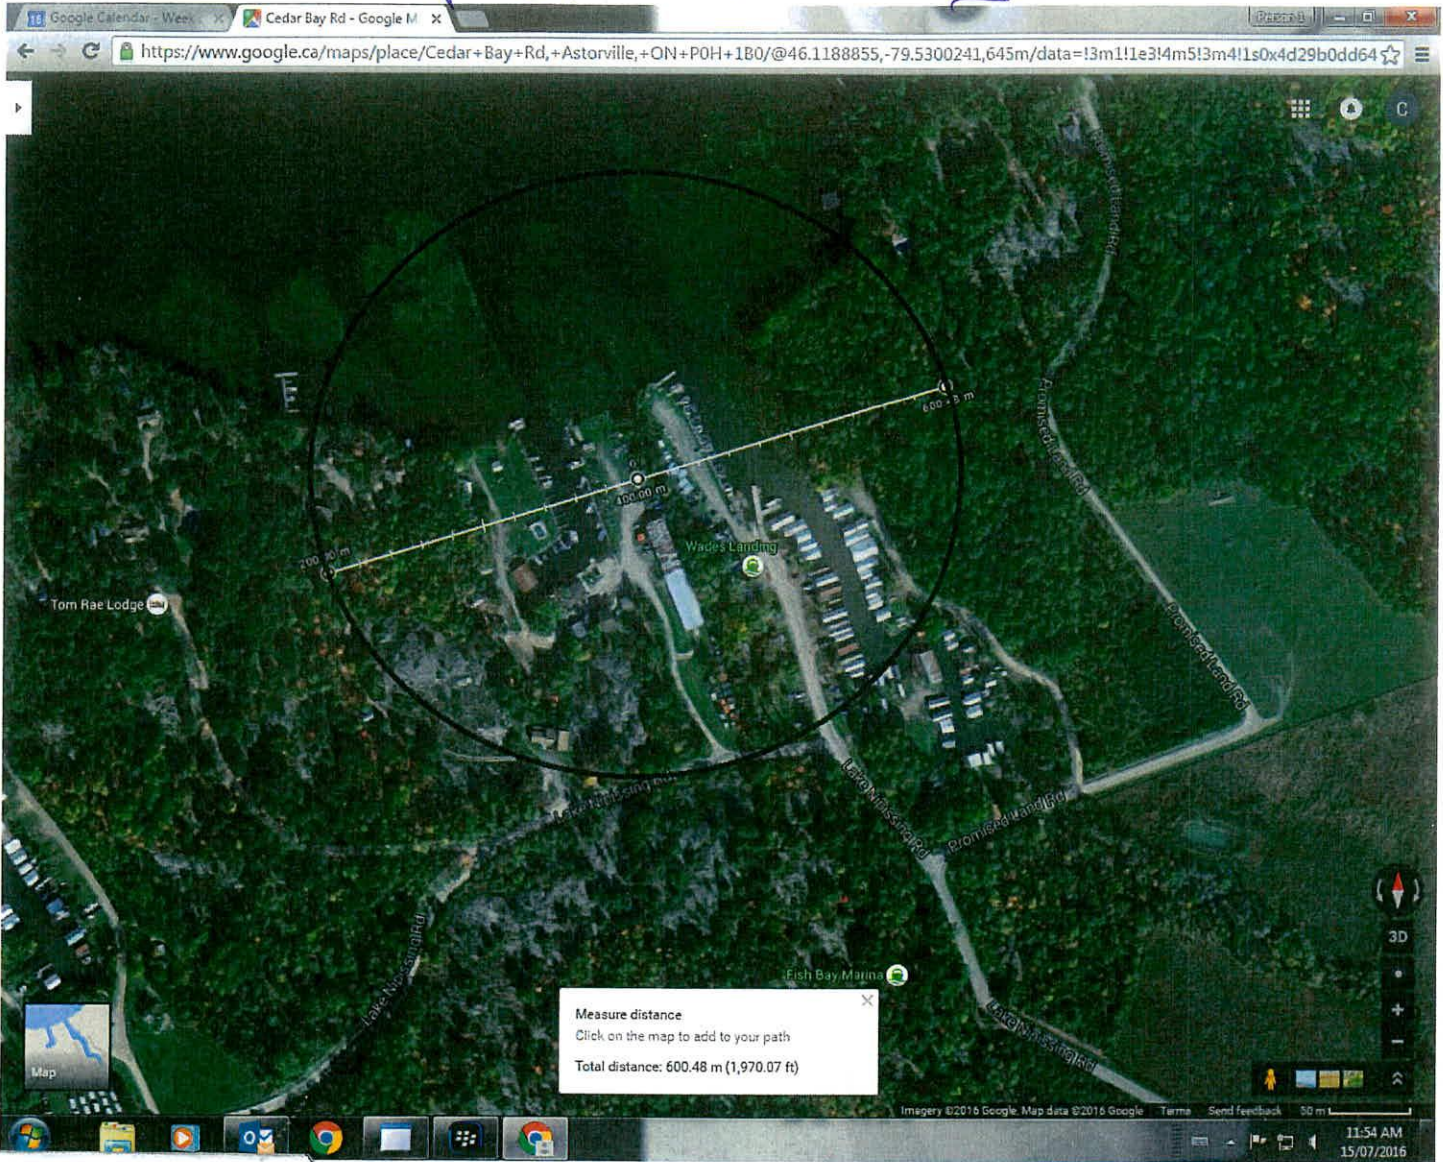

Fire Extinguisher

- 1 at propane dispenser
- 1 in store

Shut-Off

- Emergency shut-off at dispenser
- Power shut-off in store

LEGEND	
	Industrial/Commercial
	Residential Area
	Highway
	Road
	Gas Station

KennKart Digital Mapping ©2015

GPS N 46,07,171 - W 079 31,844

Municipality: Township of Nipissing

Municipality Contact

Chief Administration Officer/ Clerk

Mr. Charles Barton

705-724-2144

45 Beatty Street Nipissing P0H-1W0

Nominal Water Capacity (USWG)	Distance to Endpoint (m)
500	155
1000	195
1,300	213
1,750	235
1,885	241
2,000	246
5,000	333

Moora Propane Ltd. ©2015

Fish Bay Marina


502 Lake Nipissing Road, Nipissing, Ontario, Canada, P0H 1W0

Facility Site Plan

Risk and Safety Management Plan PUBLIC RECEPTORS WITHIN HAZARD DISTANCE

Township of Nipissing

Scale: 1:2 380

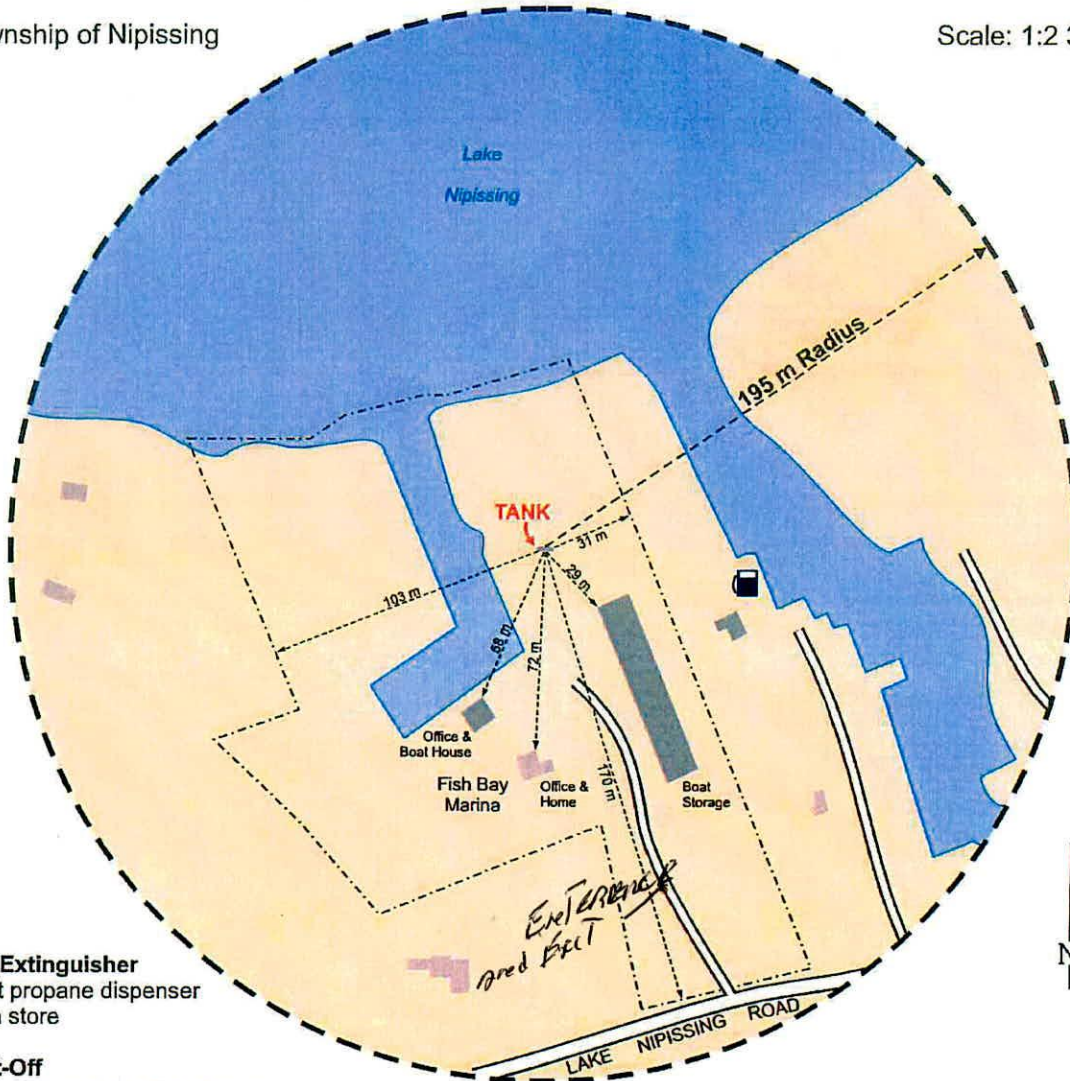

- Fire Extinguisher**
- 1 at propane dispenser
 - 1 in store

- Shut-Off**
- Emergency shut-off at dispenser
 - Power shut-off in store

LEGEND	
	Industrial/Commercial
	Residential Area
	Highway
	Road
	Gas Station

KemKart Digital Mapping, 2015

GPS N 46,07,171 - W 079 31.844
 Municipality: Township of Nipissing
 Municipality Contact
 Chief Administration Officer/ Clerk
 Mr. Charles Barton
 705-724-2144
 45 Beatty Street Nipissing P0H-1W0

Nominal Water Capacity (USWG)	Distance to Endpoint (m)
500	155
1000	195
1,300	213
1,750	235
1,885	241
2,000	246
5,000	333

Moore Propane Ltd., 2015

Fish Bay Marina
 502 Lake Nipissing Road, Nipissing, Ontario, Canada, P0H 1W0

