



Technical Standards and Safety Authority
 www.tssa.org
 14th Floor - Centre Tower
 3300 Bloor Street West
 Toronto Ontario M8X 2X4
 Fax: 416.231.4078
 Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
 Propane Storage and Handling Regulation

This Level 1 RSMP applies to:

- a facility with a total propane storage capacity of 5,000 USWG or less; or
- a facility with a fixed propane storage capacity of exactly 5,000 USWG and no more than 500 USWG of portable propane storage capacity on site.

Failure to fully complete this form may result in rejection.
 Making a false statement may result in a fine or prosecution under the *Technical Standards and Safety Act*

Licence Number

Check applicable type of propane operations.

Cylinder Motor Fill Filling Plant Card/Keylock

Submit along with this completed application a Facility Site Plan and a Map of the Surrounding Area.

For Office Use Only

Intake Group

SR#.

[Redacted]

SECTION A: GENERAL INFORMATION

The Undersigned applies to TSSA for a review for an RSMP under Ontario's *Technical Standards and Safety Act*, Propane Storage and Handling Regulation.

A Company Name: Trevor J. Lowe Holdings Ltd. Corporation No. 1935012

Operator Name (if different from above): Canadian Tire Store #297

Telephone No. 613-748-0637 Fax No. 613-748-9508 E-mail tjlowe.ctire@gmail.com

B Street No. 2010 Street Name / 911 Number / Address, if applicable Ogilvie Road

Town / City or Township / County Gloucester Province Ontario Postal Code K1J 8X3

Mailing address if different from above.

C Street No. Street Name / 911 Number / Address, if applicable

Town / City or Township / County Province Postal Code

Information on Container Refill Centre or Filling Plant

D Location of facility.

Street No. 2010 Street Name / 911 Number / Address, if applicable Ogilvie Road Nearest Major Intersection Blair Road and Ogilvie Road

Town / City or Township / County Gloucester Province Ontario Postal Code K1J 8X3

Name of Licence Holder Trevor J. Lowe Holdings Ltd.

Name of a Senior Management person as defined in the regulation holding the Record of Training (ROT). Trevor Lowe ROT type PPO-3

Municipality (or municipalities if the facility or its hazard distance touches multiple borders) City of Ottawa

Hours of operation. [Redacted]

This document is valid until the next licence renewal date. You are required by law to notify TSSA of any change of information.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Print name	Signature	Date (dd-mm-yyyy)
Name of Licence Holder Trevor J. Lowe Holdings Ltd.	[Signature]	16/JUN/2015
Name of Senior Management person as defined in the Regulation holding the Record of Training Trevor Lowe	[Signature]	16/JUN/2015



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION A: GENERAL INFORMATION (cont'd)

Indicate the year the facility was established.

1982

Indicate the year of any significant modifications, as defined in s.1, O.Reg 211/01, since establishment.

N/A


Identify the psig rating and serial number for each fixed propane storage tank on site.

	PSIG	Serial Number
Tank1:	250	5592772
Tank2:	_____	_____
Tank3:	_____	_____

Enter capacity of propane in USWG, fixed, portable, and mobile, and provide detailed inventory that includes the number of tank/vessel for each type (fixed, portable, and mobile) and the capacity of each tank/vessel, on a separate document.

Fixed: 1000 Portable: 140 Mobile: N/A

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

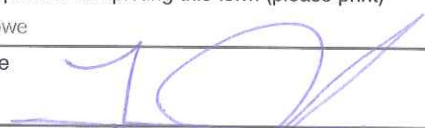Name of person completing this form (please print) Trevor Lowe		Official Title Associate Dealer
Signature 		Telephone No. 613-748-0637
		Date (dd-mmm-yyyy) 16/JUN/2015



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION A: GENERAL INFORMATION (cont'd)

Activity Information

Name of Propane Supplier(s) Superior Propane - Ontario Regional Operations Centre		For Office Use - Party No.	
Street No. 251	Street Name / 911 Number / Address, if applicable Woodlawn Road West, Unit 217		
Town / City or Township / Country Guelph		Province Ontario	Postal Code N1H 8J1
Telephone No. 1-877-873-7467	Fax No. 519-836-7766	Contact Name Mike Mullins	
E-mail mullinsm@superiorpropane.com			

Name of Propane Transporter. If same as above, please check box. <input type="checkbox"/>		For Office Use - Party No.	
Superior Propane - 5023 Ottawa			
Street No. 63	Street Name / 911 Number / Address, if applicable Roydon Place		
Town / City or Township / Country Ottawa		Province Ontario	Postal Code K2E 1A3
Telephone No. 613-314-8003	Fax No.	Contact Name Heather Ross	
E-mail rosshe@superiorpropane.com			

Off-site Cylinder and/or Mobile Storage		Capacity stored off-site, in USWG	For Office Use - Party No.
none			
Street No.	Street Name / 911 Number / Address, if applicable		
Town / City or Township / Country		Province	Postal Code
Telephone No.	Fax No.	Contact Name	

Note: Customer storage is not considered off-site storage.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Trevor Lowe		Official Title Associate Dealer	
Signature 		Telephone No. 613-748-0637	Date (dd-mmm-yyyy) 16/JUNE/2015



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN

The licence holder will complete Section B in consultation with the local Fire Services.

Description of the maximum volume, types and storage location of other hazardous materials on site, if any.

Used oil container 5000L, Used coolant container 1000L, 5w30 Formula 1 bulk oil drum 500L, 5w20 Quaker State bulk oil drum 500L, 5w30 Quaker State bulk oil drum 500L, 3 compressed oxygen containers, 3 acetylene containers.

Note: Fuel tanks located underground at gas bar pose no risk but should be noted.

Description of fire and emergency equipment indicated on facility site map.

Fire extinguisher attached to outside of propane filling station 20lb

10lb fire extinguisher located in auto service bay 1, 5, and 8

Fire hydrant on front on Ogilvie Road

Fire hose/truck hookup on front of building next to main exit

List of fire protection controls (e.g., fire detection systems, fire notification systems, alarm systems, automatic shut off devices, fusible links, etc.) and describe their function, use and operation.

Fusible link on ISC valve-isolation between tank and down stream propane dispenser, pump shut off at propane station shuts off power to pump,

emergency stop push button in service bays shuts down all electricity including pump to propane cabinet, ISC valve interlock cable (interlocked with

cabinet door) ISC valve closes when door is closed. Emergency fire pull stations monitored 24 hours

Maintenance and testing schedule for fire protection controls and devices.

Yearly inspections done

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Trevor Lowe	Official Title Associate Dealer
Signature 	Telephone No. 613-748-0637
	Date (dd-mmm-yyyy) 16/JUNE/2015



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

1. Contacts for Emergency Response

1. Facility Contact Personnel - Key Contact

Name Trevor Lowe	For Office Use - Party No.
Official Title Associate Dealer	
Telephone No. 613-748-0637	Fax No. 613-748-9508
E-mail tjlowe.ctire@gmail.com	
Role and responsibilities in emergency Coordinate site response	

5. Facility 24-Hour Contact Person

Name Richard Robitaille	For Office Use - Party No.
Official Title General Manager	
Cell No.	Fax No. 613-748-9508
E-mail rrobitaille@ctc297.com	
Role and responsibilities in emergency Coordinate site response	

2. Facility Contact Personnel - Alternate Contact

Name Richard Robitaille	For Office Use - Party No.
Official Title General Manager	
Telephone No. 613-748-0637	Fax No. 613-748-9508
E-mail rrobitaille@ctc297.com	
Role and responsibilities in emergency Coordinate site response	

6. Name of Facility Manager

Name Trevor Lowe	For Office Use - Party No.
Official Title Associate Dealer	
Telephone No. 613-748-0637	Fax No. 613-748-9508
E-mail tjlowe.ctire@gmail.com	
Role and responsibilities in emergency Coordinate site response	

3. Local Fire Services - Key Contact

Name John DeHooge	For Office Use - Party No.
Official Title Ottawa Fire Chief	E-mail john.dehooge@ottawa.ca
Telephone No. 613-580-2860 (911 after hours)	Fax No. 613-580-2864
Role and responsibilities in emergency Dispatch fire services	

7. Propane Supplier Key Contact Person

Name Mike Mullins	For Office Use - Party No.
Official Title Manager	E-mail mullinsm@superiorpropane.com
Telephone No. 1-877-873-7467	Fax No.
Role and responsibilities in emergency Coordinate with Ottawa Fire Services	

Fire Services Address

1101 CENTREPOINTE DRIVE - 3RD FLOOR, NEPEAN

Propane Supplier Address

251 Woodlawn Road West, Unit 217, Guelph, ON

4. Local Fire Services - Alternate Contact

Name Duncan McNaghton	For Office Use - Party No.
Official Title Fire Protection Engineer	E-mail duncan.mcnaughton@ottawa.ca
Telephone No. 613-580-2424 ext 29603	Fax No. 613-580-2864
Role and responsibilities in emergency Dispatch fire services	

8. Municipal Contact

Name Dave Monlone	For Office Use - Party No.
Official Title Fire Prevention Officer	
Telephone No. 613-580-2424 ext 44320	Fax No. 613-580-2455
E-mail david.monlone@ottawa.ca	

Fire Services Address

101 Centrepointe Drive - 3rd Floor, Nepean, ON, K2G 5K7

Municipality Name and Address

City of Ottawa - 101 Centrepointe Drive - 3rd Floor, Nepean, ON, K2G 5K7

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Trevor Lowe	Official Title Associate Dealer
Signature 	Telephone No. 613-748-0637
	Date (dd-mmm-yyyy) 16-JUN-2015



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation


SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

2. Additional Safety Measures

Describe any other measures in place at the facility that exceed the minimum Code and Standards requirements.

Emergency shut off push button to shut down pump and close solenoid up stream of dispensing hose.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Trevor Lowe	Official Title Associate Dealer	
Signature 	Telephone No. 613-748-0637	Date (dd-mmm-yyyy) 16-JUN-2015



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Intake Group

Level 1 Risk and Safety Management Plan (RSMP)

JUL 20 2015

Technical Standards and Safety Act
Propane Storage and Handling Regulation

RECEIVED

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

3. Record of Emergency Training Provided - For most recent 12-month period.

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Training Date (dd-mmm-yyyy) 09-04-2013	Print Name of Training Provider: FSN Training
	Print Name of Instructor: Dave Kennedy
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Training on the facility's Emergency Management Procedures provided to staff.

Training Date (dd-mmm-yyyy) 11-APR-2015	Print Name of Training Provider: KAWART HAS CONSULTING & TRAINING
	Print Name of Instructor: LARRY O'DONNELL
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

On-site specific training provided to certificate holders / persons with Records of Training.

Training Date (dd-mmm-yyyy) 16-JUN-2015	Print Name of Training Provider: KAWART HAS CONSULTING & TRAINING
	Print Name of Instructor: LARRY O'DONNELL
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Irisvor Lowe	Official Title Associate Dealer
Signature 	Telephone No. 613-748-0637
	Date (dd-mmm-yyyy) 16-JUN-2015



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

4. Emergency Training Plan for Coming Year

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Target Date (dd-mmm-yyyy) 12-APR-2016	Print Name of Training Provider: KAWARTHAS CONSULTING + TRAINING
	Print Name of Instructor: LARRY O'DONNELL
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Training on the facility's Emergency Management Procedures provided to staff.

Target Date (dd-mmm-yyyy) 12-APR-2016	Print Name of Training Provider: KAWARTHAS CONSULTING + TRAINING
	Print Name of Instructor: LARRY O'DONNELL
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

On-site specific training provided to certificate holders / persons with Records of Training.

Target Date (dd-mmm-yyyy) 16-JUN-2016	Print Name of Training Provider: KAWARTHAS CONSULTING + TRAINING
	Print Name of Instructor: LARRY O'DONNELL
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Irene Lowe	Official Title Associate Dealer
Signature 	Telephone No. 613-748-0637
	Date (dd-mmm-yyyy) 16-JUN-2015



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

5. Emergency Response Communications Plan

Warnings and Actions

Describe who gives warnings to whom, and how and when the warning will be given (including public notification as appropriate).

The ROT person on duty will contact emergency services by calling 911 immediately. They will have the area evacuated and if the store is affected, they will use the 2 way radio to contact staff in the retail store.

Describe what action is to be taken and by whom when a warning is issued (including details of a meeting place in a safe identified area and activating the evacuation plan, if necessary).

Actions and warnings will be taken by our ROT person on duty. If an evacuation is necessary all staff are to meet across the road in our parking area.

Communication with Emergency Response Authorities

Describe when and how the licence holder will give early warning to emergency response authorities (including a process to ensure that a call is placed to 911).

Each day an opening procedure is done for the propane tank and area by a ROT person. If the system is not operational, it is closed with a sign stating this. The Service Manager is informed and a call is placed to Superior Propane immediately upon noticing an issue. The ROT person will notify the manger on duty that 911 has been called.

Describe provisions for fire department entry when there are no operations or staffing at the propane site.

Our propane site is in the parking lot and is very visible. The fire department will have no issues accessing the parking lot for the propane site. There are 3 entrances to the parking lot.

Describe how the licence holder will ensure continual flow of updated information to authorities.

Information on the gauge on the outside of the tank will be provided to the authorities by the facility key contact if not a safety issue for the contact person to be close to the tank

How long will it take the facility liaison person to respond to the site.

20 to 30 minutes.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Trevor Lowe	Official Title Associate Dealer
Signature 	Telephone No. 613-748-0637
	Date (dd-mmm-yyyy) 16-JUN-2015



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

6. Building and Site Security and Procedures

	Yes	No
1. Does the propane location have controlled access to limit unnecessary risk and entry (lock out procedures)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
2. Is there adequate night lighting at the site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
3. Are procedures in place that ensure access routes, aisles, storage area, filling areas and the grounds are kept clear from unwanted materials?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
4. Are there procedures that capture and record the daily inspection of hoses and inspection requirements for filling systems and mechanical devices used in the transfer of propane?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
5. Does the facility have procedures that include a process to isolate and purge any overfilled propane cylinders?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
6. Are weighing systems validated for accuracy?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
7. Are storage areas clearly marked with the vessels' capacity status (i.e., filled, empty, purged and other hazardous materials)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
8. Are quality assurance procedures in place to ensure that all valves are closed after the propane cylinders are filled?(e.g., QCC valves)	<input checked="" type="checkbox"/>	<input type="checkbox"/>
9. Is the schedule of maintenance and testing activities retained on site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>

7. Water Supply

The propane licence holder should work with the local fire department to determine water supply capabilities that are available based on the propane facility's location.

	Yes	No
1. Is a pressurized water system available at the propane facility site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
2. Can the municipal fire department pump 375 GPM (1420 LPM) of water at this location?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
3. What is the unobstructed distance to the closest water supply that could be used for firefighting activities? (distance in metres only)		<u>51 Meters</u>
4. What is the unobstructed distance to the closest approved water supply with year round access if there are no hydrants? (distance in metres only)		<u>20 Meters</u>

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Trevor Lowe	Official Title Associate Dealer	
Signature 	Telephone No. 613-748-0637	Date (dd-mmm-yyyy) 16-JUN-2015



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

8. Licence holder and local Fire Services Review

To be completed by the Local Fire Services

Has the local fire service had an opportunity to review the Emergency Response and Preparedness Plan?

Yes No

If not, please explain (e.g., no fire services).

Fire services comments, if any:

To be completed by the Licence Holder

In response to the above comments, the following action(s) is required:

The licence holder will respond to the Local Fire Services comments by: _____ (dd-mmm-yyyy)

LOCAL FIRE SERVICES

The undersigned has reviewed Section B of the Risk and Safety Management Plan Fire Services.

Print name	Signature	Date (dd-mmm-yyyy)
Local Fire Services Name		

to see attached

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Trevor Lowe	Official Title Associate Dealer	
Signature 	Telephone No. 613-748-0637	Date (dd-mmm-yyyy) 16-JUN-2015

[Quoted text hidden]

McNaughton, Duncan <Duncan.McNaughton@ottawa.ca>
To: Trevor Lowe <tjlowe.ctire@gmail.com>

Tue, Jun 16, 2015 at 1:58 PM

To Whom it May Concern,

Please use this e-mail as approval for the Level 1 RSMP for the Canadian Tire located at 2010 Ogilvie Road in Gloucester per the attached application.

Duncan A. McNaughton, P.Eng

Fire Protection Engineer / Ingénieur Sécurité Incendie

City of Ottawa / Ville d'Ottawa

101 Centrepointe Drive - 3rd Floor

Nepean, ON

K2G 5K7

Tel: 613-580-2424 ext 29603

Fax: 613-580-9613

Duncan.McNaughton@ottawa.ca

www.ottawa.ca



OTTAWA FIRE SERVICES
SERVICE DES INCENDIES D'OTTAWA

Protecting Our Nation's Capital With Pride
Protéger notre capitale nationale avec fierté

From: Trevor Lowe [mailto:tjlowe.ctire@gmail.com]

Sent: Tuesday, June 16, 2015 1:51 PM

To: McNaughton, Duncan

Subject: Request for approval for operation Propane Cylinder fill centre

Hi Duncan,



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS

Applicant must include a Facility Site Plan and Map of Surrounding Area

Facility Site Plan.

The licence holder will submit a copy of the original facility site plan updated with the following information:

1. The storage location of fixed, portable, and mobile vessels.
2. The maximum volume, types and storage location of hazardous materials.
3. Location of permanent structures on site.
4. Access and egress points and location of barriers.
5. Location of fire and emergency equipment (e.g., sprinkler systems, extinguishers, suppression systems) on site and location of fire hydrant or water supply where available.
6. Location of emergency shut off/shut down switches/valves.

Map of Surrounding Area.

The licence holder will submit a scaled aerial map of the surrounding area showing the following information:

7. The capacity and placement of the single largest propane storage vessel, including its setback from the front, rear and side property lines.
8. GPS co-ordinates of the single largest vessel.
9. Visual indication of the single largest fixed vessel and a circle made using the distance in Table 1 as the radius from the single largest fixed vessel.
10. Clear indication of the municipality or municipalities present within the circle.
11. Visual indication of property line information.
12. The location and name of roads within or abutting the site.
13. Key note to the drawing indicating the facility's municipal address, municipal lot number(s) and concession lines as applicable, and the date the map was prepared.
14. Address and contact information for each municipality (municipal clerk or secretary-treasurers of planning board). (Refer to page 5.)
15. Complete "**Required Mapping Information from Updated Site Plan**" in table below .

Required Mapping Information from Updated Site Plan

Date map prepared (dd-mmm-yyyy)	Capacity of single largest propane storage vessel (USWG)
	1000
Tank setback coordinates. Indicate placement on the map.	
Front: 66m	Right side property line: 43m
Rear: 51m	Left side property line: 175m
GPS coordinates of single largest vessel:	45°26'8"N x 75°36'2"W

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Trevor Lowe	Official Title Associate Dealer
Signature 	Telephone No. 613-748-0637
	Date (dd-mmm-yyyy) 16-JUN-2015



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)

Applicant must include a Facility Site Plan and Map of Surrounding Area


Table 1: Distance Table

Water Capacity (litres)	Nominal Water Capacity (USWG)	Distance to 1 psi overpressure (m)
1,890	500	155
3,780	1,000	195
4,920	1,300	213
6,620	1,750	235
7,130	1,885	241
7,560	2,000	246
18,900	5,000	333

Formula: $D = 16.94 \times (1.524 \times C)^{1/3}$
 D = Distance to overpressure of 1 psi (meters)
 C = Tank Total Capacity in USWG

Parameters: Density of Propane is 0.5033 kg per litre @ 15 C
 Assume all vessels are 80% full
 1 gallon [US, liquid] = 0.003785411784 cubic meter
 1 cubic metre = 264.17 USWG

Hazard Distance Chart (EPA-TNT model)

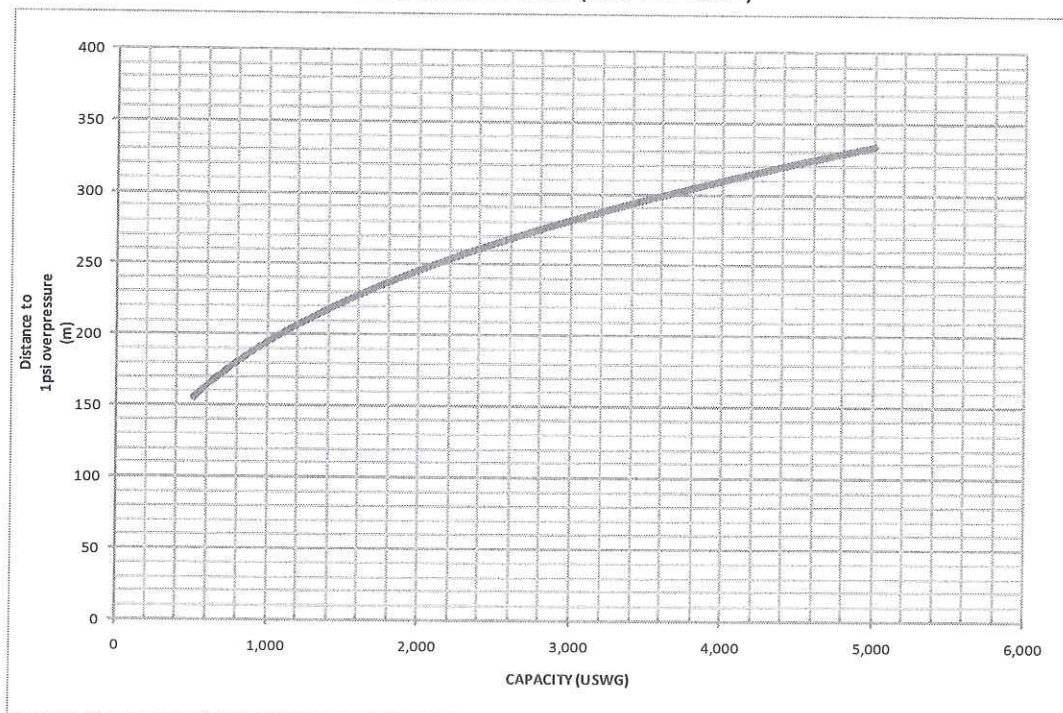



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)

Applicant must include a Facility Site Plan and Map of Surrounding Area

As an accompaniment to the Map of Surrounding Area, provide the following information about buildings and features present within the circle in Table 2.

Table 2: Buildings and Features

Buildings and Features Present within the Circle on the Map of the Surrounding Area AND Name and Address of Closest Building or Feature	* Number of Buildings and Features (mark with an "X")				Distance from Tank to Closest Building or Feature
	0	1	2-10	11+	
Industrial buildings or parks or golf courses Name: _____ Address: _____ City: _____ Province _____ Postal Code _____	x				_____ m
Residential building units specifically permanent single family dwellings, condominiums, and apartments Name: _____ Address: _____ City: _____				x	106 m
Commercial building units specifically retail, restaurants, entertainment, theatres, and sporting complexes. Name: Canadian Tire Gas Bar Address: 2006 Ogilvie Road City: Ottawa Province Ontario Postal Code K1J 7N8			x		17 m
Commercial building units – continuous occupancy specifically hotels, campgrounds, and resorts. Name: _____ Address: _____ City: _____ Province _____ Postal Code _____	x				_____ m
Sensitive institutions specifically hospitals, schools and day cares, nursing and retirement homes, mental health institutions, and prisons. Name: _____ Address: _____ City: _____ Province _____ Postal Code _____	x				_____ m
Emergency responders specifically fire stations, ambulance stations, and police stations. Name: _____ Address: _____ City: _____ Province _____ Postal Code _____	x				_____ m

* For multi-unit buildings, count each unit as "1".

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Trevor Lowe	Official Title Associate Dealer
Signature 	Telephone No. 613-748-0637
	Date (dd-mmm-yyyy) 16-JUN-2015



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

WORKSHEET


Portable Storage Additional Information Worksheet


Cylinder Size	Capacity in USWG	Quantity	Total Volume in USWG
# 420	123.9		
# 100	29.5		
# 40	11.75		
# 33.3	9.62		
# 30	8.8	24	140 Gallons
# 20	5.8		
# 10	2.9		
# 5	1.5		
Total Cylinder Capacity			140 Gallons

Tanks Stored On-site Not Connected for Use

Tank Size In USWG	Quantity	Total Volume in USWG
Total Tank Capacity		

Total Cylinder Capacity	24
Total Tank Capacity	1000
Total Portable Capacity (Total Cylinder Capacity + Total Tank Capacity)	140

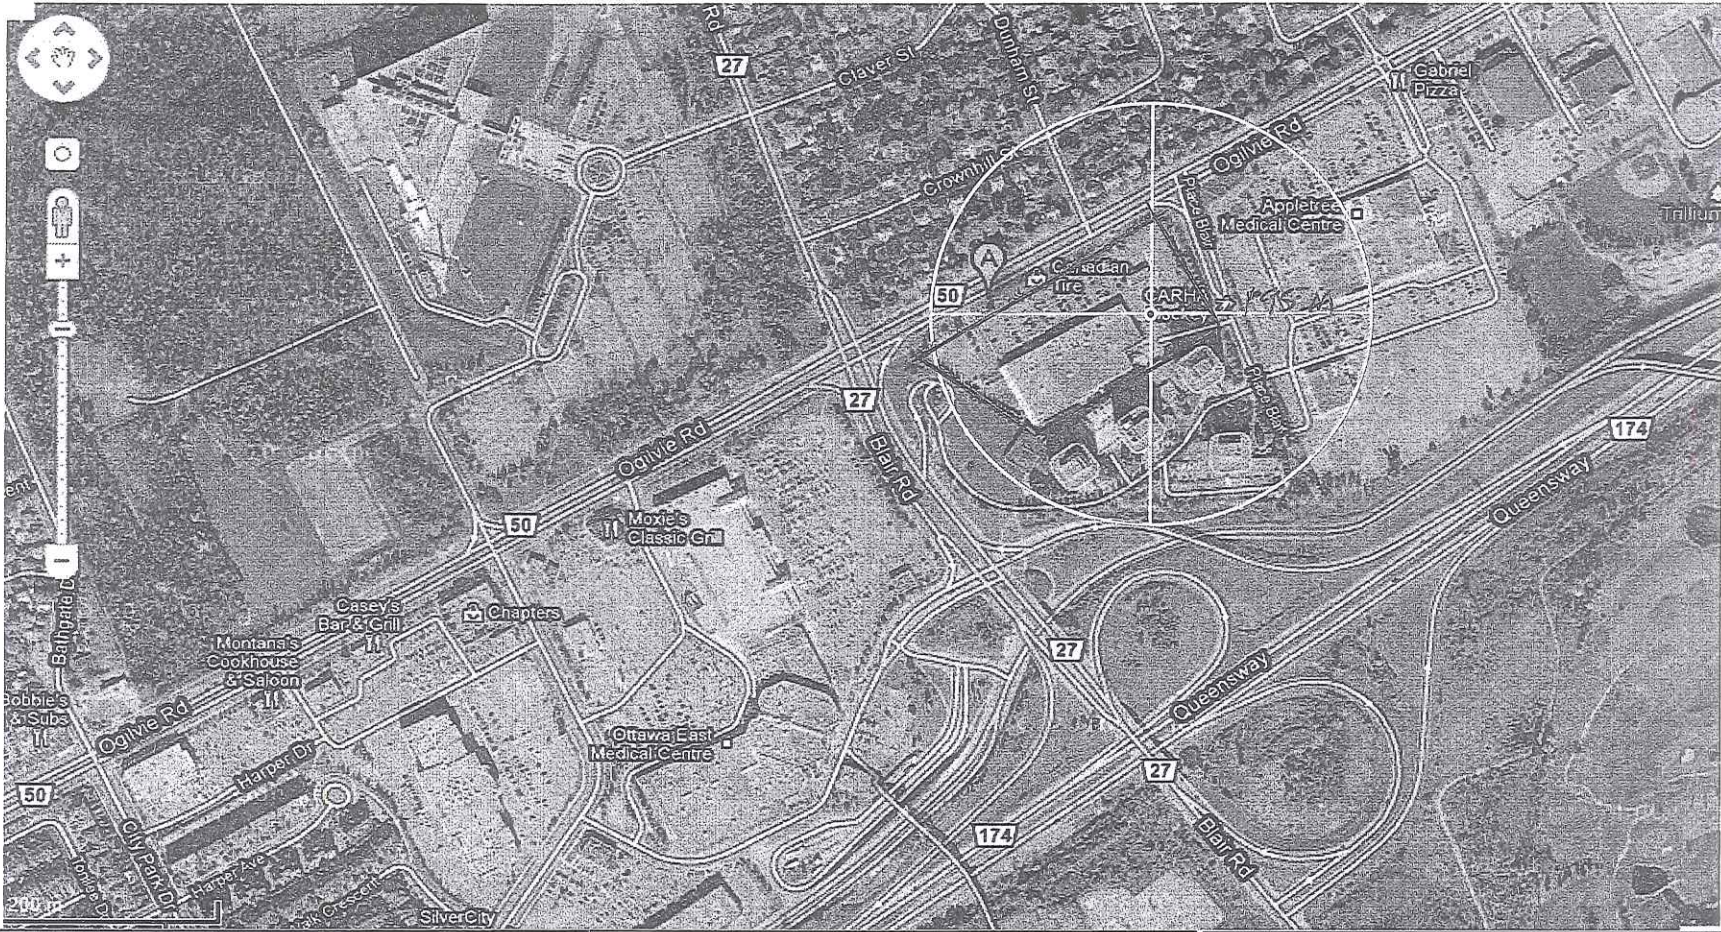

Location of Propane Storage Tank: Demarcated by  in centre of circle.
Capacity of Propane Storage Tank: Capacity of Propane Storage Tank = 1000 USWG
GPS Coordinates of Propane Storage Tank: GPS Co-ordinates = 45.4357, -75.6056
Circular Distance to 1 psi overpressure: Denoted by circle centred on tank radial distance = 246 m

Note: Property Lines a setbacks shown on site plan.
Municipality (ies): within the 1 psi overpressure circle The Municipality of GLOUCESTER
Municipal Contact: Dave Montone Fire Prevention Officer 613-580-2424 ext. 44320

Map of Surrounding Area
2010 OGILVIE ROAD
Part of Lot 21 Concession 2 Ottawa front; Being Part 1 ON Plan 5R3006 except part 1 ON plan 5R6342 and except parts 1 and 7 on expropriation plan NS148554 and except part 1 on plan 4R13170 Gloucester

Setback information
 Front: 66m Rear: 51m
 Right side of property: 43m
 Left side of property: 175m

