



Technical Standards and Safety Authority  
 www.tssa.org  
 14th Floor - Centre Tower  
 3300 Bloor Street West  
 Toronto Ontario M8X 2X4  
 Fax: 416.231.4903  
 Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
 Propane Storage and Handling Regulation

This Level 1 RSMP applies to:
 

- a facility with a total propane storage capacity of 5,000 USWG or less; or
- a facility with a fixed propane storage capacity of exactly 5,000 USWG and no more than 500 USWG of portable propane storage capacity


Failure to fully complete this form may result in rejection.  
 Making a false statement may result in a fine or prosecution under the *Technical Standards and Safety Act*

Licence Number: 000207842

Check applicable type of propane operations.

Cylinder     Motor Fill     Filling Plant     Card/Keylock

Submit along with this completed application a Facility Site Plan and a Map of the Surrounding Area.



**SECTION A: GENERAL INFORMATION**

The Undersigned applies to TSSA for a review for an RSMP under Ontario's *Technical Standards and Safety Act*, Propane Storage and Handling Regulation.

**A** Company Name: GOLDEN EAGLE DEVELOPMENT LTD    Ontario Corporation No., if applicable: 002350606

Operator Name (if different from above): O/A PINTOS MARKET

Telephone No.: 705-743-7851    Fax No.: 705-741-2663    E-mail: ged2350606@gmail.com

**B** Street No.: 2622    Street Name / 911 Number / Address, if applicable: MAPLE GROVE ROAD

Town / City or Township / County: PETERBOROUGH    Province: ONTARIO    Postal Code: K9J 0G5

Mailing address if different from above.

**C** Street No.:    Street Name / 911 Number / Address, if applicable:    Province:    Postal Code:

**Information on Container Refill Centre or Filling Plant**

Location of facility.

**D** Street No.: 2622    Street Name / 911 Number / Address, if applicable: MAPLE GROVE ROAD    Nearest Major Intersection: HIGHWAY 7 & LANSDOWNE

Town / City or Township / County: PETERBOROUGH    Province: ONTARIO    Postal Code: K9J 0G5

Name of Licence Holder: GOLDEN EAGLE DEVELOPMENT LTD

Name of a Senior Management person as defined in the regulation holding the Record of Training (ROT): YUSHENG (SIMON) GUAN    ROT type: 100-01

Municipality (or municipalities if the facility or its hazard distance touches multiple borders): CAVAN MONOGHAN TOWNSHIP

Hours of operation.

This document is valid until the next licence renewal date. You are required by law to notify TSSA of any change of information.  
 Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of Licence Holder: GOLDEN EAGLE DEVELOPMENT LTD	Signature: <i>Yusheng</i>	Date (dd-mm-yyyy): 06-06-2013
Name of Senior Management person as defined in the Regulation holding the Record of Training: YUSHENG (SIMON) GUAN		



Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)  
Technical Standards and Safety Act  
Propane Storage and Handling Regulation

**SECTION A: GENERAL INFORMATION (cont'd)**


Indicate the year the facility was established. 2010      Indicate the year of any significant modifications, as defined in s.1, O.Reg 211/01, since establishment. 2012 Change of Steel

Identify the psig rating and serial number for each fixed propane storage tank on site.

	PSIG	Serial Number
Tank1:	<u>250</u>	<u>F621485</u>
Tank2:	_____	_____
Tank3:	_____	_____

Enter capacity of propane in USWG, fixed, portable, and mobile, and provide detailed inventory that includes the number of tank/vessel for each type (fixed, portable, and mobile) and the capacity of each tank/vessel, on a separate document.

Fixed: 2000 uswg      Portable: 244.8 uswg      Mobile: 0



**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) <u>YUSHENG (SIMON) GUAN</u>	Official Title <u>PRESIDENT</u>	
Signature <u><i>yu sheng</i></u>	Telephone No. <u>705-743-7851</u>	Date (dd-mm-yyyy) <u>06-06-2013</u>



Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)  
Technical Standards and Safety Act  
Propane Storage and Handling Regulation

**SECTION A: GENERAL INFORMATION (cont'd)**

Activity Information

Name of Propane Supplier(s)			
SPARLING'S PROPANE COMPANY LTD.			
Street No. 2550	Street Name / 911 Number / Address, if applicable HARRIGAN DRIVE		
Town / City or Township / Country BRECHIN		Province ONTARIO	Postal Code L0K 1B0
Telephone No. 1-888-780-7727	Fax No. 705-484-1156	Contact Name MIKE CAMPBELL	
E-mail mdc@sparlings.com			

Name of Propane Transporter. If same as above, please check box. <input checked="" type="checkbox"/>			For Office Use - Party No.
Street No.	Street Name / 911 Number / Address, if applicable		
Town / City or Township / Country		Province	Postal Code
Telephone No.	Fax No.	Contact Name	
E-mail			

Off-site Cylinder and/or Mobile Storage		Capacity stored off-site, in USWG NONE	For Office Use - Party No.
Street No.	Street Name / 911 Number / Address, if applicable		
Town / City or Township / Country		Province	Postal Code
Telephone No.	Fax No.	Contact Name	

Note: Customer storage is not considered off-site storage.

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) YUSHENG (SIMON) GUAN	Official Title PRESIDENT
Signature <i>Yusheng</i>	Telephone No. 705-743-7851
	Date (dd-mm-yyyy) 06-06-2013



Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN**

The licence holder will complete Section B in consultation with the local Fire Services.

Description of the maximum volume, types and storage location of other hazardous materials on site, if any.

1 x 50,000 litre fibreglass double walled underground storage tank (regular gasoline)

1 x 50,000 litre split fibreglass double walled underground storage tank (35,000 litres diesel; 15,000 litres premium gasoline)

Description of fire and emergency equipment indicated on facility site map.

There is a portable fire extinguisher at the propane dispenser as well as (two) 2 portable extinguishers at the gasoline dispensing islands. The extinguishers carry a minimum rating of 20BC. There are seven (7) additional portable fire extinguishers in the store.

List of fire protection controls (e.g., fire detection systems, fire notification systems, alarm systems, automatic shut off devices, fusible links, etc.) and describe their function, use and operation.

The internal safety control (ISC) valve in the tank outlet is protected with a fusible link. The normally closed valve is pulled open by a cable attached to the cabinet door and can only be in the open position when the cabinet door is open. In the event of a fire, the fusible link will melt, allowing the ISC valve to close within the tank. When unattended, the lever is returned to the closed position, thus closing the ISC valve. The remote ECO switch as well as the main breaker terminates power to the propane solenoid valve and pump.

Maintenance and testing schedule for fire protection controls and devices.

The facility is inspected on a monthly basis by the operator. The operation of the ECO function and the ISC valve movement and a visual inspection of the condition of the fire extinguishers are part of the monthly inspection. Any deficiencies found in the propane system are reported to Sparling's Propane for immediate attention. Staff who are certified conduct a daily visual inspection of the propane equipment prior to using. Sparling's Propane conducts an annual inspection of the entire propane facility. Fire extinguishers and the premises are maintained in compliance with the Ontario Fire Code.

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) YUSHENG (SIMON) GUAN	Official Title PRESIDENT
Signature <i>yusheng</i>	Telephone No. 705-743-7851
	Date (dd-mm-yyyy) 06-06-2013



Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)**

1. Contacts for Emergency Response

<b>1. Facility Contact Personnel - Key Contact</b>		<b>5. Facility 24-Hour Contact Person</b>	
Name GARY KWAN	For Office Use - Party No.	Name YUSHENG (SIMON) GUAN	For Office Use - Party No.
Official Title AGENT for OWNER		Official Title PRESIDENT	
Telephone No. Cell # 647-966-1978	Fax No. 705-741-2683	Cell No. 647-966-1822	Fax No. 705-741-2683
E-mail garykwan@outlook.com		E-mail ged2350606@gmail.com	
Role and responsibilities in emergency Assist emergency services as required		Role and responsibilities in emergency Assist emergency services as required	
<b>2. Facility Contact Personnel - Alternate Contact</b>		<b>6. Name of Facility Manager</b>	
Name YUSHENG (SIMON) GUAN	For Office Use - Party No.	Name YUSHENG (SIMON) GUAN	For Office Use - Party No.
Official Title PRESIDENT		Official Title PRESIDENT	
Telephone No. 705-743-7851	Fax No. 705-741-2683	Telephone No. 705-743-7851	Fax No. 705-741-2683
E-mail ged2350606@gmail.com	Cell # 647-966-1822	E-mail ged2350606@gmail.com	Cell # 647-966-1822
Role and responsibilities in emergency Assist emergency services as required		Role and responsibilities in emergency Assist emergency services as required	
<b>3. Local Fire Services - Key Contact</b>		<b>7. Propane Supplier Key Contact Person</b>	
Name BILL BALFOUR	For Office Use - Party No.	Name MIKE CAMPBELL	For Office Use - Party No.
Official Title FIRE CHIEF		Official Title REGIONAL MANAGER	
Telephone No. 705-932-2765	Fax No. 705-932-2195	Telephone No. 1-888-780-7727	Fax No. 705-484-1156
E-mail bbalfour@cavanmonaghan.net		E-mail mdc@sparlings.com	
Role and responsibilities in emergency Manage Emergency Response		Role and responsibilities in emergency Key Contact to activate Sparling's Propane ERAP # 2-0220	
<b>4. Local Fire Services - Alternate Contact</b>		<b>8. Municipal Contact</b>	
Name MIKE TENNANT	For Office Use - Party No.	Name KAREN ELLIS	
Official Title DEPUTY FIRE CHIEF		Official Title DIRECTOR of PLANNING	
Telephone No. Cell 705-868-9808	Fax No. 705-932-2195	Telephone No. 705-932-9334	Fax No. 705-932-3458
E-mail None		E-mail kellis@cavanmonaghan.net	
Role and responsibilities in emergency Manage Emergency Response		Municipality The TOWNSHIP of CAVAN MONAGHAN	

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) YUSHENG (SIMON) GUAN	Official Title PRESIDENT
Signature <i>yu sheng</i>	Telephone No. 705-743-7851
	Date (dd-mm-yyyy) 06-06-2013



Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)  
Technical Standards and Safety Act  
Propane Storage and Handling Regulation

**SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)**

2. Additional Safety Measures

Describe any other measures in place at the facility that exceed the minimum Code and Standards requirements.

A sign is affixed to the dispenser that identifies Sparling's Propane as the supplier of fuel as well as the 24/7 Sparling's Propane emergency response contact number (1-888-780-7727).

The dispenser cabinet is locked and closed when the business is not open and unattended thus closing the ISC valve.

Monthly inspections of the facility are completed and recorded by the operator. Any deficiencies found are corrected or reported immediately to Sparling's Propane.

The operator conducts and records a daily visual inspection of the dispenser.

There are nine (9) additional fire extinguishers available on the premises.

The main breaker for the propane dispenser is located in the basement of the store.

The building is monitored for fire by Trent Security who will call 911 on alarm activation.

See the Propane Emergency Response Procedure and existing Emergency Response Plan listed in Tab 8.

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) YUSHENG (SIMON) GUAN	Official Title PRESIDENT
Signature 	Telephone No. 705-743-7851
	Date (dd-mm-yyyy) 06-06-2013



Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)**

3. Record of Emergency Training Provided - For most recent 12-month period.

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Training Date (dd-mm-yyyy) 27-03-2013	Print Name of Training Provider: GOLDEN EAGLE DEVELOPMENT LTD
	Print Name of Instructor: JOACHIM PINTO
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:


Training on the facility's Emergency Management Procedures provided to staff.

Training Date (dd-mm-yyyy) 27-03-2013	Print Name of Training Provider: GOLDEN EAGLE DEVELOPMENT LTD
	Print Name of Instructor: JOACHIM PINTO
Training Date (dd-mm-yyyy) As needed (new hires)	Print Name of Training Provider: GOLDEN EAGLE DEVELOPMENT LTD
	Print Name of Instructor: JOACHIM PINTO
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

On-site specific training provided to certificate holders / persons with Records of Training.

Training Date (dd-mm-yyyy) 27-03-2013	Print Name of Training Provider: GOLDEN EAGLE DEVELOPMENT LTD
	Print Name of Instructor: JOACHIM PINTO
Training Date (dd-mm-yyyy) As needed (new hires)	Print Name of Training Provider: GOLDEN EAGLE DEVELOPMENT LTD
	Print Name of Instructor: JOACHIM PINTO
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) YUSHENG (SIMON) GUAN	Official Title PRESIDENT
Signature 	Telephone No. 705-743-7851 Date (dd-mm-yyyy) 06-06-2013



Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)  
Technical Standards and Safety Act  
Propane Storage and Handling Regulation

**SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)**

4. Emergency Training Plan for Coming Year

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Target Date (dd-mm-yyyy) 27-03-2014	Print Name of Training Provider: GOLDEN EAGLE DEVELOPMENT LTD
	Print Name of Instructor: JOACHIM PINTO
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:


Training on the facility's Emergency Management Procedures provided to staff.

Target Date (dd-mm-yyyy) 27-03-2014	Print Name of Training Provider: GOLDEN EAGLE DEVELOPMENT LTD
	Print Name of Instructor: JOACHIM PINTO
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

On-site specific training provided to certificate holders / persons with Records of Training.

Target Date (dd-mm-yyyy) 27-03-2014	Print Name of Training Provider: GOLDEN EAGLE DEVELOPMENT LTD
	Print Name of Instructor: JOACHIM PINTO
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) YUSHENG (SIMON) GUAN	Official Title PRESIDENT
Signature 	Telephone No. 705-743-7851
	Date (dd-mm-yyyy) 06-06-2013





Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)**

The licence holder will complete Section B in consultation with the local Fire Services.

**5. Emergency Response Communications Plan**

**Warnings and Actions**

Describe who gives warnings to whom, and how and when the warning will be given (including public notification as appropriate).  
The shift manager is responsible for calling 911 when an emergency situation arises. The shift manager will also notify key contacts if not already on site.  
Also see the Propane Emergency Response Procedures and the existing Emergency Response Plan listed in Tab 8.

Describe what action is to be taken and by whom when a warning is issued (including details of a meeting place in a safe identified area and activating the evacuation plan, if necessary).  
The shift manager will advise all occupants to evacuate the premises and report to the emergency meeting place across from the store on the opposite side of Maple Grove Road. In the event of a catastrophic failure attempts will be made by store employees to advise persons inside the hazard distance of the emergency and will advise all persons to move to a safe location outside the hazard radius.

**Communication with Emergency Response Authorities**


Describe when and how the licence holder will give early warning to emergency response authorities (including a process to ensure that a call is placed to 911).  
The shift manager will call 911 as well as communicate with Trent Security. Once at the meeting place, the shift manager will confirm with the key contacts that emergency services were notified.

Describe provisions for fire department entry when there are no operations or staffing at the propane site.  
The dispenser is not within a fenced compound and is accessible 24/7.

Describe how the licence holder will ensure continual flow of updated information to authorities.  
The shift manager will assume the responsibility of tracking information and waiting for and meeting with emergency services until a key contact is present.  
The key contact will then assume the same responsibility.

How long will it take the facility liaison person to respond to the site.  
15 minutes

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) YUSHENG (SIMON) GUAN		Official Title PRESIDENT	
Signature 		Telephone No. 705-743-7851	Date (dd-mm-yyyy) 06-06-2013



Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)**

The licence holder will complete Section B in consultation with the local Fire Services.

**6. Building and Site Security and Procedures**


- |   | Yes                                 | No                       |
|---|-------------------------------------|--------------------------|
| 1. Does the propane location have controlled access to limit unnecessary risk and entry (lock out procedures)?  | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 2. Is there adequate night lighting at the site?  | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 3. Are procedures in place that ensure access routes, aisles, storage area, filling areas and the grounds are kept clear from unwanted materials?                                     | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 4. Are there procedures that capture and record the daily inspection of hoses and inspection requirements for filling systems and mechanical devices used in the transfer of propane? | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 5. Does the facility have procedures that include a process to isolate and purge any overfilled propane cylinders?  | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 6. Are weighing systems validated for accuracy?   | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 7. Are storage areas clearly marked with the vessels' capacity status (i.e., filled, empty, purged and other hazardous materials)?  | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 8. Are quality assurance procedures in place to ensure that all valves are closed after the propane cylinders are filled?(e.g., QCC valves)   | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 9. Is the schedule of maintenance and testing activities retained on site?  | <input checked="" type="checkbox"/> | <input type="checkbox"/> |

**7. Water Supply**

The propane licence holder should work with the local fire department to determine water supply capabilities that are available based on the propane facility's location.

- |   | Yes                      | No                                  |
|---|--------------------------|-------------------------------------|
| 1. Is a pressurized water system available at the propane facility site?  | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| 2. Can the municipal fire department pump 375 GPM (1420 LPM) of water at this location?   | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| 3. What is the unobstructed distance to the closest water supply that could be used for firefighting activities? (distance in metres only)            | n/a                      |                                     |
| 4. What is the unobstructed distance to the closest approved water supply with year round access if there are no hydrants? ( distance in metres only) | n/a                      |                                     |

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) YUSHENG (SIMON) GUAN		Official Title PRESIDENT	
Signature 		Telephone No. 705-743-7851	Date (dd-mm-yyyy) 06-06-2013



July 22, 2013

Technical Standards & Safety Authority  
14<sup>th</sup> Floor, Centre Tower  
3300 Bloor Street West  
Toronto, Ontario  
M8X 2X4

Attn: Propane Licensing

**Re: Golden Eagle Development Ltd RSMP (License # 000207842)**

Please find enclosed the RSMP for Golden Eagle Development Ltd. located at 2622 Maple Grove Road, Peterborough, Ontario. The RSMP is being submitted without comment from the local Fire Service. A copy of the RSMP was sent by courier to Chief Bill Balfour, Cavan Monaghan Township on June 20, 2013. Neither I nor my client has received a response thus far.

In the interest of continuity of service, please note my clients file as being compliant with the requirements of Ontario Regulation 211/01 and cancel any outstanding inspections to terminate his license.

If I can be of any assistance, please contact me directly. My cell # is 705-706-0986.

Yours truly,

Bruce Coomber  
Compliance Coordinator, Propane  
Sparling's Propane  
705-484-1423 or 1-888-780-7727  
705-764-3554 (fax)  
e-mail: bgc@sparlings.com



Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)**

The licence holder will complete Section B in consultation with the local Fire Services.

**8. Licence holder and local Fire Services Review**

**To be completed by the Local Fire Services**

Has the local fire service had an opportunity to review the Emergency Response and Preparedness Plan?

Yes

No



If not, please explain (e.g., no fire services).

Fire services comments, if any:

**To be completed by the Licence Holder**

In response to the above comments, the following action(s) is required:

The licence holder will respond to the Local Fire Services comments by: \_\_\_\_\_

(dd-mm-yyyy)

**LOCAL FIRE SERVICES**

The undersigned has reviewed Section B of the Risk and Safety Management Plan Fire Services.

Print name	Signature	Date (dd-mm-yyyy)
Local Fire Services Name		

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) YUSHENG (SIMON) GUAN	Official Title PRESIDENT	
Signature <i>yu sheng</i>	Telephone No. 705-743-7851	Date (dd-mm-yyyy) 06-06-2013



Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION C: SUBMISSIONS**

Applicant must include a Facility Site Plan and Map of Surrounding Area

**Facility Site Plan.**

The licence holder will submit a copy of the original facility site plan updated with the following information:

1. The storage location of fixed, portable, and mobile vessels.
2. The maximum volume, types and storage location of hazardous materials.
3. Location of permanent structures on site.
4. Access and egress points and location of barriers.
5. Location of fire and emergency equipment (e.g., sprinkler systems, extinguishers, suppression systems) on site and location of fire hydrant or water supply where available.
6. Location of emergency shut off/shut down switches/valves.

**Map of Surrounding Area.**


The licence holder will submit a scaled aerial map of the surrounding area showing the following information:

7. The capacity and placement of the single largest propane storage vessel, including its setback from the front, rear and side property lines.
8. GPS co-ordinates of the single largest vessel.
9. Visual indication of the single largest fixed vessel and a circle made using the distance in Table 1 as the radius from the single largest fixed vessel.
10. Clear indication of the municipality or municipalities present within the circle.
11. Visual indication of property line information.
12. The location and name of roads within or abutting the site.
13. Key note to the drawing indicating the facility's municipal address, municipal lot number(s) and concession lines as applicable, and the date the map was prepared.
14. Address and contact information for each municipality (municipal clerk or secretary-treasurers of planning board). (Refer to page 5.)
15. Complete "Required Mapping Information from Updated Site Plan" in table below .

**Required Mapping Information from Updated Site Plan**

Date Map Prepared (dd-mm-yyyy) 05-04-2013	Capacity of single largest propane storage vessel (USWG) 2000 uswg
Tank setback coordinates. Indicate placement on the map.	
Front: <u>65 Metres</u>	Right side property line: <u>27.5 Metres</u>
Rear: <u>99 Metres</u>	Left side property line: <u>89 Metres</u>
GPS coordinates of single largest vessel: <u>44.16.031 North x 078.24.328 West</u>	

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) YUSHENG (SIMON) GUAN	Official Title PRESIDENT
Signature 	Telephone No. 705-743-7851
	Date (dd-mm-yyyy) 06-06-2013



Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)  
Technical Standards and Safety Act  
Propane Storage and Handling Regulation

**SECTION C: SUBMISSIONS (cont'd)**  
Applicant must include a Facility Site Plan and Map of Surrounding Area

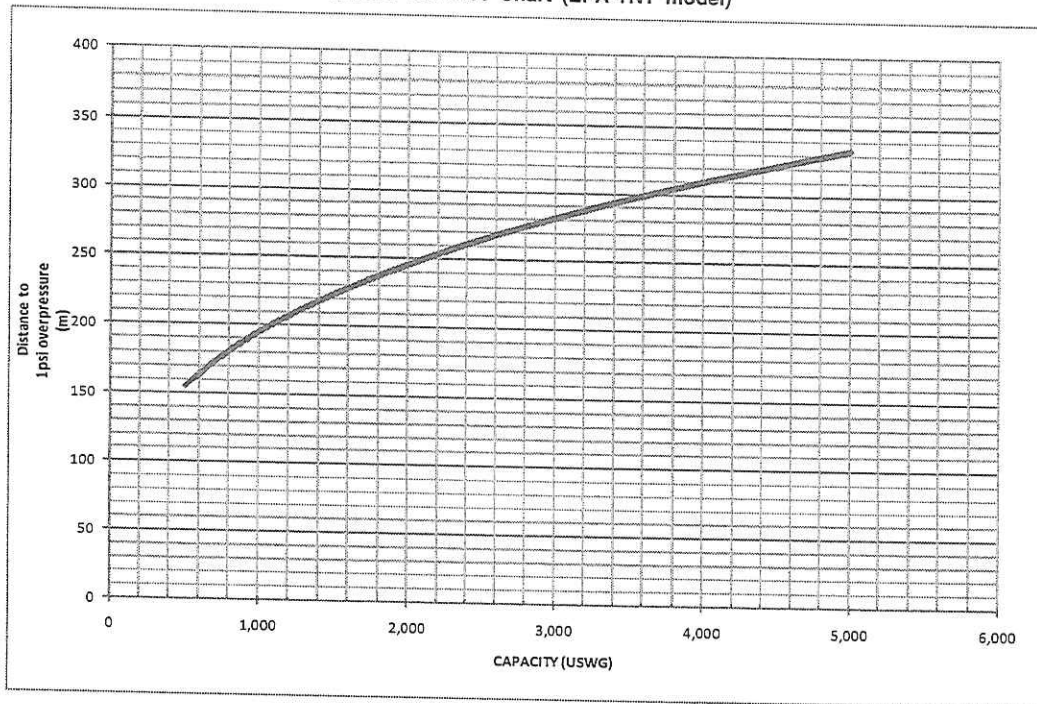
Table 1: Distance Table

Water Capacity (litres)	Nominal Water Capacity (USWG)	Distance to 1 psi overpressure (m)
1,890	500	155
3,780	1,000	195
4,920	1,300	213
6,620	1,750	235
7,130	1,885	241
7,560	2,000	246
18,900	5,000	333

**Formula:**  $D = 16.94 \times (1.524 \times C)^{1/3}$   
 D = Distance to overpressure of 1 psi (meters)  
 C = Tank Total Capacity in USWG

**Parameters:** Density of Propane is 0.5033 kg per litre @ 15 C  
 Assume all vessels are 80% full  
 1 gallon [US, liquid] = 0.003785411784 cubic meter  
 1 cubic metre = 264.17 USWG

Hazard Distance Chart (EPA-TNT model)



**Declaration:** I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) YUSHENG (SIMON) GUAN	Official Title PRESIDENT		
Signature 	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 70%; padding: 5px;">           Telephone No.            705-743-7851         </td> <td style="width: 30%; padding: 5px;">           Date (dd-mm-yyyy)            06-06-2013         </td> </tr> </table>	Telephone No. 705-743-7851	Date (dd-mm-yyyy) 06-06-2013
Telephone No. 705-743-7851	Date (dd-mm-yyyy) 06-06-2013		



Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION C: SUBMISSIONS (cont'd)**  
Applicant must include a Facility Site Plan and Map of Surrounding Area

As an accompaniment to the Map of Surrounding Area, provide the following information about buildings and features present within the circle in Table 2.

**Table 2: Buildings and Features**

Buildings and Features Present within the Circle on the Map of the Surrounding Area AND Name and Address of Closest Building or Feature	* Number of Buildings and Features (mark with an "X")				Distance from Tank to Closest Building or Feature
	0	1	2-10	11+	
Industrial buildings or parks or golf courses Name: _____ Address: _____ City: _____ Province _____ Postal Code _____	x				_____ m
Residential building units specifically permanent single family dwellings, condominiums, and apartments. Name: _____ Address: _____ City: _____				x	100 _____ m
Commercial building units specifically retail, restaurants, entertainment, theatres, and sporting complexes. Name: Cameron Cycle Address: 2232 Davis Road City: Cavan Monaghan Twp. Province Ontario Postal Code K9J 6X4			x		182 _____ m
Commercial building units – continuous occupancy specifically hotels, campgrounds, and resorts. Name: _____ Address: _____ City: _____ Province _____ Postal Code _____	x				_____ m
Sensitive institutions specifically hospitals, schools and day cares, nursing and retirement homes, mental health institutions, and prisons. Name: _____ Address: _____ City: _____ Province _____ Postal Code _____	x				_____ m
Emergency responders specifically fire stations, ambulance stations, and police stations. Name: _____ Address: _____ City: _____ Province _____ Postal Code _____	x				_____ m

\* For multi-unit buildings, count each unit as "1".

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) YUSHENG (SIMON) GUAN	Official Title PRESIDENT	
Signature 	Telephone No. 705-743-7851	Date (dd-mm-yyyy) 06-06-2013



Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
**Technical Standards and Safety Act**  
Propane Storage and Handling Regulation

**SECTION C: SUBMISSIONS (cont'd)**

Applicant must include a Facility Site Plan and Map of Surrounding Area

**Portable Storage Additional Information Sheet**

Cylinder Size	Capacity in USWG	Quantity	Total Volume in USWG
# 420	123.9		
# 100	29.5		
# 40	11.75		
# 33.3	9.62		
# 30	8.8	12	105.6
# 20	5.8	24	139.2
# 10	2.9		
# 5	1.5		
<b>Total Cylinder Capacity</b>		244.8 uswg	

**Tanks Stored On-site Not Connected for Use**

Tank Size In USWG	Quantity	Total Volume in USWG
<b>Total Tank Capacity</b>		0

<b>Total Cylinder Capacity</b>	244.8
<b>Total Tank Capacity</b>	0
<b>Total Portable Capacity</b>	244.8

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) YUSHENG (SIMON) GUAN	Official Title PRESIDENT	
Signature <i>yu sheng</i>	Telephone No. 705-743-7851	Date (dd-mm-yyyy) 06-06-2013



**Site Plan for Propane Dispenser:  
Golden Eagle Development Ltd.  
2622 Maple Grove Road  
The Township of  
Cavan Monaghan, Ontario**

(bc06/13)

Distances from 2000 uswg Propane Tank to:  
Nearest Building (Store) 8 metres  
Nearest Liquid Fuel Dispenser 17 metres



Property Line

99m

Asphalt Parking Lot

Cylinder  
Dispenser

Existing Post  
Protection

2000 uswg Propane  
Storage Tank

89m

27.5m

Asphalt

Store

Propane Motor  
Dispenser

Emergency Cut-off Switch

2 - Propane cylinder  
exchange cages

Drive Thru Lane

Canopy w/Liquid  
Fuel Dispensers

Parking

66.5m

Asphalt

Highway 7

Underground Liquid  
Fuel Storage Tanks  
1 x 50,000 litre gasoline &  
1 x Split 35,000 litre diesel/  
15,000 litre gasoline

Parking

Parking

Means of access  
& egress

Maple Grove Road

**Emergency  
Meeting Place**

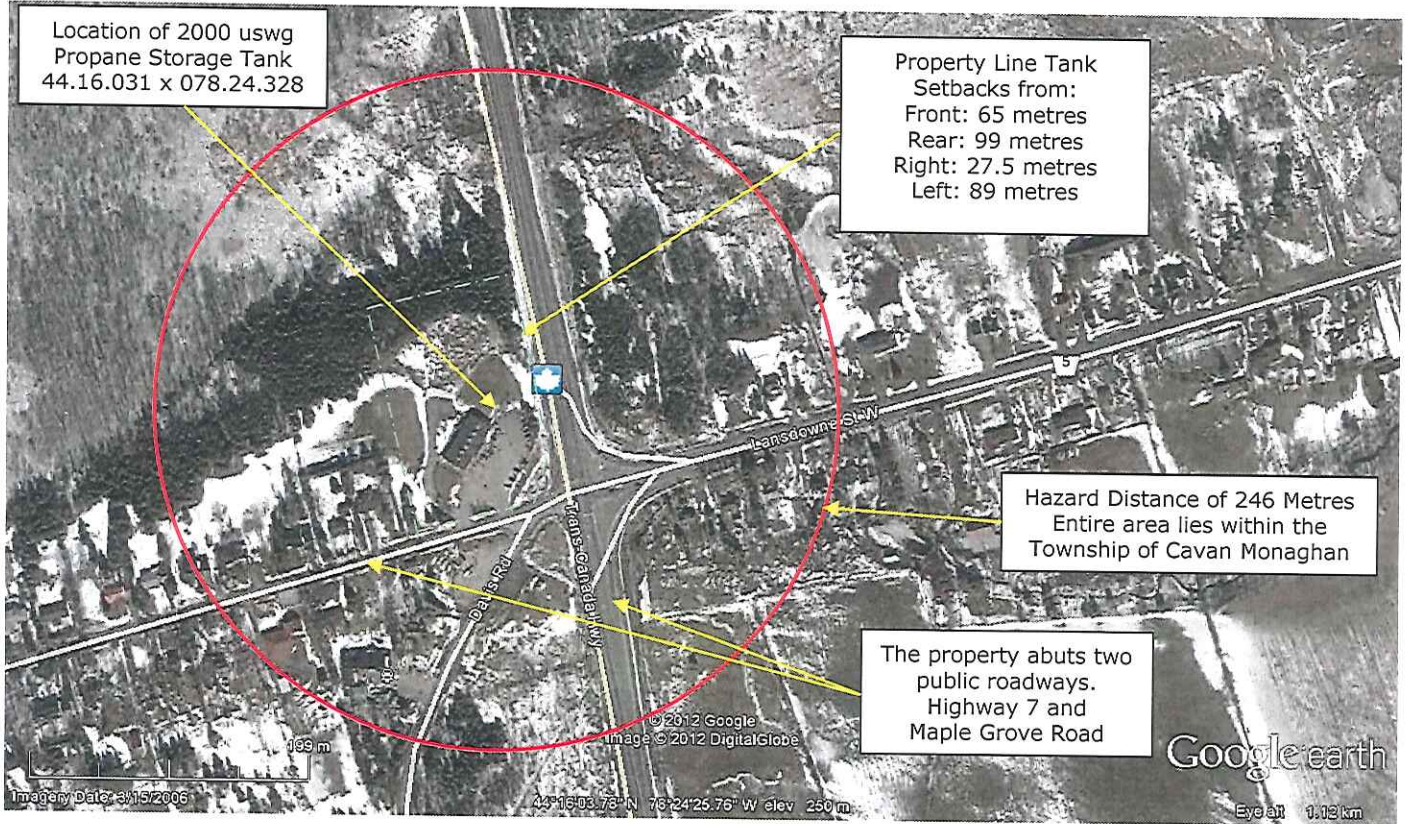
Davis Road

⊗ Fire Extinguisher

*Note:  
There are no propane bulk  
trucks parked at this facility*

# AERIAL MAP of GOLDEN EAGLE DEVELOPMENT LTD.

2622 Maple Grove Road, Township of Cavan Monaghan



Facility Address: 2622 Maple Grove Road, Township of Cavan Monaghan, Ontario	
Municipal Contact Information: Karen Ellis, Director of Planning Township of Cavan Monaghan kellis@cavanmonaghan.net 705-932-9334	Date Map Prepared:  April 5, 2013