Technical Standards and Safety Authority www.tssa.org

14th Floor - Centre Tower 3300 Bloor Street West Toronto Ontario M8X 2X4 Fax: 416.231.4903 Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP) Technical Standards and Safety Act Propane Storage and Handling Regulation

This Level 1 RSMP applies to: a facility with a total propane storage capacity of 5,000 USWG or less; or a facility with a fixed propane storage capacity of exactly 5,000 USWG and no more than 500 USWG of portable propane storage capacity on site. NDARDS & SZ Failure to fully complete this form may result in rejection. For Office Use Only Making a false statement may result in a fine or prosecution under the Technical Standards and Safety Act Licence Number 0076580992-C Check applicable type of propane operations ✓ Cylinder Motor Fill Filling Plant ___ Card/Keylock Submit along with this completed application a Facility Site Plan and a Map of the Surrounding Area SECTION A: GENERAL INFORMATION The Undersigned applies to TSSA for a review for an RSMP under Ontario's Technical Standards and Safety Act, Propane Storage and Handling Regulation. Ontario Corporation No., if applicable Company Name Canadian Tire Corporation Ltd. Operator Name (if different from above) (Joe Nicholas - Agent 905-812-3300) Telephone No E-mail (416) 544-7608 (416) 544-6163 john.lastoria@cantire.com Street Name / 911 Number / Address, if applicable Yonge Street, 17th Floor 1280 Postal Code Province Town / City or Township / County M4P 2V8 Ontario Toronto Mailing address if different from above. Street Name / 911 Number / Address, if applicable Street No. C (Account #34421) PO Box 770, Station K Postal Code Town / City or Township / County Province M4P 3J5 Ontario Toronto Information on Container Refill Centre or Filling Plant Location of facility. Street Name / 911 Number / Address, if applicable Street No. Nearest Major Intersection D 5980 Mavis Road and Britannia Road Mavis Road Postal Code Province Town / City or Township / County L5V 2T5 Ontario Mississauga Name of Licence Holder John Lastoria on behalf of Canadian Tire Corporation ROT type Name of a Senior Management person as defined in the regulation holding the Record of Training (ROT). 100-08 Municipality (or municipalities if the facility or its hazard distance touches multiple borders) City of Mississauga Hours of operation

This document is valid until the next licence renewal date. You are required by law to notify TSSA of any change of information.

Declaration: I am aware that it is an offence to give false information in this document and
I hereby declare that the information I have given here is true and complete.

Printname	Signature	Date (dd-mm-yyyy) 08-01-2012
Name of Licence Holder John Lastoria		00-01-2012
Name of Senior Management person as defined in the		F026100
Regulation holding the Record of Training Glen Butt		



14th Floor - Centre Tower 3300 Bloor Street West Safety Authority Fax: 416.231.4903 Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP) Technical Standards and Safety Act Propane Storage and Handling Regulation

SECTION A: GENERAL INFORMATION (co	ont'	(TION	A	3M	NFO	RAL	GENER	Δ.	SECTION	
------------------------------------	------	---	------	---	----	-----	-----	-------	----	---------	--

Indicate the year the facility was estat	olished. Indicate the year of any signi	ificant modifications, as defined in s.1, O.Reg 211/01, since establishment.	
Identify the psig rating and serial num	ber for each fixed propane storage tank	on site.	
PSIG	Serial Number		
Tank1: 250 PSIG	585-00		
Tank2:			
Tank3:			
Enter capacity of propane in USWG,	fixed, portable, and mobile, and provide	detailed inventory that includes the number of tank/vessel for	
) and the capacity of each tank/vessel,		
Fixed: 2000 USWG	Portable: 557 USWG	Mobile: 0	_
			ı
			ı
			l
			l
			1

Name of person compl John Lastoria	eting this form (please print)	Official Title E H & S Specialist	
Signature	x/	Telephone No. 416-544-7608	Date (dd-mm-yyyy) 08-01-2012
	Acc.	410-344-7000	



14th Floor - Centre Tower 3300 Bloor Street West Safety Authority
Fax: 416.231.4903 Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP) Technical Standards and Safety Act Propane Storage and Handling Regulation

SECTION A: GENERAL INFORMATION (contid)

Activity Information							
Name of Propar	ne Supplie	r(s)				For Office Use - I	Partv No.
Superior Propane -	Ontario Re	egional Operations Centre					
Street No.	Street Na	ame / 911 Number / Address	s, if applicable				
251	Woodlawr	Road West, Unit 217					-
Town / City or Touch	ownship /	Country			Province Ontario		Postal Code N1H 8J1
Telephone No.	î	Fax No.	Contact Na	ame			
1-877-873-7467		519-836-7766	Bruce Graha	nm (also 519-780-4913)		**************************************	
E-mail							
GrahamB@superi	orpropane.	com					
						For Office Use -	Party No
	- 2	orter. If same as above, p	lease check bo	ox.		100	
Superior Propane	W.			200-00-00-00-00-00-00-00-00-00-00-00-00-			
Street No. 7022		ame / 911 Number / Addres n Road 124S	s, if applicable				
Town / City or Tourist Guelph	ownship /	Country			Province Ontario		Postal Code N1H 6L3
Telephone No. (519) 831-6564		Fax No. N/A	Contact Na Chris VanHe				
E-mail vanherkc@superio	orpropane.c	com					
Off-site Cylinder None	r and/or M	lobile Storage		Capacity stored off-site	, in USWG	For Office Use -	Party No.
Street No.	Street Na	me / 911 Number / Address	s, if applicable				
Town / City or To	ownship /	Country			Province		Postal Code
Telephone No.	ĺ	Fax No.	Contact Na	ame	de la companya de la		
Note: Customer st	torage is n	ot considered off-site store	ane		NAMES OF THE OWNER OF THE OWNER, WHEN		

Name of person completing this form (please print) John Lastoria	Official Title E H & S Specialist		
Signature	Telephone No. 416-544-7608	Date (dd-mm-yyyy) 08-01-2012	



14th Floor - Centre Tower 3300 Bloor Street West Safety Authority
Fax: 416.231.4903 Customer Service: 1.877.682.8772 Level 1 Risk and Safety Management Plan (RSMP) Technical Standards and Safety Act Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN

The licence holder will complete Section B in consultation with the local Fire Services.

Description of the maximum volume, types and storage location of other hazardous materials on site, if any. Gasoline - The site has underground tanks with a total capacity of 180,000 litres. They are located on the south side of the gasoline dispensers.
An MSDS for regular unleaded gasoline is provided herein. MSDS for premium gasoline and diesel are similar and not included.
Description of fire and emergency equipment indicated on facility site map.
1. Fires Extinguisher Locations: a) Inside gas bar building b) On columns by gasoline dispensers c) At the bulk propane tank filling station
2. Emergency stop push button - near propane tank. This shuts down the pump and closes a solenoid valve upstream of hoses.
3. Power supply breaker inside the gas bar building. This cuts all power to the propane system - shuts down pump; closes solenoid valve.
List of fire protection controls (e.g., fire detection systems, fire notification systems, alarm systems, automatic shut off devices, fusible links, et
and describe their function, use and operation.
Emergency stop push button. This shuts down the pump and closes a solenoid valve upstream of hoses.
2. Fusible link on ISC valve - isolation valve between the tank and the downstream propane dispensing equipment.
3. Power supply breaker inside the gas bar building. This cuts all power to the propane system - shuts down pump; closes solenoid valve
ISC valve interlock bar (interlocked with cabinet door) - ISC valve closes when door is closed.
Maintenance and testing schedule for fire protection controls and devices. Maintenance and testing is undertaken by Superior Propane according to Superior Propane's Maintenance Standard. Schedule for key equipment is:
4. Dumps (Pump every 3 months: Pump Motor; check helts monthly; grease motor every 6 months); 2. ISC Valves (test for closure every 6 months)

Pumps (Pump every 3 months; Pump Motor: check belts monthly; grease motor every 6

3. Fusible links - inspected every 6 months; 4. Storage tank Relief Valves - inspect every 2 years; replacement schedule as per provincial regulations.

Maintenance records are kept for 5 years. 5. Fire extinguishers maintained by Canadian Tire in accordance with Ontario fire regulations.

Name of person completing this form (please print) John Lastoria	Official Title E H & S Specialist		
Signature	Telephone No.	Date (dd-mm-yyyy)	
	416-544-7608	08-01-2012	



14th Floor - Centre Tower 3300 Bloor Street West Safety Authority Fax: 416.231.4903 Customer Service: 1.877.682.8772 Level 1 Risk and Safety Management Plan (RSMP) Technical Standards and Safety Act Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

1. Contacts for Emergency Response

1. Facility Contact Personnel - Key	Contact)	5. Facility 24-Hour Contact Person	on	
Name Joe Nicholas	For C	Office Use - Party No.	Name Joe Nicholas		For Office Use - Party No.
Official Title Agent			Official Title Agent		
Telephone No. 905-812-3300	Fax No. 905-812-3300		Cell No. 647-704-2231	Fax No. 905-812-3300	
E-mail 1309.mississauga hea@ctpagent.ca			E-mail 1309.mississauga hea@ctpagent.ca		
Role and responsibilities in emergency	у		Role and responsibilities in emerger	псу	
Coordinate site response			Coordinate site response		
2. Facility Contact Personnel - Ali	ternate Contact		6. Name of Facility Manager		
Name Karl Degeus	For C	Office Use - Party No.	Name Joe Nicholas		For Office Use - Party No.
Official Title Regional Business Manager			Official Title Agent		
Telephone No. 905-609-2304	Fax No. 289-649-0841		Telephone No. work 905-812-3300 cell 647-704-2231	Fax No. 905-812-3300	
E-mail Karl.Degeus@cantire.com			E-mail 1309.mississauga hea@ctpagent.ca		
Role and responsibilities in emergency			Role and responsibilities in emergency		
Coordinate site response if agent is unavailable			Coordinate site response		
3. Local Fire Services - Key Contact	ct		7. Propane Supplier Key Contact	Person	
Name John McDougall	For O	Office Use - Party No.	Name Superior Propane Hotline		For Office Use - Party No.
Official Title Fire Chief	E-mail john.mcdougall(@mississauga.ca	Official Title	E-mail	
Telephone No. (905) 615-3750	Fax No. (905) 615-3773		Telephone No. 1-877-873-7467	Fax No.	
Role and responsibilities in emergency Coordinate/advise on Fire Service response contact.		police and CTC	Role and responsibilities in emergency Identify and dispatch Superior Propane and or LPERGC emergency response personnel as required.		
Fire Services Address Mississauga Fire Services, 15 Fairview Ro	d. W, Mississauga,	ON L5B 1K7	Propane Supplier Address 251 Woodlawn Road West, Unit 217, Guelph, ON		
4. Local Fire Services - Alternate C	ontact)	8. Municipal Contact		
Name Kevin Duffy	For C	Office Use - Party No.	Name Crystal Greer		For Office No.
Official Title Deputy Fire Chief -Prevention	E-mail kevin.duffy@mis	ssissauga.ca	Official Title City Clerk		
Telephone No. (905) 615-3758	Fax No. (905) 615-3773		Telephone No. (905) 615-3200 ext.5419	Fax No. (905) 615-418	I
Role and responsibilities in emergency Alternate - Coordinate/advise on Fire Servi CTC contact.		liaise with police and	E-mail crystal.greer@mississauga.ca		
Fire Services Address			Municipality Name and Address		
Mississauga Fire Services, 15 Fairview Rd. W, Mississauga, ON L5B 1K7			City of Mississauga, 300 City Centre Drive, Mississauga, ON, L5B 3C1		

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

	1000	
Name of person completing this form (please print)	Official Title	
John Lastoria	E H & S Specialist	
Signature	Telephone No.	Date (dd-mm-yyyy)
	416-544-7608	08-01-2012

FS 09195 (05/11) Page 5 of 1/5



14th Floor - Centre Tower 3300 Bloor Street West Safety Authority Fax: 416.231.4903 Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP) Technical Standards and Safety Act Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

2. Additional Safety Measures

Describe any other measures in place at the facility that exceed the minimum Code and Standards requirements.
Describe any other measures in place at the facility that exceed the minimum code and standards requirements. Emergency Shut Off push button to shut down pump and close solenoid valve upstream of dispensing hoses.
Emorgonoy onat on pash batton to onat astron pash, and astron pash, and astronomy on the control of the control

Name of person completing this form (please print) John Lastoria	Official Title E H & S Specialist		
Signature	Telephone No.	Date (dd-mm-yyyy)	
	416-544-7608	08-01-2012	



14th Floor - Centre Tower 3300 Bloor Street West Safety Authority
Fax: 416.231.4903 Customer Service: 1.877.682,8772 Level 1 Risk and Safety Management Plan (RSMP) Technical Standards and Safety Act Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

3. Record of Emergency Training Provided - For most recent 12-month period.

Training on Emergency Re	sponse Plan and Procedures provided to facility ke	y contacts.			
Training Date (dd-mm-yyyy)	Print Name of Training Provider: Canadian Tire St	andard Emergency Training	upon hire and yearly refreshers		
2010	Print Name of Instructor:				
Training Date (dd-mm-yyyy)	Print Name of Training Provider:	Please Note - The indu	stry has recently introduced a propane		
1Q 2012	Print Name of Instructor:	specific ER course - #9	11-02 (Dec.2011). Prior to December 2011		
Training Date (dd-mm-yyyy)	Print Name of Training Provider:	there wasn't one availa	ble. Canadian Tire agents will be		
	Print Name of Instructor:	completing this course	in January 2012.		
Training on the facility's Em	ergency Management Procedures provided to sta	ff.			
Training Date (dd-mm-yyyy)	Print Name of Training Provider: Canadian Tire S	tandard Emergency Training	upon hire and yearly refreshers		
2010	Print Name of Instructor:				
Training Date (dd-mm-yyyy)	Print Name of Training Provider: Key Site Contact to train staff				
1Q 2012	Print Name of Instructor:				
Training Date (dd-mm-yyyy)	Print Name of Training Provider:				
	Print Name of Instructor:				
On-site specific training pro	vided to certificate holders / persons with Records	of Training.			
Training Date (dd-mm-yyyy)	Print Name of Training Provider: Hardik Pandyer				
29-09-2010	Print Name of Instructor: Hardik Pandyer				
Training Date (dd-mm-yyyy)	Print Name of Training Provider: Superior Propan	e, FSN Training, or Other	Please Note - a ROT is valid for 3 years		
TBA as required	Print Name of Instructor: TBA as required		AND		
Training Date (dd-mm-yyyy)	Print Name of Training Provider:				
	Print Name of Instructor:				

Name of person completing this form (please print)	Official Title	Official Title			
John Lastoria	EH&S Specialist				
Signature	Telephone No.	Date (dd-mm-yyyy)			
	416-544-7608	08-01-2012			



14th Floor - Centre Tower 3300 Bloor Street West Safety Authority Fax: 416.231.4903 Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP) Technical Standards and Safety Act Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

4. Emergency Training Plan for Coming Year

Training on Emergency Resp	onse Plan and Procedures provided to facility key contacts.				
Target Date (dd-mm-yyyy)	Print Name of Training Provider: Canadian Tire Standard Emergency Training upon hire and yearly refreshers				
2011	Print Name of Instructor:				
Target Date (dd-mm-yyyy)	Print Name of Training Provider: Superior Propane, PTI, FSN, or Alternate	Please Note - the PTI just released the			
Q1 2012	Print Name of Instructor:	course material (Dec.) and Canadian Tire			
Target Date (dd-mm-yyyy)	Print Name of Training Provider:	agents will be the first to receive this training			
	Print Name of Instructor:	scheduled for the 1Q of 2012			
Training on the facility's Eme	rgency Management Procedures provided to staff.				
Target Date (dd-mm-yyyy)	Print Name of Training Provider: Key Site Contact to Train Staff				
Q1 2012	Print Name of Instructor: to be arranged				
Target Date (dd-mm-yyyy)	Print Name of Training Provider:				
	Print Name of Instructor:				
Target Date (dd-mm-yyyy)	Print Name of Training Provider:				
	Print Name of Instructor:				
On-site specific training provi	ided to certificate holders / persons with Records of Training.				
Target Date (dd-mm-yyyy)	Print Name of Training Provider: FSN Training or Alternate P	lease Note - ROT training is valid for 3 years			
TBA as required	Print Name of Instructor: to be arranged as required				
Target Date (dd-mm-yyyy)	Print Name of Training Provider:				
	Print Name of Instructor:				
Target Date (dd-mm-yyyy)	Print Name of Training Provider:				
	Print Name of Instructor:				

Name of person completing this form (please print)		Official Title	Official Title		
John Lastoria		E H & S Specialist	E H & S Specialist		
Signature		Telephone No. 416-544-7608	Date (dd-mm-yyyy) 08-01-2012		



14th Floor - Centre Tower 3300 Bloor Street West Safety Authority Fax: 416.231.4903 Customer Service: 1.877.682.8772 Level 1 Risk and Safety Management Plan (RSMP) Technical Standards and Safety Act Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

5. Emergency Response Communications Plan

Warn	ings	and	Acti	ons
------	------	-----	------	-----

Describe who gives warnings to whom, and how and when the warning will be given (including public notification as appropriate). The agent/operator or alternate (both ROT staff) will contact emergency services by calling 911 and will provide warnings as outlined in the attached

Propane Emergency Response Procedures placard(to be posted at site and be part of employee training). If it is safe to do so, this could involve advising neighbors to evacuate. The owner/operator may also contact Superior Propane via the emergency number identified in the ERP

Describe what action is to be taken and by whom when a warning is issued (including details of a meeting place in a safe identified area and activating the evacuation plan, if necessary).

The agent/operator or alternate should first follow the actions in the ERP's provided herein. Staged evacuation, if the release of propane cannot be stopped by cutting electrical power, may be required. The initial muster location will be at the front doors of the Canadian Tire warehouse store, and away from a dispersing propane cloud. Subsequent evacuation instructions potentially up to the Hazard Distance to be provided by municipal emergency responders.

Residences and businesses beyond the site boundary to be notified by municipal emergency responders.

Communication	with	Emergency	Response	Authorities
Communication	AAIEII	Line gency	Heaponac	MUNICO

Describe when and how the licence holder will give early warning to emergency response authorities (including a process to ens	ure that a	a call is
placed to 911).		

When the system is operational, site staff will be on duty and be in the propane tank area. The Key Contact or alternate will be implementing ER actions and notifications, including notifying emergency responders. Calling 911 will occur immediately after any attempts to shut down the system.

When the system is not in operation, the ISC valve (main isolation valve) is closed, and the propane system is unattended, but is shutdown.

Any accidents involving the propane tank during such times will require the intervention of random, nearby individuals

Describe provisions for fire department entry when there are no operations or staffing at the propane site.

The propane tank system is located in a open area that is easily accessible from Mavis Road and Britannia Road.

The access routes for fire trucks are identified in the attached site plan.

Describe how the licence holder will ensure continual flow of updated information to authorities.

The critical information required from the license holder is information on how to shut the system down and the fill level in the tank (if known).

This will be provided by agent - Joe Nicholas, verbally if on-site, or by cell phone during off hours.

Fill level is relevant from a time-to-BLEVE perspective (a near empty tank will BLEVE sooner than a full tank if there is fire impingement on the tank)

How long will it take the facility liaison person to respond to the site.

It would take the 24 hour contact, Joe Nicholas, approximately 45 minutes to arrive on-site after having received the emergency call.

Name of person completing this form (please print) John Lastoria	Official Title E H & S Specialist		
Signature	Telephone No. 416-544-7608	Date (dd-mm-yyyy) 08-01-2012	



14th Floor - Centre Tower 3300 Bloor Street West Safety Authority
Fax: 416.231.4903 Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP) Technical Standards and Safety Act Propane Storage and Handling Regulation

SECTION B	EMERGENCY	AND	PREPAREDNESS	RESPONSE	PLAN	(cont'd)

	The licence holder will complete Section B in consultation with the local Fire Services.					
	The licence holder will complete Section B in consultation with the loc 6. Building and Site Security and Procedures	an ne oerv	1000.			
	o, building and one occurry and 1 tooleanse		TELMINION FOR THE STATE OF THE			
		Yes	No			
1.	Does the propane location have controlled access to limit unnecessary risk and entry (lock out procedures)?		\checkmark			
2.	Is there adequate night lighting at the site?	\checkmark				
3.	Are procedures in place that ensure access routes, aisles, storage area, filling areas and the grounds are kept clear from unwanted materials?	√				
4.	Are there procedures that capture and record the daily inspection of hoses and inspection requirements for filling systems and mechanical devices used in the transfer of propane?	√				
5.	Does the facility have procedures that include a process to isolate and purge any overfilled propane cylinders?	\checkmark				
6.	Are weighing systems validated for accuracy?	√				
7.	Are storage areas clearly marked with the vessels' capacity status (i.e., filled, empty, purged and other hazardous materials)?		\checkmark			
8.	Are quality assurance procedures in place to ensure that all valves are closed after the propane cylinders are filled?(e.g., QCC valves)	1				
9.	Is the schedule of maintenance and testing activities retained on site?	\checkmark				
	7. Water Supply					
The sup	propane licence holder should work with the local fire department to determine water ply capabilities that are available based on the propane facility's location.	Yes	No			
1.	Is a pressurized water system available at the propane facility site?	√				
2.	Can the municipal fire department pump 375 GPM (1420 LPM) of water at this location?	V				
3.	What is the unobstructed distance to the closest water supply that could be used for firefighting activities? (distance in metres only)	75 m	and the second s			
4.	What is the unobstructed distance to the closest approved water supply with year round access if there are no hydrants? (distance in metres only)	N/A				

Name of person completing this form (please print) John Lastoria	Official Title E H & S Specialist		
Signature	Telephone No. 416-544-7608	Date (dd-mm-yyyy) 08-01-2012	



Technical Standards and Safety Authority Fax: 416.231.4903 www.tssa.org

14th Floor - Centre Tower 3300 Bloor Street West Toronto Ontario M8X2X4 Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP) Technical Standards and Safety Act Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

8. Licence holder and local Fire Services Review						
To be completed by the Local Fire Services Has the local fire service had an opportunity to review the Emergency F If not, please explain (e.g., no fire services).	Yes response and Preparedness Plan?	No				
Fire services comments, if any:		:				
To be completed by the Licence Holder In response to the above comments, the following action(s) is required:						
The licence holder will respond to the Local Fire Services comments	by:(dd-mm-yyyy)					
LOCAL FIRE SERVICES						
The undersigned has reviewed Section B of the Risk and Safety Management Plan Fire Services.						
Print name	Signature	Date (dd-mm-yyyy)				
Local Fire Services Name						

Name of person completing this form (please print) John Lastoria	Official Title E H & S Specialist			
Signature	Telephone No. 416-544-7608	Date (dd-mm-yyyy) 08-01-2012		



Technical Standards and Safety Authority www.tssa.org

14th Floor - Centre Tower 3300 Bloor Street West Toronto Ontario M8X2X4 Fax: 416.231.4903 Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP) Technical Standards and Safety Act

Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS

Applicant must include a Facility Site Plan and Map of Surrounding Area

Facility Site Plan.

The licence holder will submit a copy of the original facility site plan updated with the following information:

- 1. The storage location of fixed, portable, and mobile vessels.
- 2. The maximum volume, types and storage location of hazardous materials.
- 3. Location of permanent structures on site.
- 4. Access and egress points and location of barriers.
- 5. Location of fire and emergency equipment (e.g., sprinkler systems, extinguishers, suppression systems) on site and location of fire hydrant or water supply where available.
- Location of emergency shut off/shut down switches/valves.

Map of Surrounding Area.

The licence holder will submit a scaled aerial map of the surrounding area showing the following information:

- 7. The capacity and placement of the single largest propane storage vessel, including its setback from the front, rear and side property lines.
- 8. GPS co-ordinates of the single largest vessel.
- 9. Visual indication of the single largest fixed vessel and a circle made using the distance in Table 1 as the radius from the single largest fixed vessel.
- 10. Clear indication of the municipality or municipalities present within the circle.
- 11. Visual indication of property line information.
- 12. The location and name of roads within or abutting the site.
- 13. Key note to the drawing indicating the facility's municipal address, municipal lot number(s) and concession lines as applicable, and the date the map was prepared.
- 14. Address and contact information for each municipality (municipal clerk or secretary-treasurers of planning board). (Refer to page 5.)
- 15. Complete "Required Mapping Information from Updated Site Plan" in table below .

Required Mapping Information from Updated Site Plan

Date Map Prepared (dd-mm-yyyy) 13-12-2011		Capacity of single largest propand 2000 USWG	Capacity of single largest propane storagevessel (USWG) 2000 USWG		
Tank setback coordinates.			46 m		
Front: 38 m Rear: 28 m		Right side property line: Left side property line:	3 m		
GPS coordinates of single	largest vessel:	Lat. 43.6116 Long79.6955			

Name of person completing this form (please print) John Lastoria	Official Title E H & S Specialist		
Signature	Telephone No.	Date (dd-mm-yyyy)	
The state of the s	416-544-7608	08-01-2012	

SECTION C: SUBMISSIONS (cont'd)

Applicant must include a Facility Site Plan and Map of Surrounding Area

Table 1: Distance Table

Water Capacity (litres)	Nominal Water Capacity (USWG)	Distance to 1 psi overpressure (m)
1,890	500	155
3,780	1,000	195
4,920	1,300	213
6,620	1,750	235
7,130	1,885	241
7,560	2,000	246
18,900	5,000	333

Formula:

 $D = 16.94 \times (1.524 \times C)^{1/3}$

D = Distance to overpressure of 1 psi (meters)

C= Tank Total Capacity in USWG

Parameters:


Density of Propane is 0.5033 kg per litre @ 15 C

Assume all vessels are 80% full

1 gallon [US, liquid] = 0.003785411784 cubic meter

1 cubic metre = 264.17 USWG

Hazard Distance Chart (EPA-TNT model)

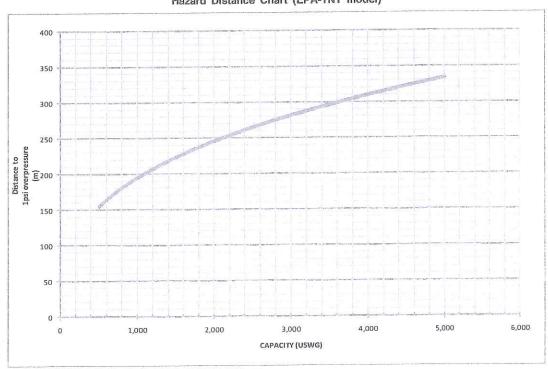



14th Floor - Centre Tower 3300 Bloor Street West Toronto Ontario M8X2X4 Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP) Technical Standards and Safety Act Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)

Applicant must include a Facility Site Plan and Map of Surrounding Area

As an accompaniment to the Map of Surrounding Area, provide the following information about buildings and features present within the circle in Table 2. Table 2: Buildings and Features

	uildings and Features Present within the Circle on the Map of the Surrounding Area AND Name and Address of Closest Building or Feature		* Number of Building and Features (mark with an "X")			Distance from Tank to Closest Building or Feature
Name:	buildings or parks or golf courses None within Hazard Distance Province Postal Code	Х				m
Name:	al building units specifically permanent single family dwellings, condominiums, and apartments. None within Hazard Distance	X			•	0m
Commerce Name: Address: City:	ial building units specifically retail, restaurants, entertainment, theatres, and sporting complexes. Canadian Tire Store, McDonald's, Mother Tuckers, Staples, Krispy Kreme, and others Mavis Road and Britannia Road Mississauga Province ON Postal Code			7	X	<u>60</u> m
Name:	ial building units – continuous occupancy specifically hotels, campgrounds, and resorts. None within Hazard Distance Province Province Postal Code	X				0m
institution Name:	institutions specifically hospitals, schools and day cares, nursing and retirement homes, mental health s, and prisons. None within Hazard Distance Province Province Postal Code	X				0 m
Name:	cy responders specifically fire stations, ambulance stations, and police stations. None within Hazard Distance Province Province Postal Code	X				0m

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) John Lastoria	Official Title E H & S Specialist		
Signature	Telephone No. 416-544-7608	Date (dd-mm-yyyy) 08-01-2012	

FS 09195 (05/11) Page 14 of 15

^{*} For multi-unit buildings, count each unit as "1".



 Technical
 14th Floor - Centre Tower

 Standards and
 3300 Bloor Street West

 Toronto Ontario M8X 2X4
 Tax: 416.231.4903

 www.tssa.org
 Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)

Technical Standards and Safety Act

Propane Storage and Handling Regulation

WORKSHEET

Portable Storage Additional Information Worksheet

Cylinder Size	Capacity in USWG	Quantity	Total Volume in USWG
# 420	123.9		
# 100	29.5		
# 40	11.75		
# 33.3	9.62		
# 30	8.8		
# 20	5.8	96	557 USWG
# 10	2.9		
# 5	1.5		


Tanks Stored On-site Not Connected for Use

Quantity	Total Volume in USWG
1	2000 USWG
	Quantity 1

	557 USWG
Total Cylinder Capacity	557 0500
Total Tank Capacity	2000 USWG
Total Portable Capacity (Total Cylinder Capacity + Total Tank Capacity)	2557 USWG

CANADIANTIRE STOLLE
5980 MANIS ROAD
MISSISSAUGA, DATARIO
LSV 2T5

LINE of PROPERTY

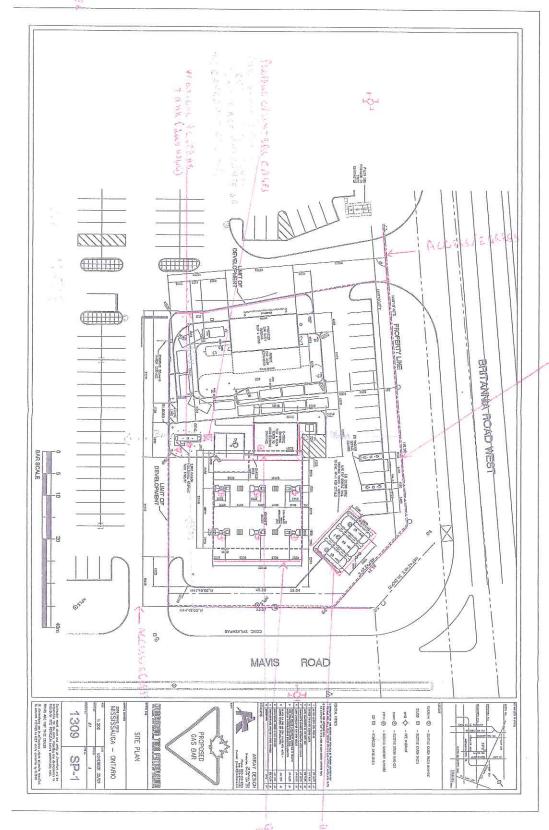

井1309

