



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

July 28

This Level 1 RSMP applies to:

- a facility with a total propane storage capacity of 5,000 USWG or less; or
- a facility with a fixed propane storage capacity of exactly 5,000 USWG and no more than 500 USWG of portable propane storage capacity on site.


Failure to fully complete this form may result in rejection. Making a false statement may result in a fine or prosecution under the *Technical Standards and Safety Act*

Licence Number **000159210**

Check applicable type of propane operations.

Cylinder Motor Fill Filling Plant Card/Keylock

Submit along with this completed application a Facility Site Plan and a Map of the Surrounding Area.

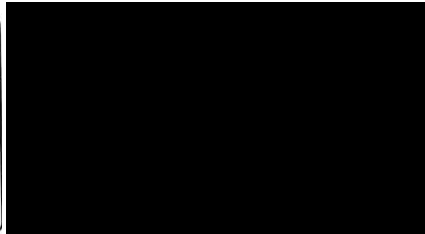

SECTION A: GENERAL INFORMATION

The Undersigned applies to TSSA for a review for an RSMP under Ontario's *Technical Standards and Safety Act*, Propane Storage and Handling Regulation.

Company Name **Western Mechanical Electrical Millwright Services Ltd** Ontario Corporation No., if applicable

Operator Name (if different from above)

Telephone No. **705 737 - 4135** Fax No. **705 737 - 1765** E-mail **bbradshaw@westernmechanical.net**

Street No. **160** Street Name / 911 Number / Address, if applicable **Brock Street**

Town / City or Township / County **Barrie** Province **Ontario** Postal Code **L4N 2M4**

Mailing address if different from above.

Street No. Street Name / 911 Number / Address, if applicable

Town / City or Township / County Province Postal Code

Information on Container Refill Centre or Filling Plant

Location of facility.

Street No. **160** Street Name / 911 Number / Address, if applicable **Brock Street** Nearest Major Intersection **Brock and Anne Streets**

Town / City or Township / County **Barrie** Province **Ontario** Postal Code **L4N 2M4**

Name of Licence Holder **Western Mechanical Electrical Millwright Services Ltd**

Name of a Senior Management person as defined in the regulation holding the Record of Training (ROT). ROT type **400 04 Filling Forklift Cylinders by Volume**

Peter Duivenvoorden

Municipality (or municipalities if the facility or its hazard distance touches multiple borders) **Barrie, Ontario**

Hours of operation.

This document is valid until the next licence renewal date. You are required by law to notify TSSA of any change of information.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Print name	Signature	Date (dd-mm-yyyy)
Name of Licence Holder Western Mechanical Electrical Millwright Services Ltd	 Please Print & Sign before returning to TSSA	25/08/2011
Name of Senior Management person as defined in the Regulation holding the Record of Training Peter Duivenvoorden		



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION A: GENERAL INFORMATION (cont'd)


Indicate the year the facility was established. N/A Indicate the year of any significant modifications, as defined in s.1, O.Reg 211/01, since establishment. 2015

Identify the psig rating and serial number for each fixed propane storage tank on site.

	PSIG	Serial Number
Tank 1:	<u>250</u>	<u>243.4</u>
Tank 2:	_____	_____
Tank 3:	_____	_____

Enter capacity of propane in USWG, fixed, portable, and mobile, and provide detailed inventory that includes the number of tank/vessel for each type (fixed, portable, and mobile) and the capacity of each tank/vessel, on a separate document.

Fixed: 2000 USWG Portable: _____ Mobile: _____



Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) <u>Hamid Norouzi</u>	Official Title <u>Process Compliance coordinator</u>	
Signature 	Telephone No. <u>519-827-2061</u>	Date (dd-mmm-yyyy) <u>26-05-2015</u>



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4078
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION A: GENERAL INFORMATION (cont'd)
Activity Information

Name of Propane Supplier(s) Superior Propane - Ontario Regional Operations Centre			
Street No. 251	Street Name / 911 Number / Address, if applicable Woodlawn Road West, Unit 217		
Town / City or Township / Country Guelph		Province Ontario	Postal Code N1H 8J1
Telephone No. 1-877-873-7467	Fax No. 519-836-7766	Contact Name David Marvin - Operations Manager, Ontario Region,	
E-mail david_marvin@Superiorpropane.com			

Name of Propane Transporter. If same as above, please check box. <input type="checkbox"/>			
Superior Propane - Barrie			
Street No. 789	Street Name / 911 Number / Address, if applicable Bayview Drive		
Town / City or Township / Country Barrie		Province Ontario	Postal Code L4N 9A5
Telephone No. (416) 459-9705	Fax No.	Contact Name Dan Parmenter	
E-mail ParmentD@SuperiorPropane.com			

Off-site Cylinder and/or Mobile Storage	Capacity stored off-site, in USWG	For Office Use - Party No.
Street No.	Street Name / 911 Number / Address, if applicable	
Town / City or Township / Country	Province	Postal Code
Telephone No.	Fax No.	Contact Name

Note: Customer storage is not considered off-site storage.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Hamid Norouzi	Official Title Process Compliance Coordinator	
Signature 	Telephone No. 519-827-2061	Date (dd-mm-yyyy) 26-05-2015



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario MBX 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN

The licence holder will complete Section B in consultation with the local Fire Services.

Description of the maximum volume, types and storage location of other hazardous materials on site, if any.

DEISEL FUEL - 950 LITERS, USED ENGINE OIL (BURNT AS HEATING FUEL IN WINTER) 1892 LITERS,
PAINT GUN WASH from 0 to 300 LITERS TYP, (AWAITING PICK-UP BY RECYCLER)

Description of fire and emergency equipment indicated on facility site map.

20 lb ABC portable fire extinguishers located at filling point and cylinder storage.
Various portable fire extinguishers located about the building, water type sprinkler system.

List of fire protection controls (e.g., fire detection systems, fire notification systems, alarm systems, automatic shut off devices, fusible links, etc.) and describe their function, use and operation.

Tank is equipped with a fusible link system, Emergency electrical disconnect switch at filling station located on the Bolard, emergency shutoff remotely located in main building.
3rd party monitoring of building security and fire sprinkler systems.

Maintenance and testing schedule for fire protection controls and devices.

Superior Propane maintenance includes, 6 month pump and ISC inspections and a bi-annual relief valve inspections.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Bob Bradshaw		Official Title Health & Safety Coordinator	
Signature 	Telephone No. 705 737 - 4135		Date (dd-mm-yyyy) 705 737 - 1765



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

1. Contacts for Emergency Response

1. Facility Contact Personnel - Key Contact		5. Facility 24-Hour Contact Person	
Name Bob Bradshaw	For Office Use - Party No.	Name Peter Duivenvoorden	For Office Use - Party No.
Official Title H&S coordinator		Official Title Owner	
Telephone No. (705) 737-4135	Fax No. (705) 737-1765	Cell No. (705) 623-1048	Fax No. (705) 737-1765
E-mail bbradshaw@westernmechanical.net		E-mail peterdsr@westernmechanical.net	
Role and responsibilities in emergency Safety - Coordinator for all emergency situations.		Role and responsibilities in emergency Owner - overall control	
2. Facility Contact Personnel - Alternate Contact		6. Name of Facility Manager	
Name Joe Givens	For Office Use - Party No.	Name Doug Dinniwell	For Office Use - Party No.
Official Title Manager		Official Title General Manager	
Telephone No. (705) 737-4135	Fax No. (705) 737-1765	Telephone No. (705) 737-4135	Fax No. (705) 737-1765
E-mail jgivens@westernmechanical.net		E-mail ddinniwell@westernmechanical.net	
Role and responsibilities in emergency control of resources		Role and responsibilities in emergency Operational responsibility for site.	
3. Local Fire Services - Key Contact		7. Propane Supplier Key Contact Person	
Name John Lynn	For Office Use - Party No.	Name Shane Morrison	For Office Use - Party No.
Official Title Fire Chief		Official Title Area Manager Superior Propane	
Telephone No. (705) 728-3199	Fax No. (705) 728-1277	Telephone No. (705) 644-4775	Fax No.
E-mail lynnj@barrie.ca		E-mail morrison@superiorpropane.com	
Role and responsibilities in emergency Overall direction / control of fire fighting resources.		Role and responsibilities in emergency Supplier Resources / technical support.	
4. Local Fire Services - Alternate Contact		8. Municipal Contact	
Name Rick Monkman	For Office Use - Party No.	Name Wendell McArthur	
Official Title Deputy Fire Chief		Official Title Director of Engineering	
Telephone No. (705) 728-3199	Fax No. (705) 739-1277	Telephone No. (705) 739 - 4220 x 4551	Fax No. (705) 728-4439
E-mail rmonkman@barrie.ca		E-mail wmcarthur@barrie.ca	
Role and responsibilities in emergency Assists / augments Fire Chief.		Municipality Barrie	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Bob Bradshaw	Official Title Health & Safety Coordinator
Signature Please Print & Sign before returning to TSSA	Telephone No. 705 737 - 4135
	Date (dd-mm-yyyy) 705 737 - 1765



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario MBX 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

2. Additional Safety Measures

Describe any other measures in place at the facility that exceed the minimum Code and Standards requirements.
See attached Western Procedures H&S 01-04 and 10-25 for emergency response.

[Large area with horizontal dashed lines for writing additional safety measures]

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Bob Bradshaw		Official Title Health & Safety Coordinator	
Signature 	Please Print & Sign before returning to TSSA	Telephone No. 705 737 - 4135	Date (dd-mm-yyyy) 705 737 - 1765



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

3. Record of Emergency Training Provided - For most recent 12-month period.

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Training Date (dd-mm-yyyy) 26 / March / 2010	Print Name of Training Provider: Western Mechanical Electrical Millwright Services
	Print Name of Instructor: Bob Bradshaw
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Training on the facility's Emergency Management Procedures provided to staff.

Training Date (dd-mm-yyyy) 26 / March / 2010	Print Name of Training Provider: Western Mechanical Electrical Millwright Services
	Print Name of Instructor: Bob Bradshaw
Training Date (dd-mm-yyyy) 31 / March / 2010	Print Name of Training Provider: Western Mechanical Electrical Millwright Services
	Print Name of Instructor: Bob Bradshaw
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

On-site specific training provided to certificate holders / persons with Records of Training.

Training Date (dd-mm-yyyy) 25 / Jan / 2010	Print Name of Training Provider: FSN Training (3 year renewals)
	Print Name of Instructor: Bill Bird T254
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Bob Bradshaw	Official Title Health & Safety Coordinator	
Signature 	Telephone No. 705 737 - 4135	Date (dd-mm-yyyy) 705 737 - 1765



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

4. Emergency Training Plan for Coming Year

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Target Date (dd-mm-yyyy) 30/09/2011	Print Name of Training Provider: Western Mechanical Electrical Millwright Services Ltd
	Print Name of Instructor: Bob Bradshaw
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Training on the facility's Emergency Management Procedures provided to staff.

Target Date (dd-mm-yyyy) 30/09/2011	Print Name of Training Provider: Western Mechanical Electrical Millwright Services Ltd
	Print Name of Instructor: Bob Bradshaw
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

On-site specific training provided to certificate holders / persons with Records of Training.

Target Date (dd-mm-yyyy) 31/01/2013	Print Name of Training Provider: FSN Training (3 year renewals)
	Print Name of Instructor: Unknown
Target Date (dd-mm-yyyy) 30/09/2011	Print Name of Training Provider: Western Mechanical Electrical Millwright Services Ltd
	Print Name of Instructor: Bob Bradshaw
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Bob Bradshaw	Official Title Health & Safety Coordinator
Signature Please Print & Sign before returning to TSSA	Telephone No. 705 737 - 4135 Date (dd-mm-yyyy) 705 737 - 1765



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

5. Emergency Response Communications Plan

Warnings and Actions

Describe who gives warnings to whom, and how and when the warning will be given (including public notification as appropriate).

Person seeing dangerous situation will pull emergency stop(s) on Propane system and initiate internal Fire / Evacuation plan by Public Address phone system.

Emergency alert phone calls will be made from the safety of the MUSTER POINT (the Western Sign) on Brock Street.

H&S Coordinator and / or Snr Manager on site will be contacted by cell phone or directly as appropriate.

Fighting of fires will be only attempted in the case of very small fires, otherwise evacuation and Emergency services notification only will be done.

Describe what action is to be taken and by whom when a warning is issued (including details of a meeting place in a safe identified area and activating the evacuation plan, if necessary).

All personel evacuate building by designated local fire escape and meet at designated RV point at front of building (sign on Brock St).

Managers verify personel count and confirms Emergency calls have been made per the plan.

Communication with Emergency Response Authorities

Describe when and how the licence holder will give early warning to emergency response authorities (including a process to ensure that a call is placed to 911).

Any abnormal conditions will be inspected and warning calls (Fire Dept, Superior Propane, neighbours) as appropriate to the inspection results.

Describe provisions for fire department entry when there are no operations or staffing at the propane site.

Entry will be gained by cutting chain link gate padlock and entering east driveway, line of site to tank from Brock Street, or by cutting chain link gate lock on North side and entering from John St

Describe how the licence holder will ensure continual flow of updated information to authorities.

Site responder (safety, owner, manager) will provide facilities details as required, the amount of Prppane and other fuels on site if known. Provide and access or resources required.

How long will it take the facility liaison person to respond to the site.

Normaly less than 20 mins.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Bob Bradshaw		Official Title Health & Safety Coordinator	
Signature 	Please Print & Sign before returning to TSSA	Telephone No. 705 737 - 4135	Date (dd-mm-yyyy) 705 737 - 4135



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

6. Building and Site Security and Procedures

- | | Yes | No |
|---|-------------------------------------|-------------------------------------|
| 1. Does the propane location have controlled access to limit unnecessary risk and entry (lock out procedures)? | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 2. Is there adequate night lighting at the site? | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 3. Are procedures in place that ensure access routes, aisles, storage area, filling areas and the grounds are kept clear from unwanted materials? | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 4. Are there procedures that capture and record the daily inspection of hoses and inspection requirements for filling systems and mechanical devices used in the transfer of propane? | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| Column for check before use on fill tally sheet. | | |
| 5. Does the facility have procedures that include a process to isolate and purge any overfilled propane cylinders? | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| Cylinders will be recovered and repaired by Superior Propane. | | |
| 6. Are weighing systems validated for accuracy? | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| Filling is by volume only. | | |
| 7. Are storage areas clearly marked with the vessels' capacity status (i.e., filled, empty, purged and other hazardous materials)? | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 8. Are quality assurance procedures in place to ensure that all valves are closed after the propane cylinders are filled?(e.g., QCC valves) | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 9. Is the schedule of maintenance and testing activities retained on site? | <input checked="" type="checkbox"/> | <input type="checkbox"/> |

7. Water Supply

The propane licence holder should work with the local fire department to determine water supply capabilities that are available based on the propane facility's location.

- | | Yes | No |
|---|-------------------------------------|--------------------------|
| 1. Is a pressurized water system available at the propane facility site? | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 2. Can the municipal fire department pump 375 GPM (1420 LPM) of water at this location? | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 3. What is the unobstructed distance to the closest water supply that could be used for firefighting activities? (distance in metres only) | <u>176.8 meters</u> | |
| 4. What is the unobstructed distance to the closest approved water supply with year round access if there are no hydrants? (distance in metres only) | <u>n/a</u> | |

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Bob Bradshaw		Official Title Health & Safety Coordinator	
Signature 		Telephone No. 705 737 - 4135	Date (dd-mm-yyyy) 705 737 - 1765



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

8. Licence holder and local Fire Services Review

To be completed by the Local Fire Services

Has the local fire service had an opportunity to review the Emergency Response and Preparedness Plan?

Yes	No
<input checked="" type="checkbox"/>	<input type="checkbox"/>


If not, please explain (e.g., no fire services).

Fire services comments, if any:

To be completed by the Licence Holder


In response to the above comments, the following action(s) is required:

The licence holder will respond to the Local Fire Services comments by:


N/A. 
(dd-mm-yyyy)

LOCAL FIRE SERVICES

The undersigned has reviewed Section B of the Risk and Safety Management Plan Fire Services.

Local Fire Services Name	Print name DAVE FORFAR	Signature Please Print & Sign before returning to TSSA 	Date (dd-mm-yyyy) 24-05-2011
--------------------------	----------------------------------	---	--

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

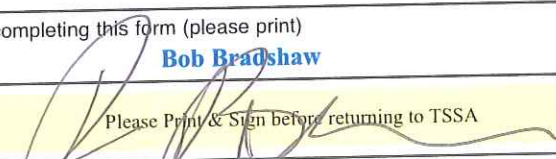Name of person completing this form (please print) Bob Bradshaw	Official Title Health & Safety Coordinator
Signature Please Print & Sign before returning to TSSA 	Telephone No. 705 737 - 4135
	Date (dd-mm-yyyy) 705 737 - 1765



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS

Applicant must include a Facility Site Plan and Map of Surrounding Area

Facility Site Plan.

The licence holder will submit a copy of the original facility site plan updated with the following information:

1. The storage location of fixed, portable, and mobile vessels.
2. The maximum volume, types and storage location of hazardous materials.
3. Location of permanent structures on site.
4. Access and egress points and location of barriers.
5. Location of fire and emergency equipment (e.g., sprinkler systems, extinguishers, suppression systems) on site and location of fire hydrant or water supply where available.
6. Location of emergency shut off/shut down switches/valves.

Map of Surrounding Area.

The licence holder will submit a scaled aerial map of the surrounding area showing the following information:

7. The capacity and placement of the single largest propane storage vessel, including its setback from the front, rear and side property lines.
8. GPS co-ordinates of the single largest vessel.
9. Visual indication of the single largest fixed vessel and a circle made using the distance in Table 1 as the radius from the single largest fixed vessel.
10. Clear indication of the municipality or municipalities present within the circle.
11. Visual indication of property line information.
12. The location and name of roads within or abutting the site.
13. Key note to the drawing indicating the facility's municipal address, municipal lot number(s) and concession lines as applicable, and the date the map was prepared.
14. Address and contact information for each municipality (municipal clerk or secretary-treasurers of planning board). (Refer to page 5.)
15. Complete "Required Mapping Information from Updated Site Plan" in table below .

Required Mapping Information from Updated Site Plan

Date Map Prepared (dd-mm-yyyy) Site Plan - 12/01/2010 -	Capacity of single largest propane storage vessel (USWG) 2000 USWG
Tank setback coordinates. Indicate placement on the map.	
Front: <u>115 m</u>	Right side property line: <u>120 m</u>
Rear: <u>210 m</u>	Left side property line: <u>110 m</u>
GPS coordinates of single largest vessel: <u>40° 22' 27.23" N x 79° 42' 13.36" W</u>	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Bob Bradshaw	Official Title Health & Safety Coordinator
Signature Please Print & Sign before returning to TSSA	Telephone No. 705 737 - 4135
	Date (dd-mm-yyyy) 705 737 - 1765



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)

Applicant must include a Facility Site Plan and Map of Surrounding Area


Table 1: Distance Table

Water Capacity (litres)	Nominal Water Capacity (USWG)	Distance to 1 psi overpressure (m)
1,890	500	155
3,780	1,000	195
4,920	1,300	213
6,620	1,750	235
7,130	1,885	241
7,560	2,000	246
18,900	5,000	333

Formula: $D = 16.94 \times (1.524 \times C)^{1/3}$
 D = Distance to overpressure of 1 psi (meters)
 C = Tank Total Capacity in USWG

Parameters: Density of Propane is 0.5033 kg per litre @ 15 C
 Assume all vessels are 80% full
 1 gallon [US, liquid] = 0.003785411784 cubic meter
 1 cubic metre = 264.17 USWG

Hazard Distance Chart (EPA-TNT model)

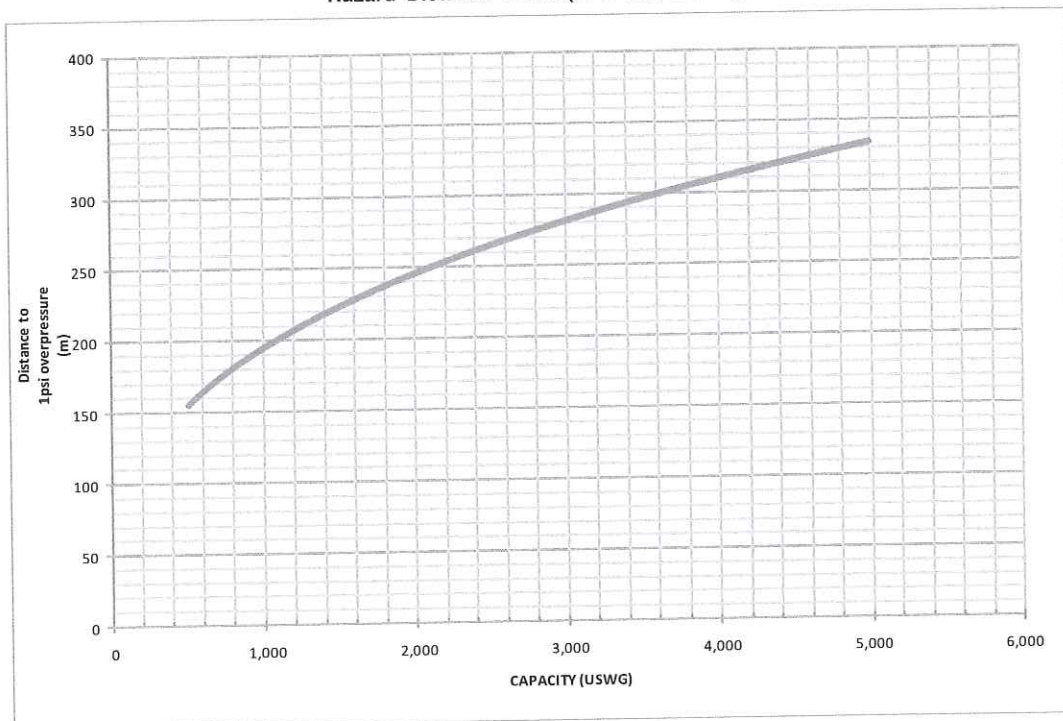

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Bob Bradshaw		Official Title Health & Safety Coordinator	
Signature <i>[Signature]</i> Please Print & Sign before returning to TSSA		Telephone No. 705 737 - 4135	Date (dd-mm-yyyy) 705 737 - 1765



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)

Applicant must include a Facility Site Plan and Map of Surrounding Area

As an accompaniment to the Map of Surrounding Area, provide the following information about buildings and features present within the circle in Table 2.

Table 2: Buildings and Features

Buildings and Features Present within the Circle on the Map of the Surrounding Area AND Name and Address of Closest Building or Feature	* Number of Buildings and Features (mark with an "X")				Distance from Tank to Closest Building or Feature
	0	1	2-10	11+	
Industrial buildings or parks or golf courses Name: <u>Moore Packaging</u> Address: <u>191 John Street.</u> City: <u>Barrie</u> Province <u>Ontario</u> Postal Code <u>L4N 2L4</u>		X			<u>90</u> m
Residential building units specifically permanent single family dwellings, condominiums, and apartments. [Redacted]		X			<u>75</u> m
Commercial building units specifically retail, restaurants, entertainment, theatres, and sporting complexes. Name: <u>Fix Auto / Roberts Collision</u> Address: <u>150 Brock Street</u> City: <u>Barrie</u> Province <u>Ontario</u> Postal Code <u>L4N 2M4</u>		X			<u>60</u> m
Commercial building units – continuous occupancy specifically hotels, campgrounds, and resorts. Name: _____ Address: _____ City: _____ Province _____ Postal Code _____					_____ m
Sensitive institutions specifically hospitals, schools and day cares, nursing and retirement homes, mental health institutions, and prisons. Name: _____ Address: _____ City: _____ Province _____ Postal Code _____					_____ m
Emergency responders specifically fire stations, ambulance stations, and police stations. Name: _____ Address: _____ City: _____ Province _____ Postal Code _____					_____ m

* For multi-unit buildings, count each unit as "1".

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Bob Bradshaw	Official Title Health & Safety Coordinator
Signature Please Print & Sign before returning to TSSA	Telephone No. 705 737 - 4135 Date (dd-mm-yyyy) 705 737 - 1765



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario MBX 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)
Applicant must include a Facility Site Plan and Map of Surrounding Area

Portable Storage Additional Information Sheet


Cylinder Size	Capacity in USWG	Quantity	Total Volume in USWG
# 420	123.9		
# 100	29.5		
# 40	11.75		
# 33.3	9.62	225	2164.5
# 30	8.8		
# 20	5.8		
# 10	2.9		
# 5	1.5		
Total Cylinder Capacity			


Tanks Stored On-site Not Connected for Use

Tank Size In USWG	Quantity	Total Volume in USWG
2000	1	2000
Total Tank Capacity		2000

Total Cylinder Capacity	2164.5
Total Tank Capacity	2000
Total Portable Capacity	0

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

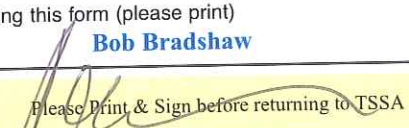Name of person completing this form (please print) Bob Bradshaw		Official Title Health & Safety Coordinator	
Signature  Please Print & Sign before returning to TSSA		Telephone No. 705 737 - 4135	Date (dd-mm-yyyy) 705 737 - 1765

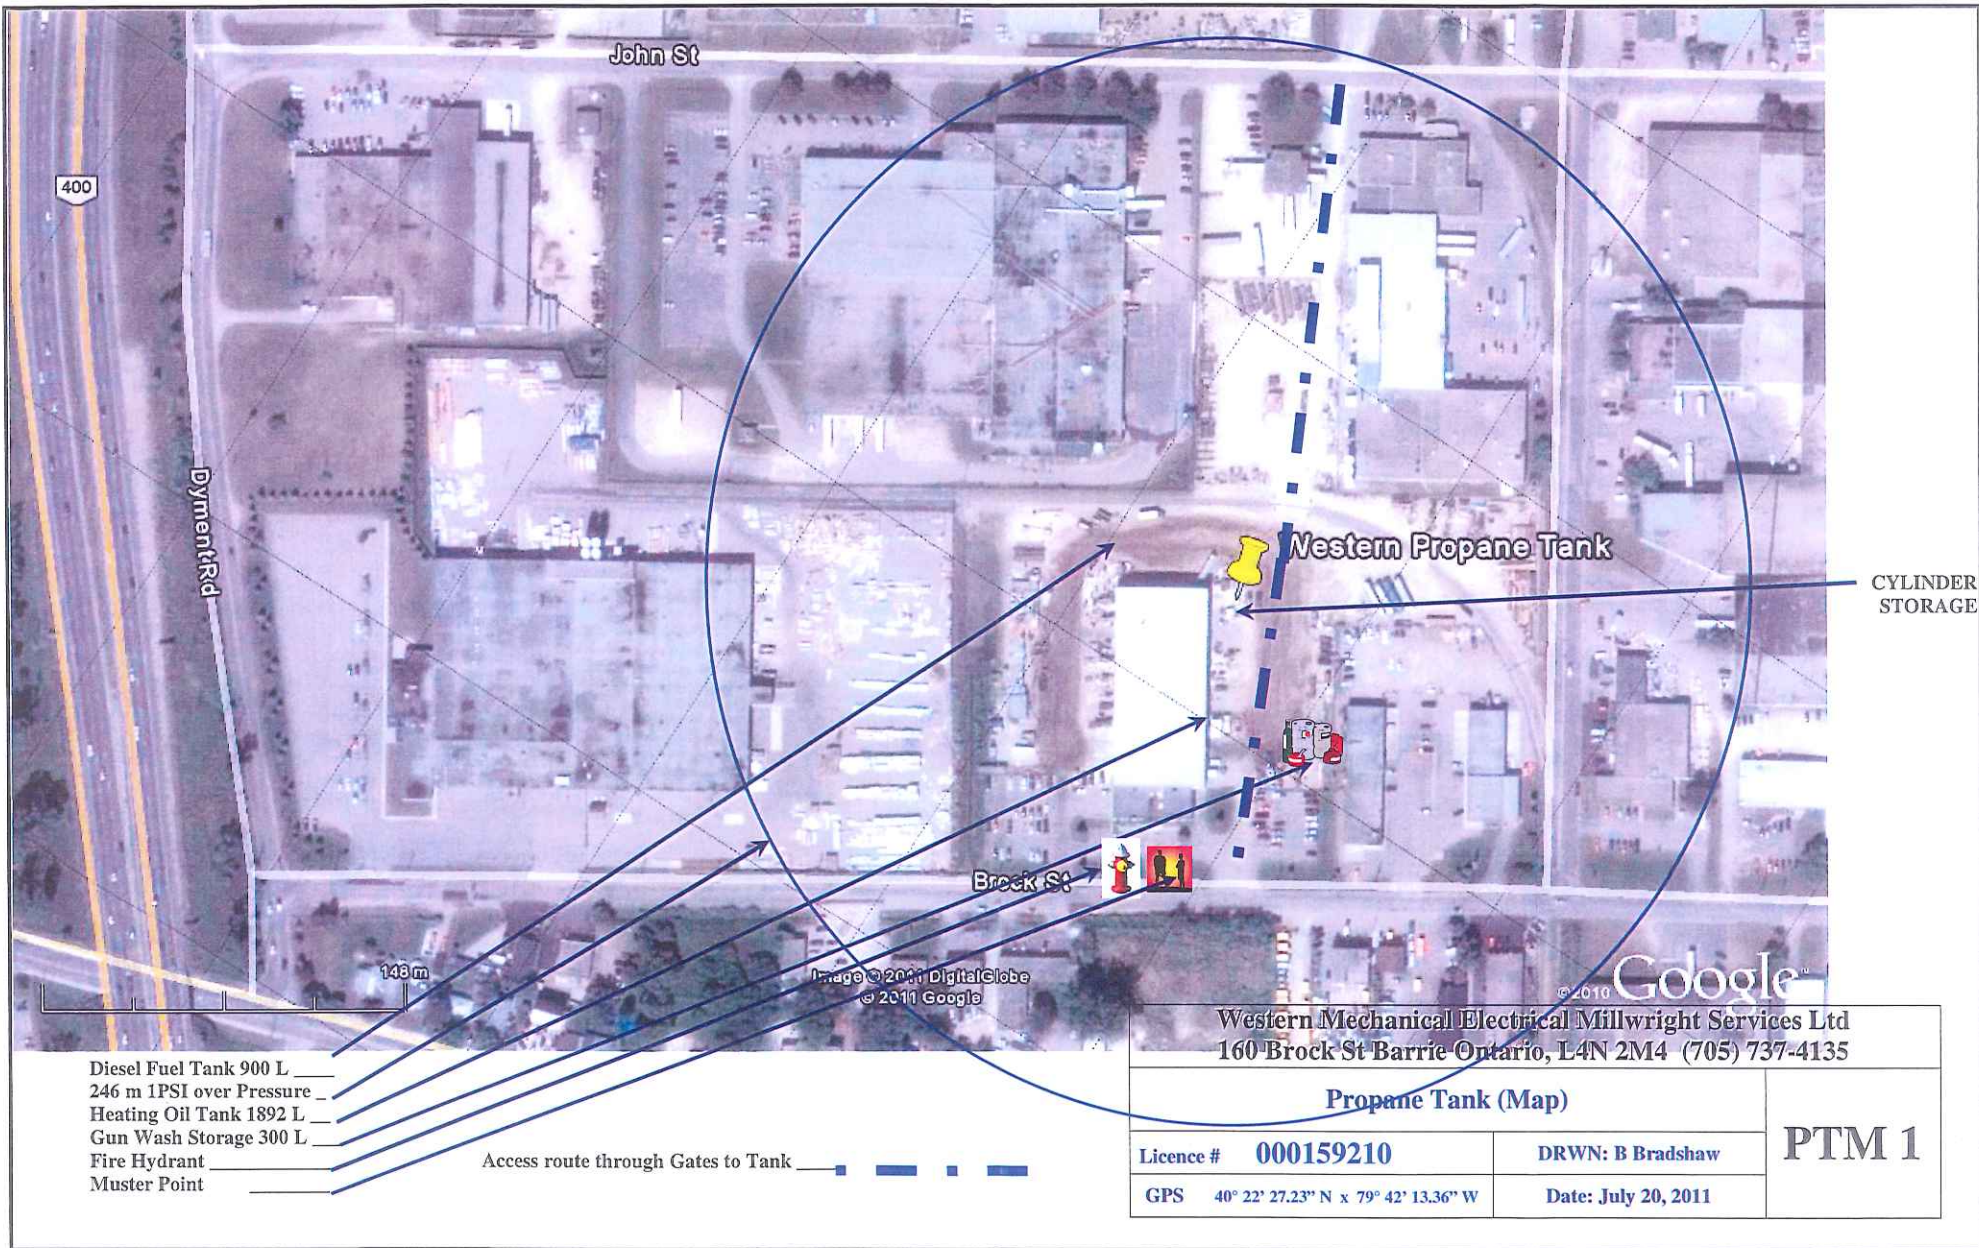


- Diesel Fuel Tank 900 L _____
- 246 m 1PSI over Pressure _____
- Heating Oil Tank 1892 L _____
- Gun Wash Storage 300 L _____
- Fire Hydrant _____
- Muster Point _____

Access route through Gates to Tank - - - - -


CYLINDER STORAGE

Western Mechanical Electrical Millwright Services Ltd 160 Brock St Barrie Ontario, L4N 2M4 (705) 737-4135		
Propane Tank (Map)		
Licence #	000159210	DRWN: B Bradshaw
GPS	40° 22' 27.23" N x 79° 42' 13.36" W	Date: July 20, 2011
		PTM 1


Propane Filling Area



MAIN FLOOR SAFETY AND EVACUATION MAP

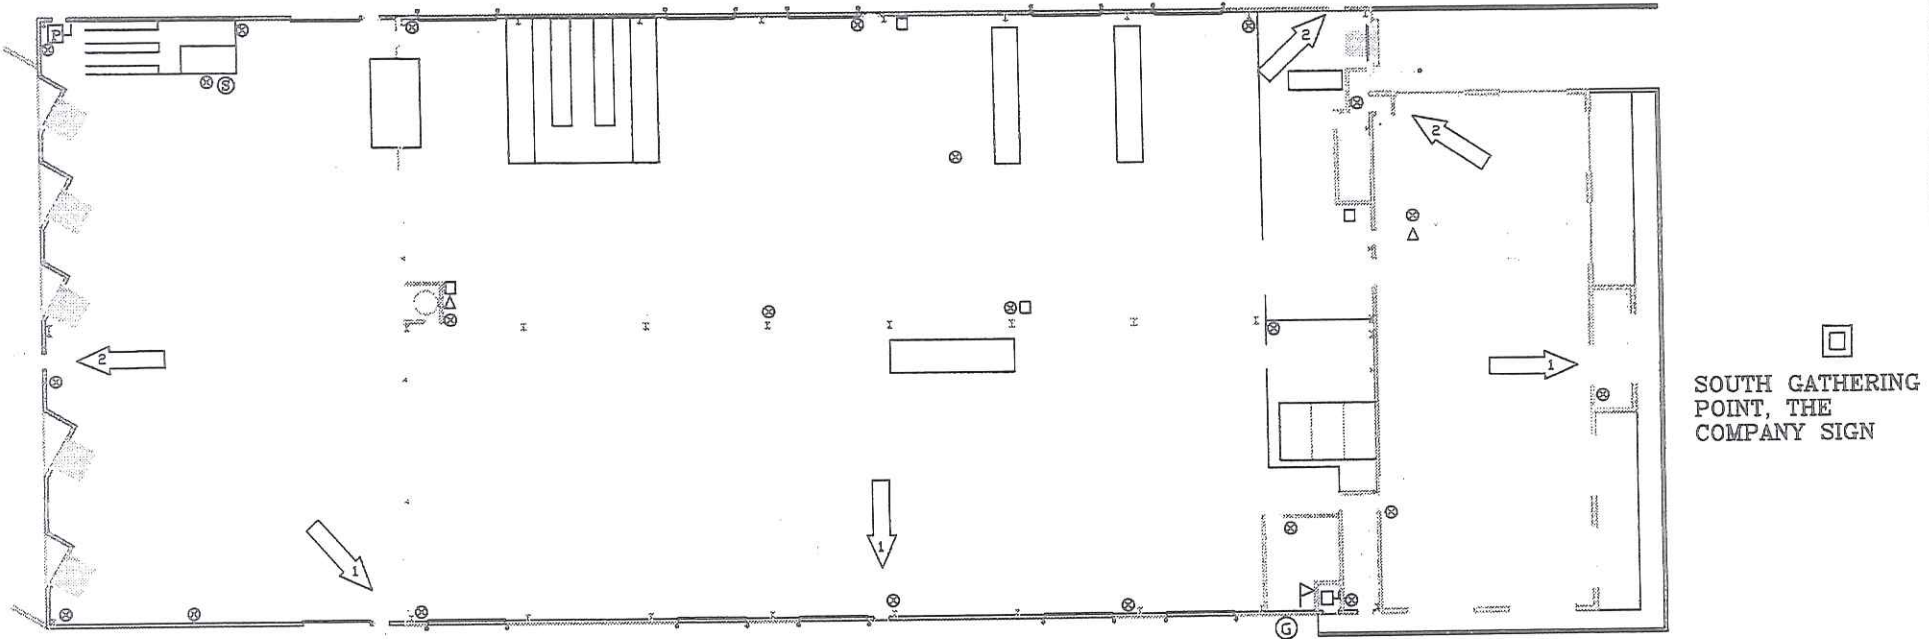

LEGEND:



EXIT POINT, 1 IS THE PRIMARY EXIT, 2 IS THE SECONDARY EXIT



GATHERING POINT



MAIN ELECTRICAL DISCONNECT



SPILL CONTAINMENT KIT



EYE WASH STATION



SPRINKLER STANDPIPE



FIRST AID KIT



GAS MAIN SHUT OFF



FIRE EXTINGUISHER



PROPANE TANK SHUT OFF



WEST GATHERING POINT 'THE SCHOOL HOUSE'



SOUTH GATHERING POINT, THE COMPANY SIGN