



Technical Standards and Safety Authority
 www.tssa.org
 14th Floor - Centre Tower
 3300 Bloor Street West
 Toronto Ontario M8X 2X4
 Fax: 416.231.4903
 Customer Service: 1.877.692.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
 Propane Storage and Handling Regulation

This Level 1 RSMP applies to:

- a facility with a total propane storage capacity of 5,000 USWG or less; or
- a facility with a fixed propane storage capacity of [redacted] USWG or less; or
- a facility with a fixed propane storage capacity of [redacted] USWG of portable propane storage capacity on [redacted]


Failure to fully complete this form may result in rejection.
 Making a false statement may result in a fine or prosecution
 under the *Technical Standards and Safety Act*

Licence Number 000156040

Check applicable type of propane operations.

Cylinder Motor Fit Filling Plant Card/Keylock

Submit along with this completed application a Facility Site Plan and a Map of the Surrounding Area.

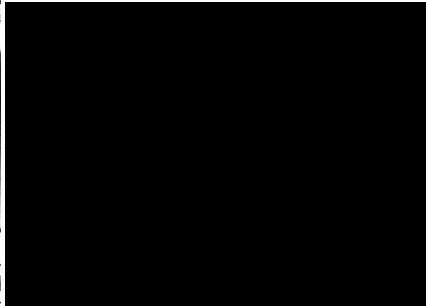

SECTION A: GENERAL INFORMATION

The Undersigned applies to TSSA for a review for an RSMP under Ontario's *Technical Standards and Safety Act*, Propane Storage and Handling Regulation.

A Company Name Presstran Industries Ontario Corporation No., if applicable _____

Operator Name (if different from above) _____

Telephone No. 519-633-7000 Fax No. 519-633-2533 E-mail bfitzpatrick@cosma.com

B Street No. 170 Street Name / 911 Number / Address, if applicable Edward Street

Town / City or Township / County St. Thomas Province Ont Postal Code N5P 4B4

Mailing address if different from above, _____

C Street No. _____ Street Name / 911 Number / Address, if applicable _____

Town / City or Township / County _____ Province _____ Postal Code _____

Information on Container Refill Centre or Filling Plant

Location of facility.

D Street No. 170 Street Name / 911 Number / Address, if applicable Edward Street Nearest Major Intersection EDWARD ST. & BURWELL ST. *BA.*

Town / City or Township / County St. Thomas Province Ont Postal Code _____

Name of Licence Holder Presstran Industries

Name of a Senior Management person as defined in the regulation holding the Record of Training (ROT). Jeff Shewaga ROT type 400-04

Municipality (or municipalities if the facility or its hazard distance touches multiple borders) St. Thomas

Hours of operation.

This document is valid until the next licence renewal date. You are required by law to notify TSSA of any change of information.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of Licence Holder	Print name <u>Brian FitzPatrick</u>	Signature	Date (dd-mm-yyyy) <u>08/04/2011</u>
Name of Senior Management person as defined in the Regulation holding the Record of Training	<u>Jeff Shewaga</u>	Signature	Date (dd-mm-yyyy) <u>08/04/2011</u>



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION A: GENERAL INFORMATION (cont'd)


Indicate the year the facility was established. 1984 Indicate the year of any significant modifications, as defined in s.1, O.Reg 211/01, since establishment. 2010

Identify the psig rating and serial number for each fixed propane storage tank on site.

	PSIG	Serial Number
Tank1:	<u>250 PSI @ 115</u>	<u>T32 215292</u>
Tank2:	_____	_____
Tank3:	_____	_____

Enter capacity of propane in USWG, fixed, portable, and mobile, and provide detailed inventory that includes the number of tank/vessel for each type (fixed, portable, and mobile) and the capacity of each tank/vessel, on a separate document.

Fixed: 2000 USWG - One only Portable: 33.3 LB - 68 tanks Mobile: _____



Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Brian FitzPatrick	Official Title Purchasing Manager	
Signature 	Telephone No. 519-633-7080	Date (dd-mm-yyyy) 08/04/2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION A: GENERAL INFORMATION (cont'd)

Activity Information

Name of Propane Supplier(s) Superior Propane		For Office Use - Party No.	
Street No. 7652	Street Name / 911 Number / Address, if applicable Queensline, Hwy 2 West		
Town / City or Township / Country Chatham		Province Ont.	Postal Code N7M 5J5
Telephone No. 1-877-873-7467	Fax No. 905 780 5849	Contact Name Susan Roy	
E-mail roys@superiorpropane.com			

Name of Propane Transporter. If same as above, please check box. <input checked="" type="checkbox"/>		For Office Use - Party No.	
Street No.	Street Name / 911 Number / Address, if applicable		
Town / City or Township / Country		Province	Postal Code
Telephone No.	Fax No.	Contact Name	
E-mail			

Off-site Cylinder and/or Mobile Storage		Capacity stored off-site, in USWG	For Office Use - Party No.
Street No.	Street Name / 911 Number / Address, if applicable		
Town / City or Township / Country		Province	Postal Code
Telephone No.	Fax No.	Contact Name	

Note: Customer storage is not considered off-site storage.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Brian FitzPatrick		Official Title Purchasing Manager	
Signature 	Telephone No. 519-633-7080	Date (dd-mm-yyyy) 03/04/2011	



Technical Standards and Safety Authority
 www.tssa.org
 14th Floor - Centre Tower
 3300 Bloor Street West
 Toronto Ontario M8X2X4
 Fax: 416.231.4903
 Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
 Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN

The licence holder will complete Section B in consultation with the local Fire Services.

Description of the maximum volume, types and storage location of other hazardous materials on site, if any.

Presstran's Emergency Response Plan (Section 7) identifies the description and location of hazardous materials. The main hazardous materials include a 1,360 L diesel tank located outside east of building; a 225 L diesel tank located on 2nd floor mezzanine beside the compressor room; 15 acetylene cylinders located outside east of bay door #37 (north central); 5-15 oxygen cylinders located in northeast Stamping Department; 10 (10-60 gal) Flammable Cabinets containing paints, aerosols, cleaners/degreasers in various areas; 9,500 L waste oil tank in water treatment room, 15 drums of oil in water treatment room.

Description of fire and emergency equipment indicated on facility site map.

Eight hydrants and seven siamese connections.

List of fire protection controls (e.g., fire detection systems, fire notification systems, alarm systems, automatic shut off devices, fusible links, etc.) and describe their function, use and operation.

Simplex Grinnel fire alarm system. Damar Monitoring Service. We are a completely sprinklered facility. We have audible / visual "horn strobes" throughout the facility. Presstran's EPRP also covers "failures: for alarm system etc. (3.1.1)

Maintenance and testing schedule for fire protection controls and devices.

Monthly riser / alarm activation inspections and testing. Bi-yearly inspection of the Range Guard system. Monthly fire extinguisher inspections. Monthly emergency exit signs / lighting inspections. Weekly riser / pressure inspections. Weekly FM200 suppression system inspection. Yearly fire alarm inspection and certification. Yearly 3rd party fire extinguisher inspections.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Brian FitzPatrick	Official Title Purchasing Manager
Signature 	Telephone No. 519-633-7080
	Date (dd-mm-yyyy) 08/04/2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

1. Contacts for Emergency Response

1. Facility Contact Personnel - Key Contact		5. Facility 24-Hour Contact Person	
Name Jeff Shewaga	For Office Use - Party No.	Name Stinson Security	For Office Use - Party No.
Official Title Assistant General Manager		Official Title On site 24/7 security services	
Telephone No. 519-633-7080	Fax No. 519-633-2533	Cell No. 519-633-7080	Fax No.
E-mail jshewaga@cosma.com		E-mail stinson@cosma.com	
Role and responsibilities in emergency Senior Management Contact		Role and responsibilities in emergency To contact applicable emergency unit/persons and facility personnel	
2. Facility Contact Personnel - Alternate Contact		6. Name of Facility Manager	
Name Jeff Bouwman	For Office Use - Party No.	Name Jeff Shewaga	For Office Use - Party No.
Official Title Assistant General Manager		Official Title Assistant General Manager	
Telephone No. 519-633-7080	Fax No. 519-633-2533	Telephone No. 519-633-7080	Fax No. 519-633-2533
E-mail jbouwman@cosma.com		E-mail jshewaga@cosma.com	
Role and responsibilities in emergency Senior Management contact		Role and responsibilities in emergency Senior Management Contact	
3. Local Fire Services - Key Contact		7. Propane Supplier Key Contact Person	
Name Robert Broadbent	For Office Use - Party No.	Name Susan Roy	For Office Use - Party No.
Official Title Fire Chief		Official Title Account Manager	
Telephone No. 519-631-0210	Fax No. 519-631-0215	Telephone No. 519-954-4226	Fax No. 519-954-4227
E-mail rbroadbent@city.st-thomas.on.ca		E-mail roys@superiorpropane.com	
Role and responsibilities in emergency Main contact for fire services		Role and responsibilities in emergency Propane supplier contact.	
4. Local Fire Services - Alternate Contact		8. Municipal Contact	
Name Oscar Jensen	For Office Use - Party No.	Name Wendell Graves	For Office Use - Party No.
Official Title Deputy Chief		Official Title Clerk	
Telephone No. 519-631-0210	Fax No. 519-631-0215	Telephone No. 519-631-1680	Fax No. 519-633-9019
E-mail ojensen@city.st-thomas.on.ca		E-mail wgraves@city.st-thomas.on.ca	
Role and responsibilities in emergency Alternate contact for fire services		Municipality City of St. Thomas	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Brian FitzPatrick	Official Title Purchasing Manager
Signature 	Telephone No. 519-633-7080
	Date (dd-mm-yyyy) 08/04/2011



Technical Standards and Safety Authority
 www.tssa.org
 14th Floor - Centre Tower
 3300 Bloor Street West
 Toronto Ontario M8X 2X4
 Fax: 416.231.4903
 Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
 Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

2. Additional Safety Measures

Describe any other measures in place at the facility that exceed the minimum Code and Standards requirements.
 Not applicable.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Brian FitzPatrick	Official Title Purchasing Manager	
Signature 	Telephone No. 519-633-7080	Date (dd-mm-yyyy) 08/04/2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

3. Record of Emergency Training Provided - For most recent 12-month period.

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Training Date (dd-mm-yyyy) 4/31/2011	Print Name of Training Provider: Presstran Industries
	Print Name of Instructor: Department Managers - each department to communicate EPRP
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Training on the facility's Emergency Management Procedures provided to staff.

Training Date (dd-mm-yyyy) 3/31/2011	Print Name of Training Provider: Presstran Industries
	Print Name of Instructor: Department Managers - each department to communicate EPRP
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

On-site specific training provided to certificate holders / persons with Records of Training.

Training Date (dd-mm-yyyy) 12/30/2011	Print Name of Training Provider: Bright Group (initial training), renewals through Ontario Propane Association
	Print Name of Instructor: Doug Russell
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Brian FitzPatrick	Official Title Purchasing Manager
Signature 	Telephone No. 519-633-7080
	Date (dd-mm-yyyy) 08/04/2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

4. Emergency Training Plan for Coming Year

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Target Date (dd-mm-yyyy) 2/29/2012	Print Name of Training Provider: Presstran Industries
	Print Name of Instructor: Department Managers - each department to communicate EPRP
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Training on the facility's Emergency Management Procedures provided to staff.

Target Date (dd-mm-yyyy) 2/29/2012	Print Name of Training Provider: Presstran Industries
	Print Name of Instructor: Department Managers - each department to communicate EPRP
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

On-site specific training provided to certificate holders / persons with Records of Training.

Target Date (dd-mm-yyyy)	Print Name of Training Provider: Bright Group (initial training), renewals through Ontario Propane Association
	Print Name of Instructor: Doug Russell
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Brian FitzPatrick	Official Title Purchasing Manager
Signature 	Telephone No. 519-633-7080
	Date (dd-mm-yyyy) 08/04/2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

5. Emergency Response Communications Plan

Warnings and Actions

Describe who gives warnings to whom, and how and when the warning will be given (including public notification as appropriate). Supervisor/Employee may activate alarm in the event of an emergency. The Supervisor/Employee notifies Chief Emergency Leader via radio, verbally or telephone or internal office paging. The Chief Emergency Leader notifies Security of details of emergency and location. The Chief Emergency Leader will contact the GM/AGM. The General Manager, or in his absence, the Assistant General Manager will speak to the media or members of the general public during an emergency.

Describe what action is to be taken and by whom when a warning is issued (including details of a meeting place in a safe identified area and activating the evacuation plan, if necessary). Supervisor/employee or Chief Emergency Leader activates alarm. Facility is evacuated via the closest and safest emergency exit and assembles at their designated assembly point (see attached map). The Emergency Leaders will conduct a head count and report to the Chief Emergency Leader at Security with the results of the head count. The Chief Emergency Leader will report any missing persons to Emergency Services upon their arrival. Emergency services will assist in the evacuation of surrounding business that may be effected by the incident.

Communication with Emergency Response Authorities

Describe when and how the licence holder will give early warning to emergency response authorities (including a process to ensure that a call is placed to 911). The Chief Emergency Leader or Security will notify Emergency Services. Upon activation of the alarm, the alarm monitoring company automatically notifies the Fire Department of the emergency.

Describe provisions for fire department entry when there are no operations or staffing at the propane site. Presstran Industries has a 24/7 security guard service on site that controls access at all times.

Describe how the licence holder will ensure continual flow of updated information to authorities. The Chief Emergency Leader/Security/GM/AGM will maintain communication to the appropriate authorities via telephone, or in person.

How long will it take the facility liaison person to respond to the site. We have personnel on site 24/7.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Brian FitzPatrick	Official Title Purchasing Manager	
Signature 	Telephone No. 519-633-7080	Date (dd-mm-yyyy) 08/04/2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

6. Building and Site Security and Procedures

	Yes	No
1. Does the propane location have controlled access to limit unnecessary risk and entry (lock out procedures)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
2. Is there adequate night lighting at the site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
3. Are procedures in place that ensure access routes, aisles, storage area, filling areas and the grounds are kept clear from unwanted materials?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
4. Are there procedures that capture and record the daily inspection of hoses and inspection requirements for filling systems and mechanical devices used in the transfer of propane?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
5. Does the facility have procedures that include a process to isolate and purge any overfilled propane cylinders?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
6. Are weighing systems validated for accuracy?	<input type="checkbox"/>	<input checked="" type="checkbox"/>
7. Are storage areas clearly marked with the vessels' capacity status (i.e., filled, empty, purged and other hazardous materials)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
8. Are quality assurance procedures in place to ensure that all valves are closed after the propane cylinders are filled?(e.g., QCC valves)	<input checked="" type="checkbox"/>	<input type="checkbox"/>
9. Is the schedule of maintenance and testing activities retained on site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>

7. Water Supply

The propane licence holder should work with the local fire department to determine water supply capabilities that are available based on the propane facility's location.

	Yes	No
1. Is a pressurized water system available at the propane facility site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
2. Can the municipal fire department pump 375 GPM (1420 LPM) of water at this location?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
3. What is the unobstructed distance to the closest water supply that could be used for firefighting activities? (distance in metres only)		<u>23m & 94m</u>
4. What is the unobstructed distance to the closest approved water supply with year round access if there are no hydrants? (distance in metres only)		<u>N/A</u>

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Brian FitzPatrick	Official Title Purchasing Manager	
Signature 	Telephone No. 519-633-7080	Date (dd-mm-yyyy) 08/04/2011



Technical Standards and Safety Authority
 www.tssa.org
 14th Floor - Centre Tower
 3300 Bloor Street West
 Toronto Ontario M8X 2X4
 Fax: 416.231.4903
 Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
 Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)
 The licence holder will complete Section B in consultation with the local Fire Services.
 B. Licence holder and local Fire Services Review

To be completed by the Local Fire Services

Has the local fire service had an opportunity to review the Emergency Response and Preparedness Plan? Yes No

If not, please explain (e.g., no fire services).

Fire services comments, if any:

To be completed by the Licence Holder

In response to the above comments, the following action(s) is required:

The licence holder will respond to the Local Fire Services comments by: _____ (dd-mm-yyyy)

LOCAL FIRE SERVICES

The undersigned has reviewed Section B of the Risk and Safety Management Plan Fire Services.

Print name	Signature	Date (dd-mm-yyyy)
Local Fire Services Name CFPO William Todd		01-04-2011

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) BRIAN FITZPATRICK	Official Title PURCHASING MGR	
Signature 	Telephone No. 514-633-7080	Date (dd-mm-yyyy) 08/04/2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS
Applicant must include a Facility Site Plan and Map of Surrounding Area

Facility Site Plan.

The licence holder will submit a copy of the original facility site plan updated with the following information:

1. The storage location of fixed, portable, and mobile vessels.
2. The maximum volume, types and storage location of hazardous materials.
3. Location of permanent structures on site.
4. Access and egress points and location of barriers.
5. Location of fire and emergency equipment (e.g., sprinkler systems, extinguishers, suppression systems) on site and location of fire hydrant or water supply where available.
6. Location of emergency shut off/shut down switches/valves.

Map of Surrounding Area.

The licence holder will submit a scaled aerial map of the surrounding area showing the following information:

7. The capacity and placement of the single largest propane storage vessel, including its setback from the front, rear and side property lines.
8. GPS co-ordinates of the single largest vessel.
9. Visual indication of the single largest fixed vessel and a circle made using the distance in Table 1 as the radius from the single largest fixed vessel.
10. Clear indication of the municipality or municipalities present within the circle.
11. Visual indication of property line information.
12. The location and name of roads within or abutting the site.
13. Key note to the drawing indicating the facility's municipal address, municipal lot number(s) and concession lines as applicable, and the date the map was prepared.
14. Address and contact information for each municipality (municipal clerk or secretary-treasurers of planning board). (Refer to page 5.)
15. Complete "Required Mapping Information from Updated Site Plan" in table below .

Required Mapping Information from Updated Site Plan

Date Map Prepared (dd-mm-yyyy) 03/03/2011	Capacity of single largest propane storage vessel (USWG) 2000 USWG
Tank setback coordinates. Indicate placement on the map.	
Front: 203M	Right side property line: 118M
Rear: 34M	Left side property line: 247M
GPS coordinates of single largest vessel: N42.7886 W81.1626	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Brian FitzPatrick	Official Title Purchasing Manager
Signature 	Telephone No. 519-633-7080
	Date (dd-mm-yyyy) 08/04/2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)
Applicant must include a Facility Site Plan and Map of Surrounding Area


Table 1: Distance Table

Water Capacity (litres)	Nominal Water Capacity (USWG)	Distance to 1 psi overpressure (m)
1,890	500	155
3,780	1,000	195
4,920	1,300	213
6,620	1,750	235
7,130	1,885	241
7,560	2,000	246
18,900	5,000	333

Formula: $D = 16.94 \times (1.524 \times C)^{1/3}$
 D = Distance to overpressure of 1 psi (meters)
 C = Tank Total Capacity in USWG

Parameters: Density of Propane is 0.5033 kg per litre @ 15 C
 Assume all vessels are 80% full
 1 gallon [US, liquid] = 0.003785411784 cubic meter
 1 cubic metre = 264.17 USWG

Hazard Distance Chart (EPA-TNT model)

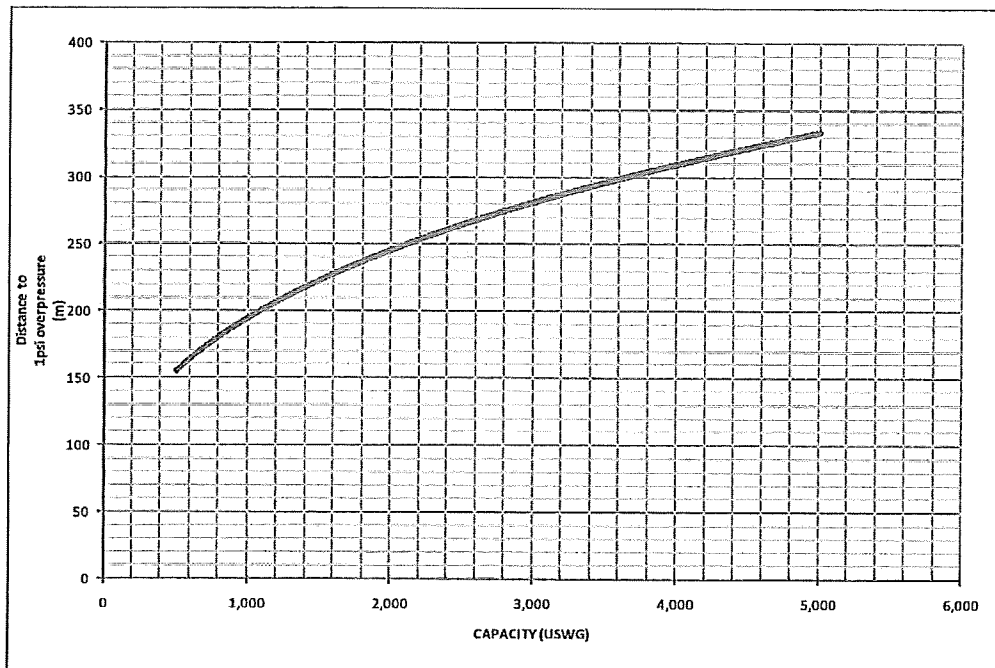

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Brian FitzPatrick	Official Title Purchasing Manager
Signature 	Telephone No. 519-633-7080
Date (dd-mm-yyyy) 08/04/2011	



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)

Applicant must include a Facility Site Plan and Map of Surrounding Area

As an accompaniment to the Map of Surrounding Area, provide the following information about buildings and features present within the circle in Table 2.

Table 2: Buildings and Features

Buildings and Features Present within the Circle on the Map of the Surrounding Area AND Name and Address of Closest Building or Feature	* Number of Buildings and Features (mark with an "X")				Distance from Tank to Closest Building or Feature
	0	1	2-10	11+	
Industrial buildings or parks or golf courses Name: Vacant, LaFarge Cement Address: 50 Harwill Rd., 104 Gaylord Rd. City: St. Thomas Province Ont. Postal Code Various			x		138 m
Residential building units specifically permanent single family dwellings, condominiums, and apartments. Name: _____ Address: _____ City: _____ Province _____ Postal Code _____	X				_____ m
Commercial building units specifically retail, restaurants, entertainment, theatres, and sporting complexes. Name: _____ Address: _____ City: _____ Province _____ Postal Code _____	X				_____ m
Commercial building units – continuous occupancy specifically hotels, campgrounds, and resorts. Name: _____ Address: _____ City: _____ Province _____ Postal Code _____	X				_____ m
Sensitive institutions specifically hospitals, schools and day cares, nursing and retirement homes, mental health institutions, and prisons. Name: _____ Address: _____ City: _____ Province _____ Postal Code _____	X				_____ m
Emergency responders specifically fire stations, ambulance stations, and police stations. Name: _____ Address: _____ City: _____ Province _____ Postal Code _____	X				_____ m

* For multi-unit buildings, count each unit as "1".

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Brian FitzPatrick	Official Title Purchasing Manager		
Signature 	Telephone No. 519-633-7080 <table border="1" style="float: right;"> <tr> <td>Date (dd-mm-yyyy)</td> <td>08/04/2011</td> </tr> </table>	Date (dd-mm-yyyy)	08/04/2011
Date (dd-mm-yyyy)	08/04/2011		



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)
Applicant must include a Facility Site Plan and Map of Surrounding Area

Portable Storage Additional Information Sheet

Cylinder Size	Capacity in USWG	Quantity	Total Volume in USWG
# 420	123.9		
# 100	29.5		
# 40	11.75		
# 33.3	9.62	68	654.16
# 30	8.8		
# 20	5.8		
# 10	2.9		
# 5	1.5		
Total Cylinder Capacity			


Tanks Stored On-site Not Connected for Use

Tank Size In USWG	Quantity	Total Volume In USWG
Total Tank Capacity		


Total Cylinder Capacity	654.16 USWG
Total Tank Capacity	2000 USWG
Total Portable Capacity	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.


Name of person completing this form (please print) Brian FitzPatrick	Official Title Purchasing Manager
Signature 	Telephone No. 519-633-7080
	Date (dd-mm-yyyy) 08/04/2011



- Lubricant tote
- ➔ Emergency exit
- ⊙ Fire Hydrant
- ⚡ Siamese connection

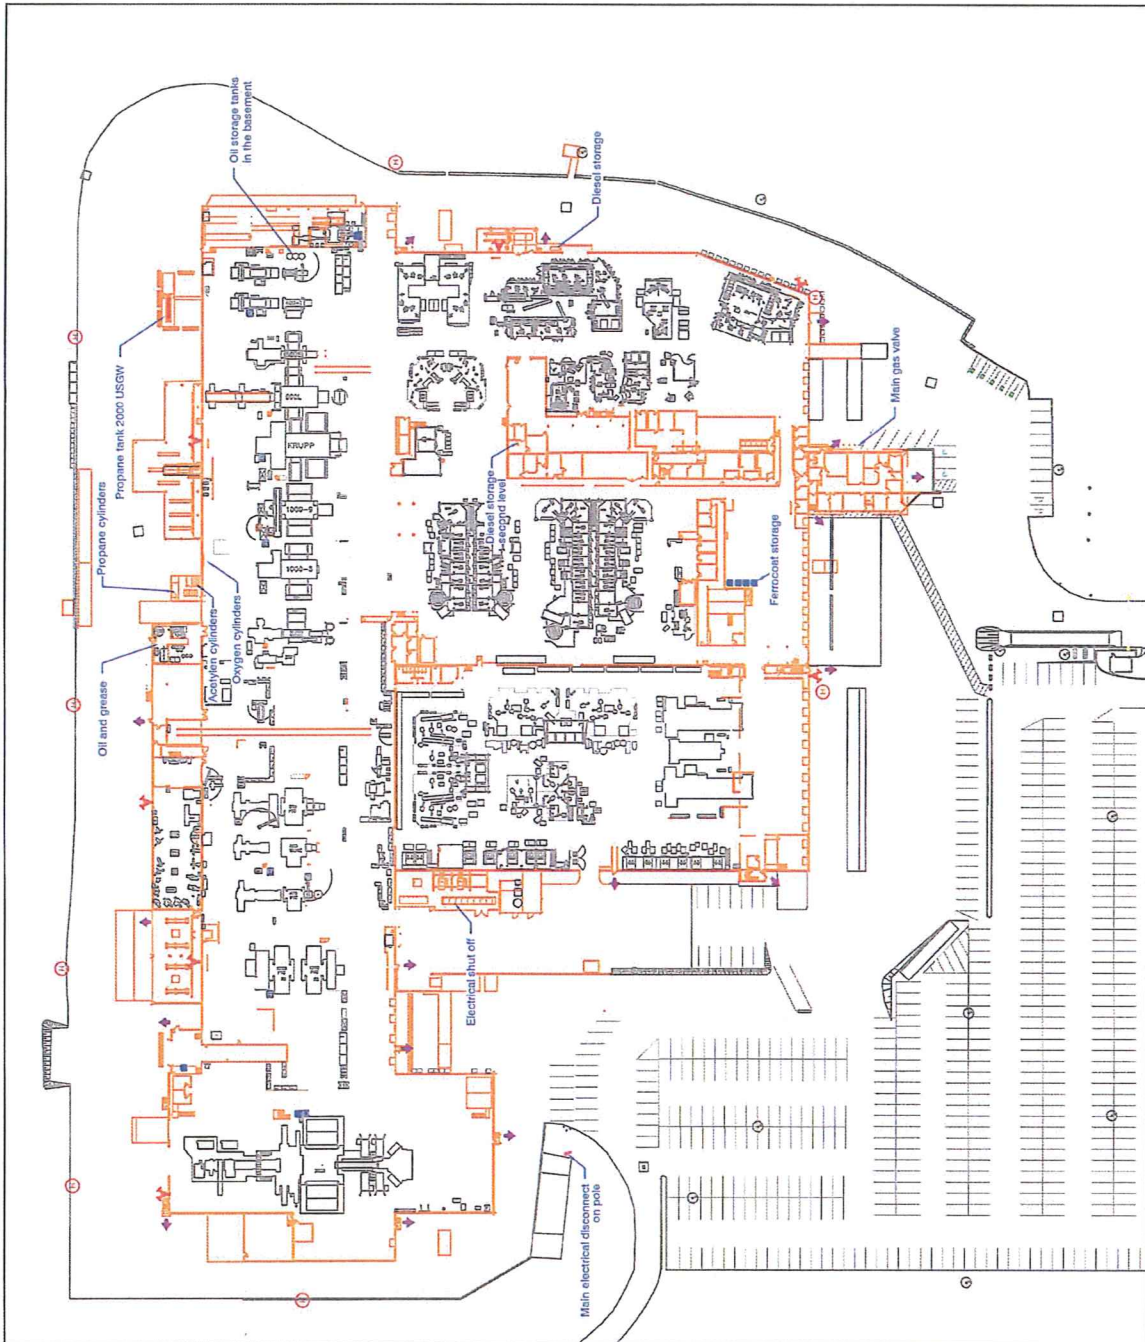

DET. / CITY	DESCRIPTION	SIZE	DRAWING NUMBER
	Presstran Industries	100' x 100'	
	A DIVISION OF VISION ENTERPRISES, INC.	100' x 100'	
	BY: TRISTAN, CREATORS, INC. 401		
DESCRIPTION: Risk and Safety Management Plan - Presstran Facility Site Plan			
DATE: MARCH 3, 11	DESIGNER: VL	SCALE: 1:750 (C)	DWG. NAME: RSMP-2011-A2

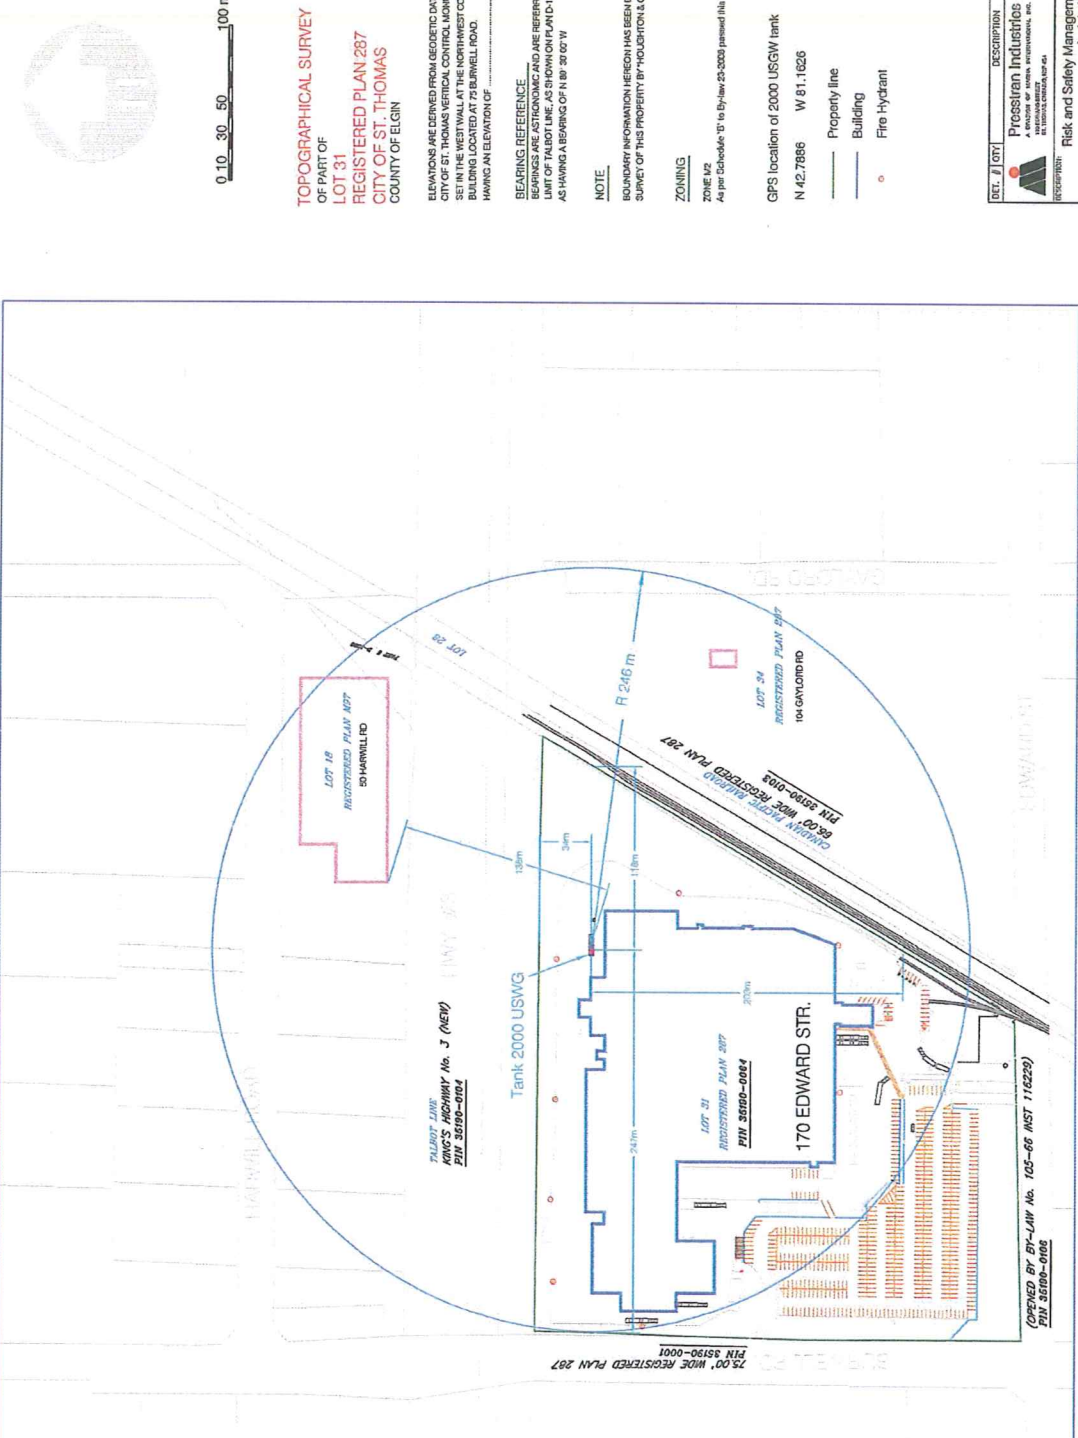

0 10 30 50 100 m

TOPOGRAPHICAL SURVEY
 OF PART OF
LOT 31
REGISTERED PLAN 287
CITY OF ST. THOMAS
 COUNTY OF ELGIN

ELEVATIONS ARE DERIVED FROM GEODETIC DATUM AND ARE REFERRED TO CITY OF ST. THOMAS VERTICAL CONTROL MONUMENT No. 8, BEING A PLACED IN THE NORTH WEST CORNER OF THE TERRACE BUILDING LOCATED AT 77 BURNELL RD. HAVING AN ELEVATION OF 770.33

BEARINGS REFERENCE BEARINGS ARE ASTRONOMIC AND ARE REFERRED TO THE SOUTH LIMIT OF TALBOT LINE, AS SHOWN ON PLAN D-1002 AS HAVING A BEARING OF N 89° 30' 00" W

NOTE

BOUNDARY INFORMATION HEREON HAS BEEN DERIVED FROM A PLAN SURVEY OF THIS PROPERTY BY HOUGHTON & COMPANY DATED MAY 2007.

ZONINGS

ZONE M2
 As per Schedule "1" to By-law 28-2009 passed (1st 16th of February, 2009)

GPS location of 2000 USGW tank
 N 42.7886 W 81.1626

- Property line
- Building
- Fire hydrant

DET. # (LOT)	DESCRIPTION	DRAWING NUMBER
101	Pressiran Industries A BRANCH OF MIRA INVESTMENTS, INC. 101 GAYLORD RD. ST. THOMAS, ONTARIO, CANADA	101-11
102	Risk and Safety Management Plan - Pressiran Aerial plan	102-11
DATE:	MARCH 1, '11	SCALE: 1:1500 (D)
PROJECT:		PROJECT NO: RSM-2011-A1