



Technical Standards and Safety Authority
 www.tssa.org

14th Floor - Centre Tower
 3300 Bloor Street West
 Toronto Ontario M8X 2X4
 Fax: 416.231.4903
 Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
 Propane Storage and Handling Regulation

This Level 1 RSMP applies to:

- a facility with a total propane storage capacity of 5,000 USWG or less; or
- a facility with a fixed propane storage capacity of exactly 5,000 USWG and no more than 500 USWG of portable propane storage capacity on site.


Failure to fully complete this form may result in rejection. Making a false statement may result in a fine or prosecution under the *Technical Standards and Safety Act*

Licence Number 0076509819-C

Check applicable type of propane operations.

Cylinder Motor Fill Filling Plant Card/Keylock

Submit along with this completed application a Facility Site Plan and a Map of the Surrounding Area.



July 1

SECTION A: GENERAL INFORMATION

The Undersigned applies to TSSA for a review for an RSMP under Ontario's *Technical Standards and Safety Act, Propane Storage and Handling Regulation.*

Company Name 3600106 MANITOBA INC Ontario Corporation No., if applicable _____

Operator Name (if different from above)
o/a Piston Ring Service & Supply

Telephone No. (807) 227-2630 Fax No. (807) 227-2327 E-mail prvbaymgr@pistonringservice.com

Street No. _____ Street Name / 911 Number / Address, if applicable
Hwy. 17 & Elm St., P.O. Box 130

Town / City or Township / County Vermilion Bay Province ON Postal Code POV 2V0

Mailing address if different from above.

Street No. 660 Street Name / 911 Number / Address, if applicable
Wall Street, P.O. Box 843

Town / City or Township / County Winnipeg Province MB Postal Code R3C 2P7

Information on Container Refill Centre or Filling Plant

Location of facility.


Street No. _____ Street Name / 911 Number / Address, if applicable
Hwy. 17 & Elm St. Nearest Major Intersection Hwy. 17 & Hwy. 105 / Elm Street

Town / City or Township / County Vermilion Bay Province ON Postal Code POV 2V0

Name of Licence Holder
3600106 MANITOBA INC O/A PISTON RING SERVICE

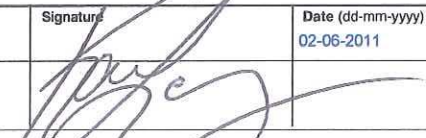
Name of a Senior Management person as defined in the regulation holding the Record of Training (ROT). ROT type
Karl Lang 100-01

Municipality (or municipalities if the facility or its hazard distance touches multiple borders)
Machin

Hours of operation.


This document is valid until the next licence renewal date. You are required by law to notify TSSA of any change of information.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Print name Name of Licence Holder <u>Piston Ring Service</u>	Signature 	Date (dd-mm-yyyy) <u>02-06-2011</u>
Name of Senior Management person as defined in the Regulation holding the Record of Training <u>Karl Lang</u>		



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION A: GENERAL INFORMATION (cont'd)

Indicate the year the facility was established. Indicate the year of any significant modifications, as defined in s.1, O.Reg 211/01, since establishment.
Unknown 1995 Motor Vehicle Propane Pump was removed

Identify the psig rating and serial number for each fixed propane storage tank on site.

	PSIG	Serial Number
Tank1:	250 PSIG	SE5592565
Tank2:	_____	_____
Tank3:	_____	_____

Enter capacity of propane in USWG, fixed, portable, and mobile, and provide detailed inventory that includes the number of tank/vessel for each type (fixed, portable, and mobile) and the capacity of each tank/vessel, on a separate document.

Fixed: 2000 USWG Portable: 0 USWG Mobile: 0



Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Karl Lang	Official Title Manager	
Signature 	Telephone No. (807) 227-2630	Date (dd-mm-yyyy) 02-06-2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION A: GENERAL INFORMATION (cont'd)
Activity Information

Name of Propane Supplier(s) Superior Propane - Ontario Regional Operations Centre			
Street No. 251	Street Name / 911 Number / Address, if applicable Woodlawn Road West, Unit 217		
Town / City or Township / Country Guelph		Province Ontario	Postal Code N1H 8J1
Telephone No. 1-877-873-7467	Fax No. 519-836-7766	Contact Name Mike Mullins	
E-mail mullinsm@superiorpropane.com			

Name of Propane Transporter. If same as above, please check box. <input type="checkbox"/>			
Superior Propane - Dryden			
Street No. 30	Street Name / 911 Number / Address, if applicable Keith Avenue		
Town / City or Township / Country Dryden		Province ON	Postal Code P8N 2Z4
Telephone No. (807) 628-6393	Fax No.	Contact Name Phil Eddy	
E-mail eddy@superiorpropane.com			

Off-site Cylinder and/or Mobile Storage None	Capacity stored off-site, in USWG	For Office Use - Party No.
Street No.	Street Name / 911 Number / Address, if applicable	
Town / City or Township / Country		Province
Telephone No.		Contact Name

Note: Customer storage is not considered off-site storage.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Karl Lang	Official Title Manager
Signature 	Telephone No. 807-227-2630
	Date (dd-mm-yyyy) 02-06-2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN

The licence holder will complete Section B in consultation with the local Fire Services.

Description of the maximum volume, types and storage location of other hazardous materials on site, if any.
None

Description of fire and emergency equipment indicated on facility site map.

Fire Extinguishers in Building - Type (1 x 10# ABC and 1 x 20# ABC)

Fire Extinguisher at Propane Tank - Type (1 x 20# ABC)

First Aid Kit and Eye & Skin Station located in Main Store/Building.

List of fire protection controls (e.g., fire detection systems, fire notification systems, alarm systems, automatic shut off devices, fusible links, etc.) and describe their function, use and operation.

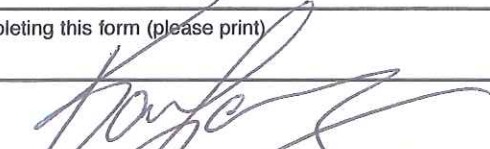
1. Fusible link on ISC valve - isolation valve between the tank and the downstream propane dispensing equipment.
2. Emergency stop push button - mounted on a post near the propane tank. This shuts down the pump and closes a solenoid valve upstream of hoses.
3. Power supply breaker inside the gas bar building. This cuts all power to the propane system - shuts down pump; closes solenoid valve.

Maintenance and testing schedule for fire protection controls and devices.

Maintenance and testing is undertaken by Superior Propane according to Superior Propane's Maintenance Standard. Schedule for key equipment is:

1. Pumps (Pump every 3 months; Pump Motor: check belts monthly; grease motor every 6 months)
2. ISC Valves (test for closure every 6 months)
3. Storage tank Relief Valves - inspect every 2 years; replacement schedule as per provincial regulations.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Karl Lang	Official Title Manager
Signature 	Telephone No. (807) 227-2630
	Date (dd-mm-yyyy) 02-06-2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

1. Contacts for Emergency Response

1. Facility Contact Personnel - Key Contact

Name Karl Lang	For Office Use - Party No.
Official Title Manager	
Telephone No. (807) 227-2630	Fax No. (807) 227-2327
E-mail prvbay@pistonringservice.com	
Role and responsibilities in emergency Coordinate site response	

5. Facility 24-Hour Contact Person

Name Karl Lang	For Office Use - Party No.
Official Title Manager	
Cell No. (807) 529-4132	Fax No. (807) 227-2327
E-mail prvbay@pistonringservice.com	
Role and responsibilities in emergency Coordinate site response	

2. Facility Contact Personnel - Alternate Contact

Name Lesley Tourond	For Office Use - Party No.
Official Title Counter Person	
Telephone No. (807) 227-2630	Fax No. (807) 227-2327
E-mail prvbay@pistonringservice.com	
Role and responsibilities in emergency Coordinate site response if agent unavailable.	

6. Name of Facility Manager

Name Karl Lang	For Office Use - Party No.
Official Title Manager	
Telephone No. (807) 227-2630	Fax No. (807) 227-2327
E-mail prvbay@pistonringservice.com	
Role and responsibilities in emergency Coordinate site response	

3. Local Fire Services - Key Contact

Name Robert Wisneski	For Office Use - Party No.
Official Title Fire Chief	
Telephone No. (807) 227-2056	Fax No. (866) 505-3447
E-mail machinfire@bellnet.ca	
Role and responsibilities in emergency Coordinate/advise on Fire Service response. Liaise with police.	

7. Propane Supplier Key Contact Person

Name Superior Propane Hotline	For Office Use - Party No.
Official Title	
Telephone No. 1-877-873-7467	Fax No.
E-mail	
Role and responsibilities in emergency Identify and dispatch Superior Propane and or LPERGC emergency response personnel as required.	

4. Local Fire Services - Alternate Contact

Name Cora MacRae	For Office Use - Party No.
Official Title Machin Fire Dept.	
Telephone No. (807) 227-2056	Fax No. (866) 505-3447
E-mail machinfire@bellnet.ca	
Role and responsibilities in emergency Alternate - Coordinate/advise on Fire Service Response. Liaise with police.	

8. Municipal Contact

Name Tammy Rob	For Office Use - Party No.
Official Title Town Clerk/Treasurer	
Telephone No. (807) 227-2633	Fax No. (807) 227-5443
E-mail clerktreasurer@visitmachin.com	
Municipality Machin	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Karl Lang	Official Title Manager
Signature 	Telephone No. 807-227-2630
	Date (dd-mm-yyyy) 02-06-2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

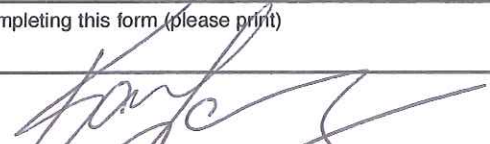
SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

2. Additional Safety Measures

Describe any other measures in place at the facility that exceed the minimum Code and Standards requirements.

Emergency Shut Off push button to shut down pump and close solenoid valve upstream of dispensing hoses.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Karl Lang	Official Title Manager	
Signature 	Telephone No. (807) 227-2630	Date (dd-mm-yyyy) 02-06-2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

3. Record of Emergency Training Provided - For most recent 12-month period.

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Training Date (dd-mm-yyyy)	Print Name of Training Provider: None
	Print Name of Instructor:
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

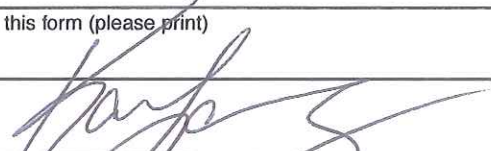
Training on the facility's Emergency Management Procedures provided to staff.

Training Date (dd-mm-yyyy)	Print Name of Training Provider: None
	Print Name of Instructor:
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

On-site specific training provided to certificate holders / persons with Records of Training.

Training Date (dd-mm-yyyy) 08-10-2010 (Karl Lang)	Print Name of Training Provider: Propane Training Institute
	Print Name of Instructor: Carmine Fagnilli
Training Date (dd-mm-yyyy) 06-10-2009 (Lesley Tourond)	Print Name of Training Provider: Propane Training Institute
	Print Name of Instructor: Ernie Matthews
Training Date (dd-mm-yyyy) 05-05-2010 (John Tennant)	Print Name of Training Provider: Propane Training Institute
	Print Name of Instructor: Jim Gregorchuk

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Karl Lang	Official Title Manager
Signature 	Telephone No. (807) 227-2630
	Date (dd-mm-yyyy) 02-06-2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

4. Emergency Training Plan for Coming Year

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Target Date (dd-mm-yyyy) Q4 (2011)	Print Name of Training Provider: Superior Propane or Other	Please Note - the course content is currently being developed by the TSSA with the intent that it and its provider will be ready to deliver this training in the fourth quarter of this year.
	Print Name of Instructor: to be arranged	
Target Date (dd-mm-yyyy)	Print Name of Training Provider:	
	Print Name of Instructor:	
Target Date (dd-mm-yyyy)	Print Name of Training Provider:	
	Print Name of Instructor:	

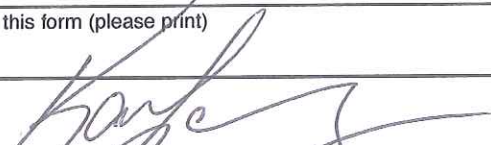
Training on the facility's Emergency Management Procedures provided to staff.

Target Date (dd-mm-yyyy) Q4(2011)	Print Name of Training Provider: Key site contact to train staff
	Print Name of Instructor: to be arranged
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

On-site specific training provided to certificate holders / persons with Records of Training.

Target Date (dd-mm-yyyy) As required	Print Name of Training Provider: Superior Propane, FSN, or Other	Please Note - a ROT is valid for 3 years
	Print Name of Instructor: to be arranged	
Target Date (dd-mm-yyyy)	Print Name of Training Provider:	
	Print Name of Instructor:	
Target Date (dd-mm-yyyy)	Print Name of Training Provider:	
	Print Name of Instructor:	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Karl Lang	Official Title Manager
Signature 	Telephone No. (807) 227-2630
	Date (dd-mm-yyyy) 02-06-2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

5. Emergency Response Communications Plan

Warnings and Actions

Describe who gives warnings to whom, and how and when the warning will be given (including public notification as appropriate).
The operator or alternate will contact emergency services by calling 911 and will provide warnings outlined in the attached "Propane Emergency Response Procedures" placard (to be posted on site and part of the employee training). If it is safe to do so this could involve advising neighbours to evacuate.
The owner/operator may also contact Superior Propane via the emergency number identified in the ERP.

Describe what action is to be taken and by whom when a warning is issued (including details of a meeting place in a safe identified area and activating the evacuation plan, if necessary).
Actions and warnings will be taken by on duty ROT person(s) as per attached ERP placard. Only a few gas bar staff will be on duty when operating the propane system. The Muster location will be on Highway 17, in a safe area. Note a specific muster point is not advisable, since a propane plume can blow in any direction.
Note that the facility is in a wide open area allowing people to self evacuate.

Communication with Emergency Response Authorities

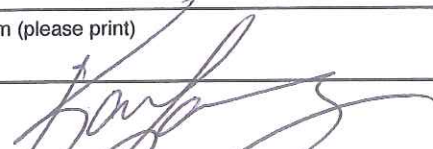
Describe when and how the licence holder will give early warning to emergency response authorities (including a process to ensure that a call is placed to 911).
When the system is operational, a ROT person will be on duty and be in the propane tank area. This person will be able to visually ascertain any abnormal/accident events and implement the appropriate ER actions including notifying emergency responders. When the system is not in operation, the ISC valve (main isolation valve) is closed, and the propane system is unattended but shut down. Any accidents involving the propane tank during such times will require the intervention of random, nearby individuals or staff.

Describe provisions for fire department entry when there are no operations or staffing at the propane site.
The propane tank system is located in a wide open area that is easily accessible by Highway 17.
The fire access routes are identified in the attached site plan.

Describe how the licence holder will ensure continual flow of updated information to authorities.
The critical information required from the license holder is how to shut the system down and the fill level in the tank (if known).
Fill level is relevant from a time-to-BLEVE perspective (a near empty tank will BLEVE sooner than a full tank if there is fire impingement on the tank).
This information will be provided to the authorities verbally by agent - Karl Lang, if on site, or by cell phone if after hours.

How long will it take the facility liaison person to respond to the site.
Approximately 10 minutes, after having received the emergency call.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Karl Lang	Official Title Manager	
Signature 	Telephone No. (807) 227-2630	Date (dd-mm-yyyy) 02-06-2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

6. Building and Site Security and Procedures

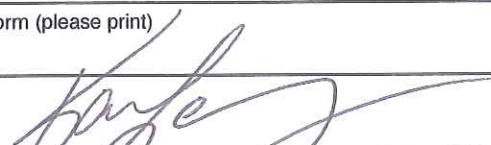
	Yes	No
1. Does the propane location have controlled access to limit unnecessary risk and entry (lock out procedures)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
2. Is there adequate night lighting at the site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
3. Are procedures in place that ensure access routes, aisles, storage area, filling areas and the grounds are kept clear from unwanted materials?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
4. Are there procedures that capture and record the daily inspection of hoses and inspection requirements for filling systems and mechanical devices used in the transfer of propane?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
5. Does the facility have procedures that include a process to isolate and purge any overfilled propane cylinders?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
6. Are weighing systems validated for accuracy?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
7. Are storage areas clearly marked with the vessels' capacity status (i.e., filled, empty, purged and other hazardous materials)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
8. Are quality assurance procedures in place to ensure that all valves are closed after the propane cylinders are filled?(e.g., QCC valves)	<input checked="" type="checkbox"/>	<input type="checkbox"/>
9. Is the schedule of maintenance and testing activities retained on site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>

7. Water Supply

The propane licence holder should work with the local fire department to determine water supply capabilities that are available based on the propane facility's location.

	Yes	No
1. Is a pressurized water system available at the propane facility site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
2. Can the municipal fire department pump 375 GPM (1420 LPM) of water at this location?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
3. What is the unobstructed distance to the closest water supply that could be used for firefighting activities? (distance in metres only)	<u>100 Metres</u>	
4. What is the unobstructed distance to the closest approved water supply with year round access if there are no hydrants? (distance in metres only)	<u>N/A</u>	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Karl Lang	Official Title Manager	
Signature 	Telephone No. (807) 227-2630	Date (dd-mm-yyyy) 02-06-2011



Technical
Standards and
Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

8. Licence holder and local Fire Services Review

To be completed by the Local Fire Services

Has the local fire service had an opportunity to review the Emergency Response and Preparedness Plan?

Yes No

If not, please explain (e.g., no fire services).

Fire services comments, if any:

To be completed by the Licence Holder

In response to the above comments, the following action(s) is required:

The licence holder will respond to the Local Fire Services comments by: _____ (dd-mm-yyyy)

LOCAL FIRE SERVICES

The undersigned has reviewed Section B of the Risk and Safety Management Plan Fire Services.

Local Fire Services Name	Print name <i>Bob Wisneski</i>	Signature <i>[Signature]</i>	Date (dd-mm-yyyy) <i>07/05/2011</i>
--------------------------	-----------------------------------	---------------------------------	----------------------------------------

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) <i>Karl Lang</i>	Official Title <i>Manager</i>
Signature	Telephone No. <i>(807) 227-2630</i>
	Date (dd-mm-yyyy) <i>02-06-2011</i>



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS

Applicant must include a Facility Site Plan and Map of Surrounding Area

Facility Site Plan.

The licence holder will submit a copy of the original facility site plan updated with the following information:

1. The storage location of fixed, portable, and mobile vessels.
2. The maximum volume, types and storage location of hazardous materials.
3. Location of permanent structures on site.
4. Access and egress points and location of barriers.
5. Location of fire and emergency equipment (e.g., sprinkler systems, extinguishers, suppression systems) on site and location of fire hydrant or water supply where available.
6. Location of emergency shut off/shut down switches/valves.

Map of Surrounding Area.

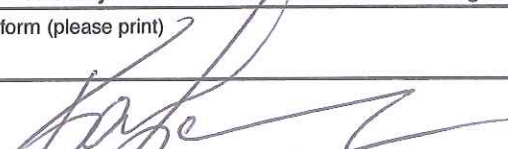
The licence holder will submit a scaled aerial map of the surrounding area showing the following information:

7. The capacity and placement of the single largest propane storage vessel, including its setback from the front, rear and side property lines.
8. GPS co-ordinates of the single largest vessel.
9. Visual indication of the single largest fixed vessel and a circle made using the distance in Table 1 as the radius from the single largest fixed vessel.
10. Clear indication of the municipality or municipalities present within the circle.
11. Visual indication of property line information.
12. The location and name of roads within or abutting the site.
13. Key note to the drawing indicating the facility's municipal address, municipal lot number(s) and concession lines as applicable, and the date the map was prepared.
14. Address and contact information for each municipality (municipal clerk or secretary-treasurers of planning board). (Refer to page 5.)
15. Complete "Required Mapping Information from Updated Site Plan" in table below .

Required Mapping Information from Updated Site Plan

Date Map Prepared (dd-mm-yyyy) <u>10-01-2011</u>	Capacity of single largest propane storage vessel (USWG) <u>2000 USWG</u>
Tank setback coordinates. Indicate placement on the map.	
Front: <u>89 ft. - 27.12</u>	Right side property line: <u>165 ft. - 50.29</u>
Rear: <u>50 ft. - 15.24</u>	Left side property line: <u>10 ft. - 3.</u>
GPS coordinates of single largest vessel: <u>Lat. 49.8566, Long. -93.3786</u>	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) <u>Karl Lang</u>	Official Title <u>Manager</u>
Signature 	Telephone No. <u>(807) 227-2630</u>
	Date (dd-mm-yyyy) <u>02-06-2011</u>



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)
Applicant must include a Facility Site Plan and Map of Surrounding Area

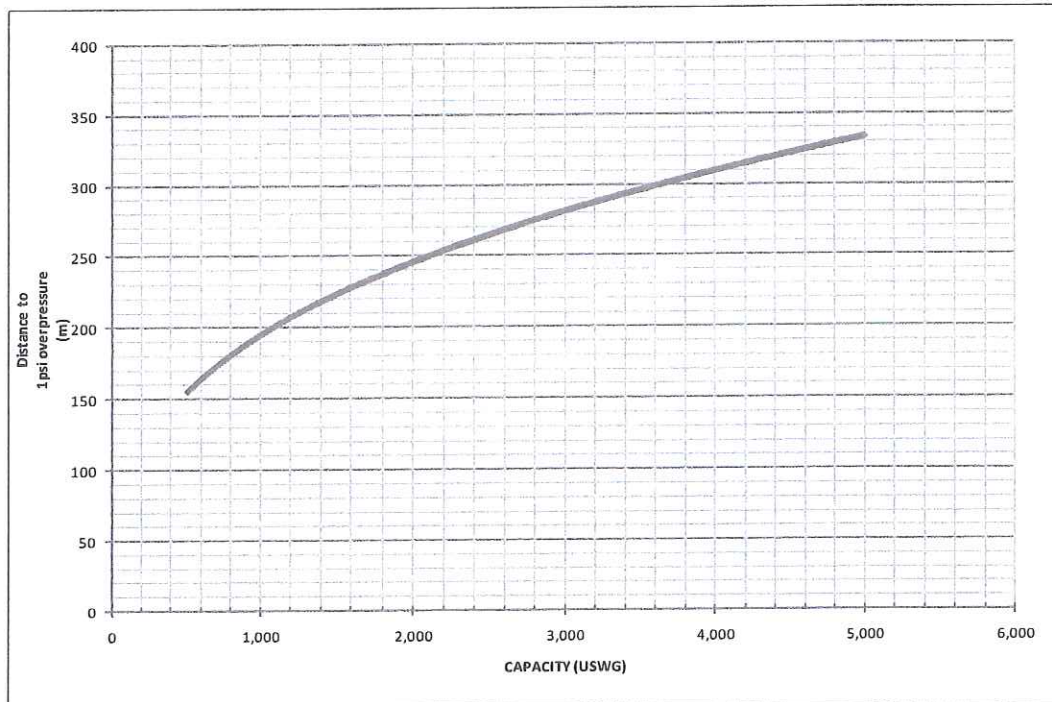
Table 1: Distance Table

Water Capacity (litres)	Nominal Water Capacity (USWG)	Distance to 1 psi overpressure (m)
1,890	500	155
3,780	1,000	195
4,920	1,300	213
6,620	1,750	235
7,130	1,885	241
7,560	2,000	246
18,900	5,000	333

Formula: $D = 16.94 \times (1.524 \times C)^{1/3}$
 D = Distance to overpressure of 1 psi (meters)
 C = Tank Total Capacity in USWG

Parameters: Density of Propane is 0.5033 kg per litre @ 15 C
 Assume all vessels are 80% full
 1 gallon [US, liquid] = 0.003785411784 cubic meter
 1 cubic metre = 264.17 USWG

Hazard Distance Chart (EPA-TNT model)



Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) <i>Nothing completed on this page.</i>	Official Title	
Signature 	Telephone No.	Date (dd-mm-yyyy)



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)

Applicant must include a Facility Site Plan and Map of Surrounding Area

As an accompaniment to the Map of Surrounding Area, provide the following information about buildings and features present within the circle in Table 2.

Table 2: Buildings and Features

Buildings and Features Present within the Circle on the Map of the Surrounding Area AND Name and Address of Closest Building or Feature	* Number of Buildings and Features (mark with an "X")				Distance from Tank to Closest Building or Feature
	0	1	2-10	11+	
Industrial buildings or parks or golf courses Name: <u>None</u> Address: _____ City: _____ Province _____ Postal Code _____	X				<u>0</u> m
Residential building units specifically permanent single family dwellings, condominiums, and apartments. [Redacted]				X	<u>50</u> m
Commercial building units specifically retail, restaurants, entertainment, theatres, and sporting complexes. Name: <u>Credit Union, LCBO, Canada Post, Norwynn Service</u> Address: _____ City: _____ Province _____ Postal Code _____			X		<u>100</u> m
Commercial building units – continuous occupancy specifically hotels, campgrounds, and resorts. Name: <u>Pine Acres Campground, Bayview Hotel</u> Address: _____ City: _____ Province _____ Postal Code _____			X		<u>150</u> m
Sensitive institutions specifically hospitals, schools and day cares, nursing and retirement homes, mental health institutions, and prisons. Name: <u>None</u> Address: _____ City: _____ Province _____ Postal Code _____	X				<u>0</u> m
Emergency responders specifically fire stations, ambulance stations, and police stations. Name: <u>None</u> Address: _____ City: _____ Province _____ Postal Code _____	X				<u>0</u> m

* For multi-unit buildings, count each unit as "1".

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Karl Lang	Official Title Manager
Signature 	Telephone No. (807) 227-2630
	Date (dd-mm-yyyy) 02-06-2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)

Applicant must include a Facility Site Plan and Map of Surrounding Area

Portable Storage Additional Information Sheet


Cylinder Size	Capacity in USWG	Quantity	Total Volume in USWG
# 420	123.9		
# 100	29.5		
# 40	11.75		
# 33.3	9.62		
# 30	8.8		
# 20	5.8		
# 10	2.9		
# 5	1.5		
Total Cylinder Capacity 0			

Tanks Stored On-site Not Connected for Use

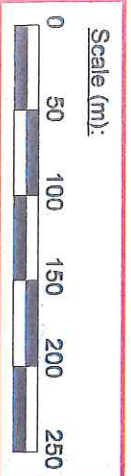
Tank Size In USWG	Quantity	Total Volume in USWG
None		
Total Tank Capacity		

Total Cylinder Capacity	0
Total Tank Capacity	0
Total Portable Capacity	0

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Karl Lang	Official Title Manager
Signature 	Telephone No. (807) 227-2630
	Date (dd-mm-yyyy) 02-06-2011

©2011 Google – Imagery
 ©2011 Digital Globe, Cnes/Spot Image, First Base Solutions,
 Map data ©2011 Google, Tele Atlas



Hazard Distance = 246 m

Setback Distances to Site Boundary: North: .31 m East: 41 m South: 25 m West: 3 m

Capacity of Propane Storage Tank = 2000 USWG

GPS Co-ordinates of Propane Storage Tank = 49.8566, -93.3786

Circular Distance to 1 psi overpressure = 246 m

Municipality (ies) within the 1 psi overpressure circle: Township of Machin

Municipal Contact: **Tammy Rob**
 Clerk, Municipality of Machin
 75 Spruce Street, Vermillion Bay, ON, P0V 2V0
 Tel: 807-227-2633 Fax: 807-227-5443
 email: deputyclerk@vistimachin.com

Map of Surrounding Area

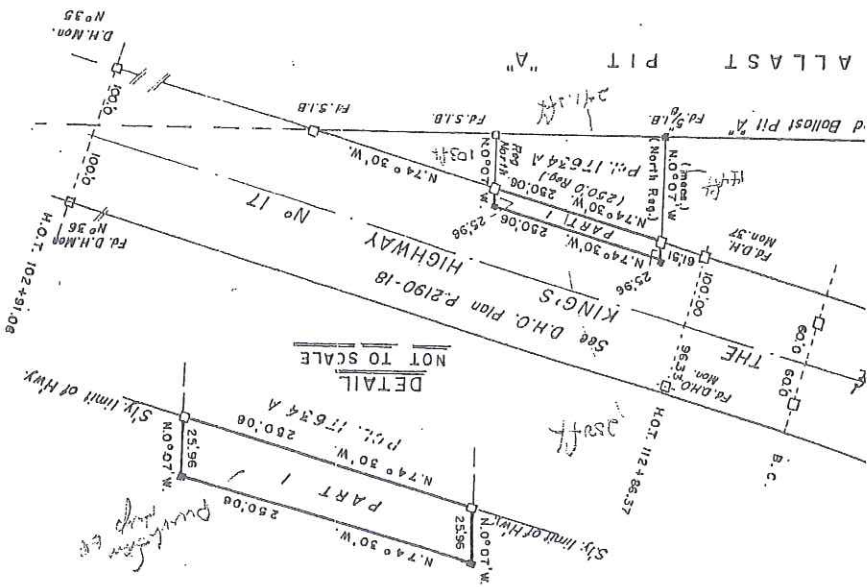
Piston Ring Service & Supply
 HWY 17 & Elm Street, P.O. Box 130, Vermillion Bay, ON, P0V 2V0

Drawn by: L. Oliverio Date: February 23, 2011

PLAN OF SURVEY OF
PART OF LOT 4 - CONCESSION IV
TOWNSHIP OF LANGTON
DISTRICT OF KENORA

SCALE: 1 INCH = 200 FEET
M. M. GRAHAM O.L.S.
1966

ASSUMED AND ARE
30' OF THE LIMIT
TWEEN MONUMENTS N° 38
PARTMENT OF HIGHWAYS



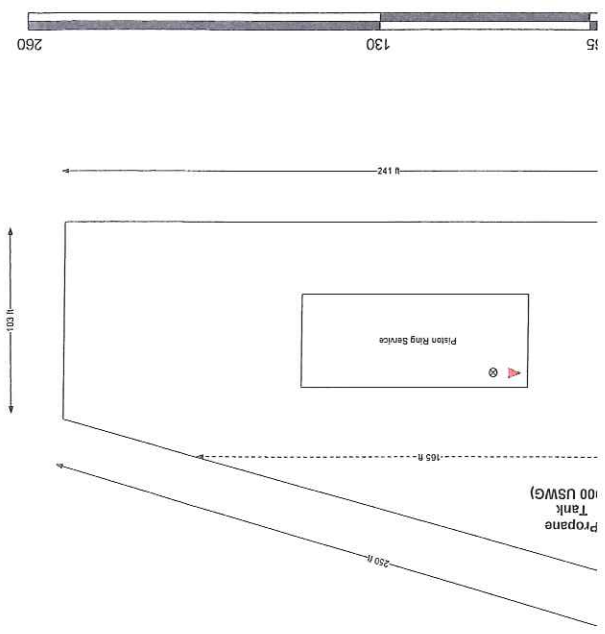
EVIDENCE FOUND AS NOTED
IRON BARS 1" sq. x 48" PLANTED SHOWN
IRON BARS 5/8" sq. x 24" PLANTED SHOWN

KENORA, ONTARIO,
MAY 12, 1966.
OF MAY, 1966.
4 THAT THE SURVEY WAS COMPLETED ON THE 12th DAY
3 THAT THIS PLAN CONTAINS A TRUE COPY OF THE
2 THAT I WAS PRESENT AT AND DID PERSONALLY SUPER-
1 THAT THIS SURVEY AND PLAN ARE CORRECT AND IN
I HEREBY CERTIFY

SURVEYOR'S CERTIFICATE
J-8312

PLAN K.R.-1176
APPROVED 3-June-66
PLAN K.R. 1176
RECORDED UNDER N° 85820
REGISTERED 12 th JAN. 1967
DEPUTY MASTER OF TITLES
PART I GROWN

Date: May 30 th , 2011		Rev 0										
Drawn by: L. Forget		Checked by: C. Britsky										
Superior Propane Ltd. Site Plan Piston Ring Service HWY 17 & ELM Street Vermillion Bay Ontario P.O. Box 130 Township of Langton District of Kenora												
<p>Notes:</p> <p>1. Tank distances to property lines:</p> <table border="1"> <thead> <tr> <th>Property Line Setbacks</th> <th>Distance</th> </tr> </thead> <tbody> <tr> <td>East (Right Side)</td> <td>165 ft</td> </tr> <tr> <td>South (Front Side)</td> <td>89 ft</td> </tr> <tr> <td>West (Left Side)</td> <td>10 ft</td> </tr> <tr> <td>North (Back Side)</td> <td>50 ft</td> </tr> </tbody> </table> <p>2. Fire Extinguisher</p> <p>3. Egress/Fire Access Route: Site is wide open, egress/access points from HWY 17 and from ELM st.</p> <p>4. E-Stop</p>			Property Line Setbacks	Distance	East (Right Side)	165 ft	South (Front Side)	89 ft	West (Left Side)	10 ft	North (Back Side)	50 ft
Property Line Setbacks	Distance											
East (Right Side)	165 ft											
South (Front Side)	89 ft											
West (Left Side)	10 ft											
North (Back Side)	50 ft											
<p>Key Plan:</p> <p>©2011 Google - Map data ©2011 Google</p>												



Propane Tank (100 USWG)